


FILED
May 02, 2023
Data Center
Missouri Public
Service Commission


## Exhibit No. 182


Max Hourly Load in 24 Hour Period @ Generation Voltage July 2021 - June 2022 per Ameren Load Research

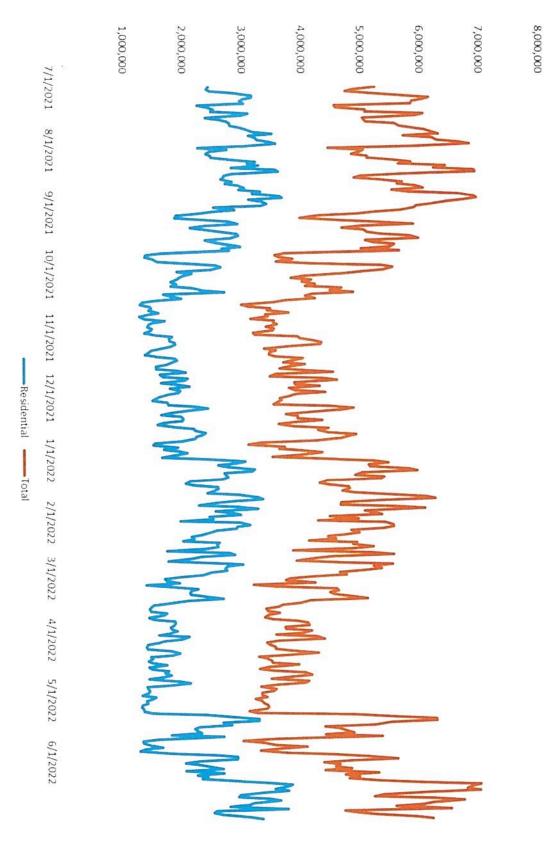


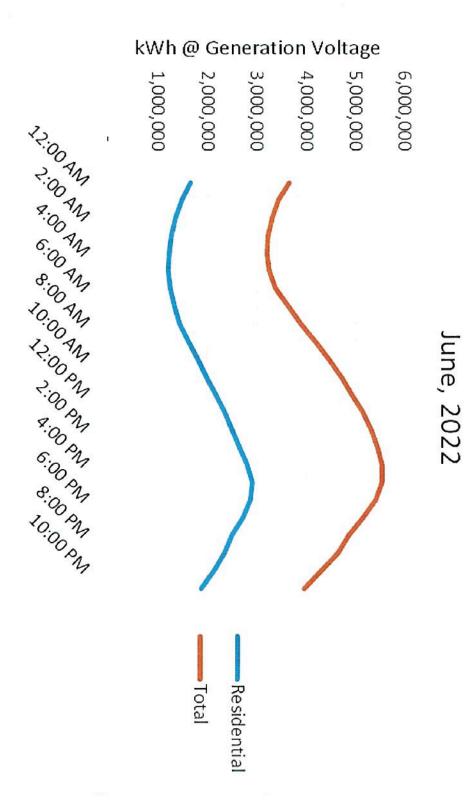


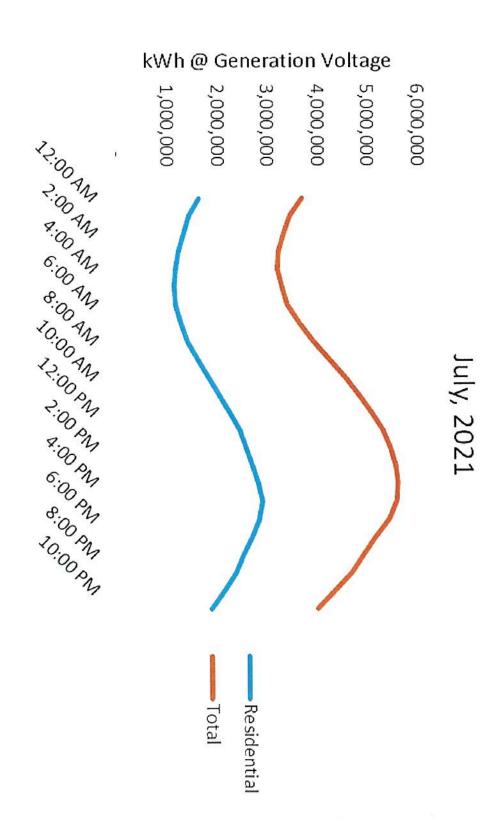

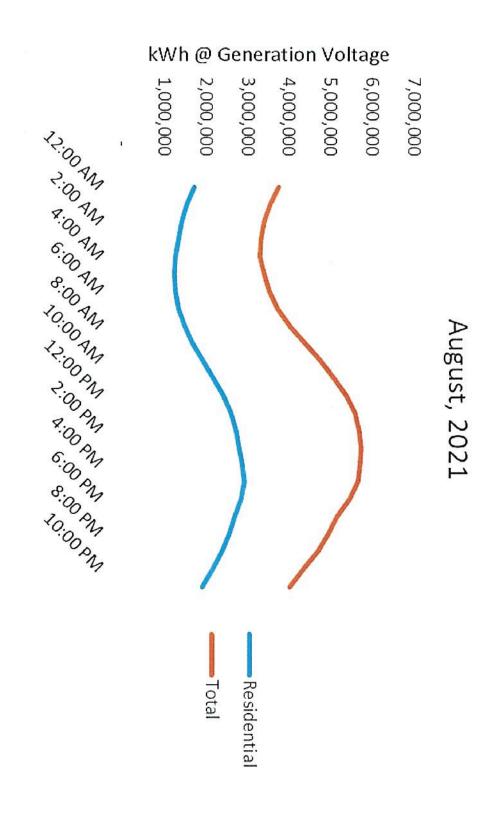

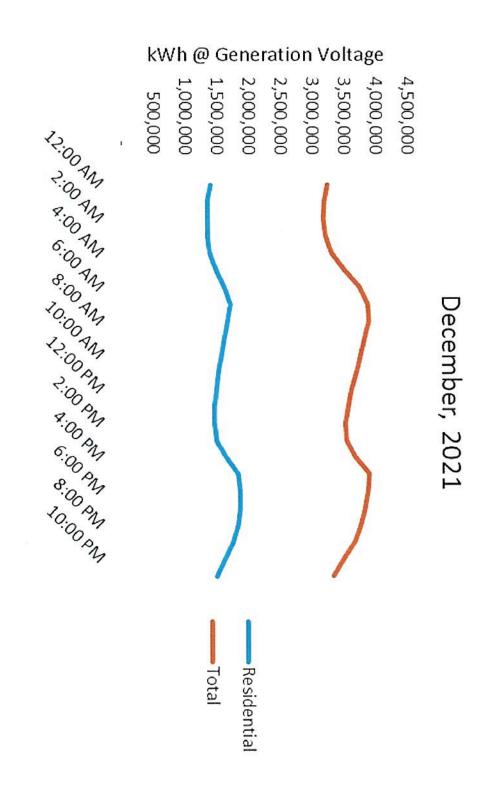

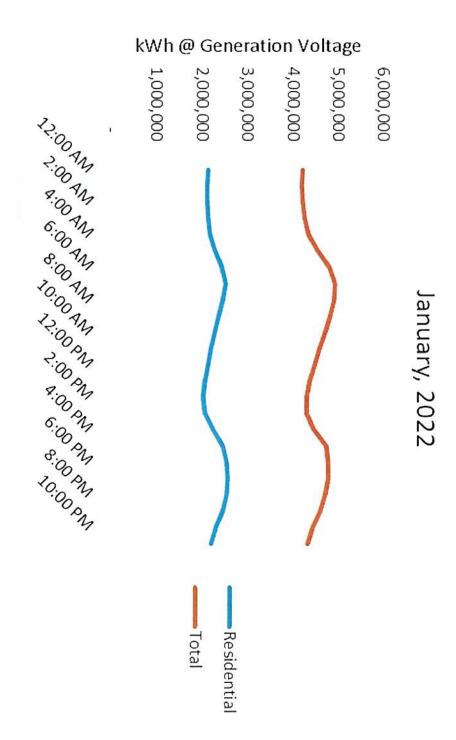

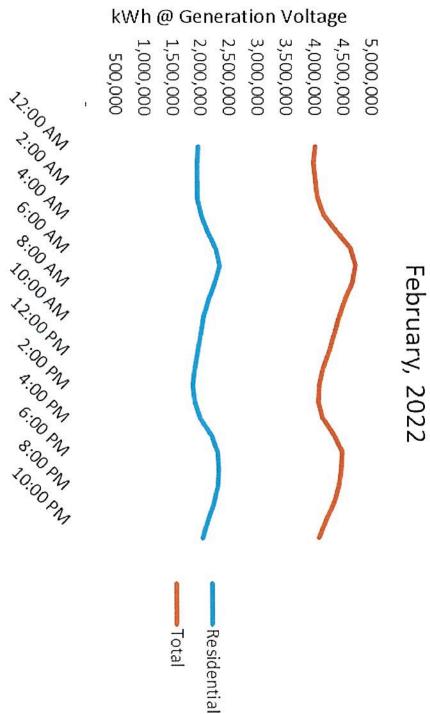

		~	