


**DIVISION OF HEALTH**  
**OF THE DEPARTMENT OF PUBLIC HEALTH AND WELFARE**  
**STATE OF MISSOURI**

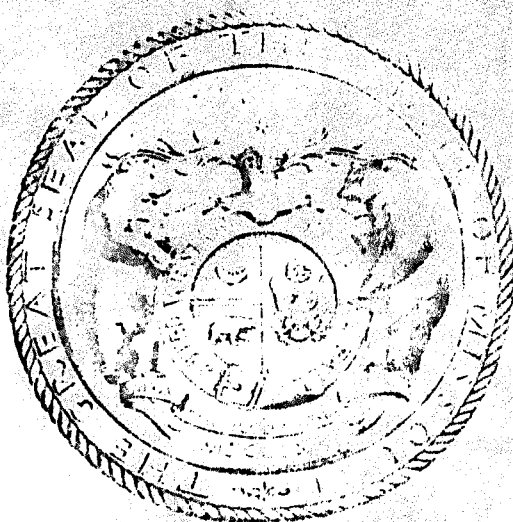

**PERMIT OF APPROVAL**

**FOR SUPPLYING WATER TO THE PUBLIC**

**PERMIT NO. 6163**

**GRANTED TO**

**TURKEY MOUNTAIN ESTATES SUBDIVISION NO. 2, STONE COUNTY, MISSOURI**

(Name of Municipality, Corporation, Company, Person or Institution)

**ISSUED IN ACCORDANCE WITH SECTION 192.200**  
**MISSOURI REVISED STATUTES AND RULES AND REGULATIONS**  
**PROMULGATED UNDER SECTION 192.180.**

*Applicant* Exhibit No. JA-78-120, WF-78-170  
Date 8-28-78 Case No. WE-78-120  
Reporter JJ By Barbara R. Wanda  
Director of Division of Health

Date January 15, 1973

**THE DIVISION OF HEALTH  
OF MISSOURI**

**REPORT OF FINAL INSPECTION AND APPROVAL OF PUBLIC WATER SUPPLY  
TURKEY MOUNTAIN ESTATES NO. 2  
STONE COUNTY, SHELL KNOB, MISSOURI  
December 14, 1972**

**INTRODUCTION**

A final inspection was made of the completed water supply facilities serving Turkey Mountain Estates No. 2 by a representative of the Division of Health on December 5, 1972. The following is a brief description and final approval of these facilities.

**DESCRIPTION**

The completed water supply consists of a drilled well, pumping equipment, storage and distribution facilities.

The well is drilled to a total depth of 750 feet and cased to a depth of 326 feet with six inch steel casing. The casing is satisfactorily sealed its entire length with neat cement grout.

A submersible pump of 80 gallons per minute capacity is installed in the well. This installation is equipped with a master flow meter, water level depth gauge, breather pipe, and automatic electrical controls.

Pressure and storage is provided by a pressure tank of 10,000 gallons total capacity. This installation is provided with a compressor, sight glass and blow-off valve.

The distribution system is being installed essentially as per plans and specifications as development warrants.

**FINAL APPROVAL**

The completed sanitary works described above were examined as to features of construction which may affect the operation of such systems, including size, capacities of various units, and features which may affect the efficiency and ease of operation. The completed works, so far as could be determined, are constructed essentially in accordance with the approved plans, and final approval of the completed works is hereby granted.

In the final inspection of the works, the Division of Health does not examine into structural features, or the efficiency of mechanical equipment. This final approval does not include approval of these features.

The Division of Health reserves the right to withdraw the approval of the sanitary works at anytime it is found to be operating unsatisfactorily, and to require alterations, additional treatment or changed methods of operation as deemed necessary to place the works in satisfactory condition.

APPROVED:

Glen A. Harwell  
Glen A. Harwell, Supervisor of  
Public Health Sanitation

John R. Nixon  
John R. Nixon  
Sanitary Engineer II