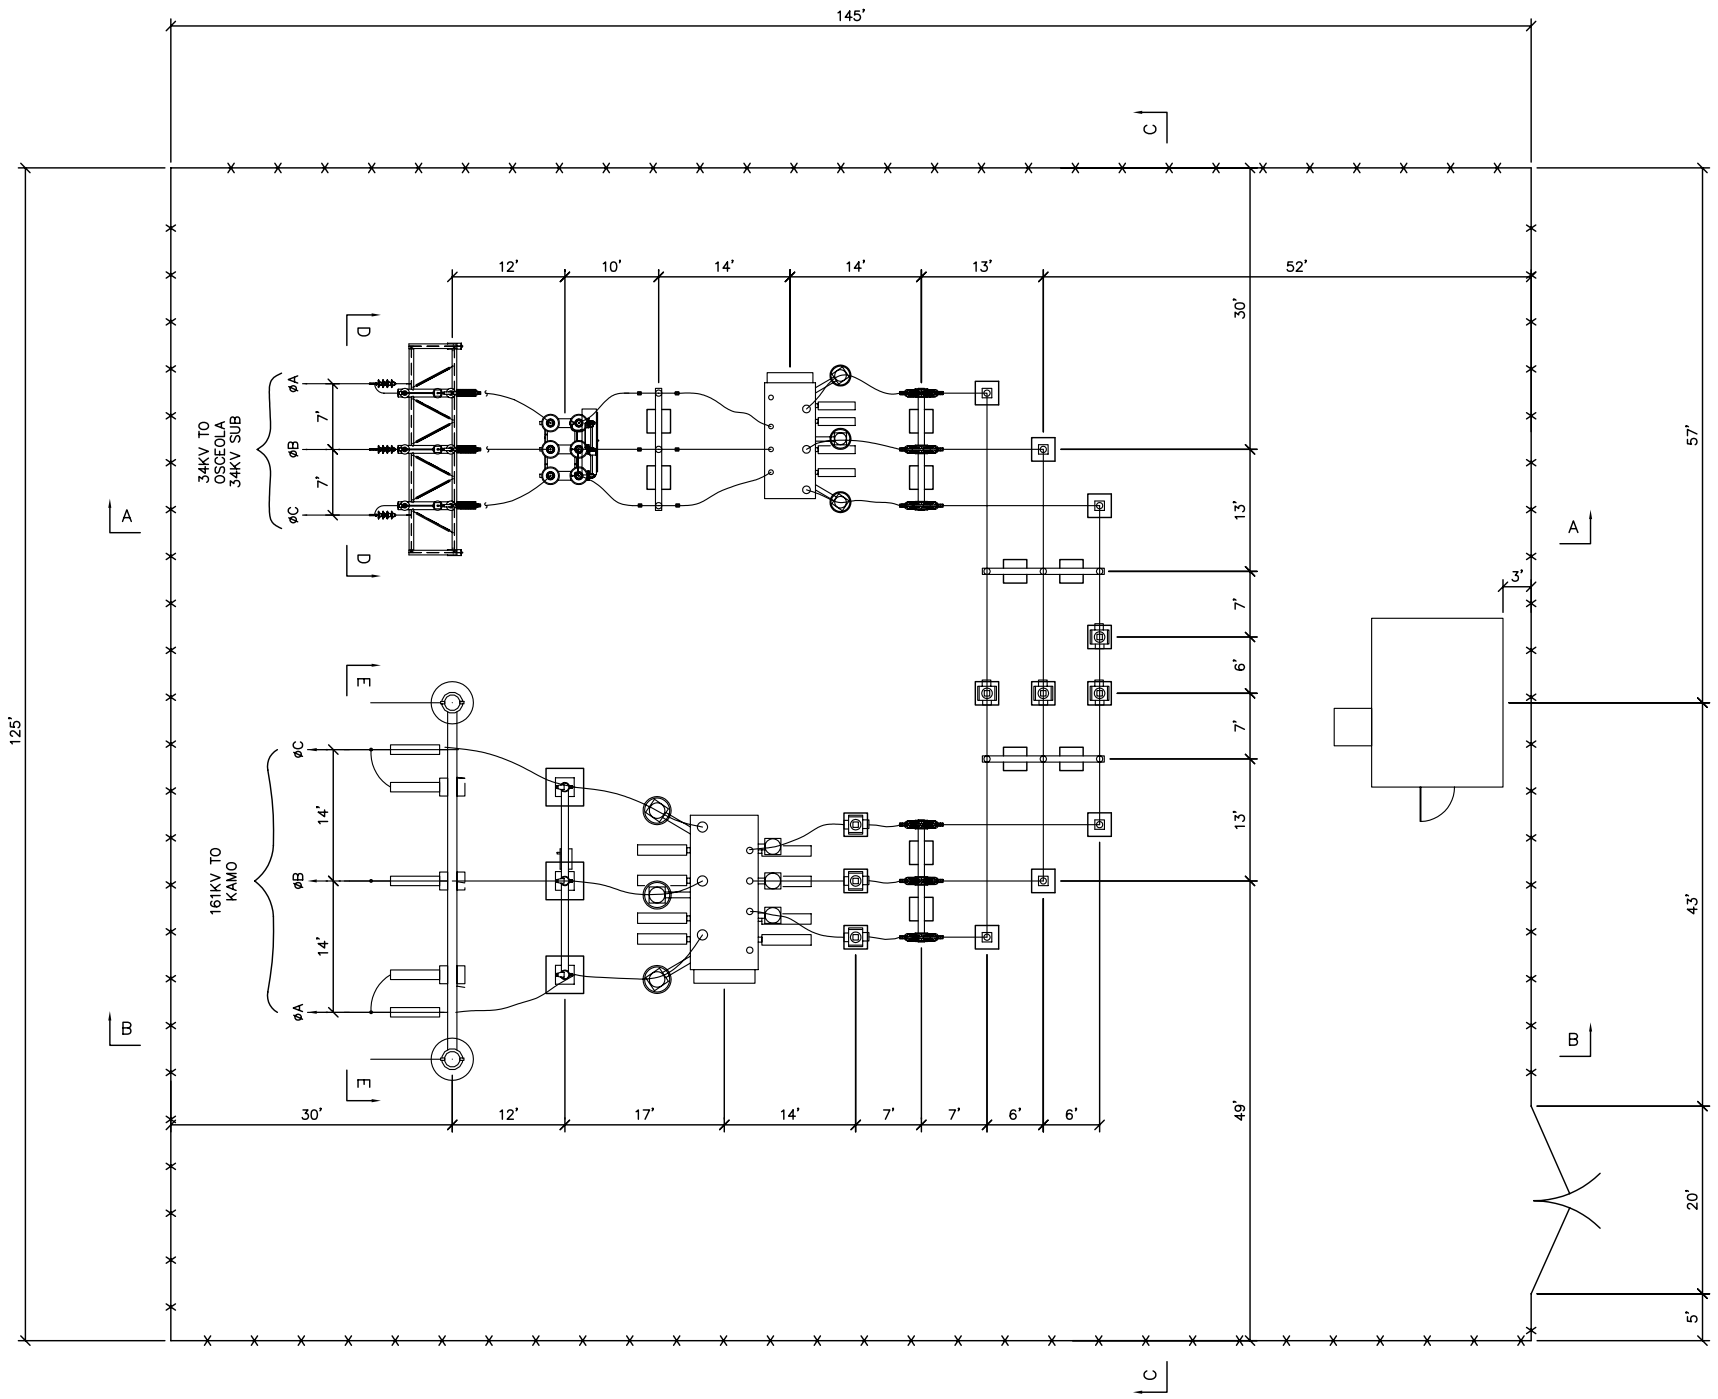

LEGEND:

- F FIXED (WELDED) BUS FITTING
- S SLIP (NON-WELDED) BUS FITTING
- △ SWITCH OPERATOR LOCATION
- ⬭ BILL OF MATERIAL ITEM NUMBER

REFERENCE DRAWINGS:

609-100 SITE LAYOUT
609-501 ELEVATIONS

NOTES:

1. INSTALL 795 MCM AAC OR ACSR CONDUCTOR INSIDE ALL 3" IPS BUS RUNS LONGER THAN 15 FEET FOR VIBRATION DAMPING.



REV. NO.	BY	CHK	DATE	DESCRIPTION

REVISIONS

MISSOURI PUBLIC SERVICE
KANSAS CITY, MISSOURI 64138

OSCEOLA 161/34KV SUBSTATION
PLAN VIEW

DWG. NO.	609-500
DRAWN	MJP
DATE	7/11/05
CHK. BY	
W.O. NO.	
SCALE	1"=10'
SHEET	1 OF 1
REVISION	0