



NO.	NODE	ELV. FT.	OUTPUT GPM	E.G.L. FT.	PR. HEAD PSI
1	RESERVOIR	849.0	200	849.0	1.7
2	RESERVOIR	849.0		849.0	5.8
3	RESERVOIR	848.0		848.0	21.8
4	RESERVOIR	849.0		849.0	13.3
5	RESERVOIR	869.0		869.0	5.8
6	RESERVOIR	862.0		862.0	21.8
7	RESERVOIR	864.0		864.0	13.3
8	RESERVOIR	854.0		854.0	5.8
9	RESERVOIR	854.0		854.0	21.8
10	RESERVOIR	848.0		848.0	13.3
11	RESERVOIR	850.0		850.0	5.8
12	RESERVOIR	860.0		860.0	21.8
13	RESERVOIR	870.0		870.0	13.3
14	RESERVOIR	835.0		835.0	5.8
15	RESERVOIR	835.0		835.0	21.8
16	RESERVOIR	822.0		822.0	13.3
17	RESERVOIR	822.0		822.0	5.8
18	RESERVOIR	822.0		822.0	21.8
19	RESERVOIR	827.0		827.0	13.3
20	RESERVOIR	843.0		843.0	5.8
21	RESERVOIR	843.0		843.0	21.8
22	RESERVOIR	847.0		847.0	13.3
23	RESERVOIR	845.0		845.0	5.8
24	RESERVOIR	845.0		845.0	21.8
25	RESERVOIR	843.0		843.0	13.3
26	RESERVOIR	845.0		845.0	5.8
27	RESERVOIR	843.0		843.0	21.8
28	RESERVOIR	843.0		843.0	13.3
29	RESERVOIR	843.0		843.0	5.8
30	RESERVOIR	843.0		843.0	21.8
31	RESERVOIR	830.0		830.0	13.3
32	RESERVOIR	830.0		830.0	5.8
33	RESERVOIR	811.0		811.0	21.8
34	RESERVOIR	845.0		845.0	13.3
35	RESERVOIR	843.0		843.0	5.8
36	RESERVOIR	843.0		843.0	21.8

NO.	PIPE	FROM TO	DIAM.	LENGTH	COEF. FLOW	VEL. FT./SEC	HEAD LOSS
1	PIPE	1	2	4.0	120.0	200	5.1
2	PIPE	2	2	4.0	120.0	158	8.3
3	PIPE	3	12	3	30.0	46	3.0
4	PIPE	4	12	2.5	66.0	120	13.8
5	PIPE	5	11	4	39.0	74	3.5
6	PIPE	6	13	2.5	58.0	120	2.9
7	PIPE	7	7	6	2.5	278.0	36
8	PIPE	8	7	6	2.5	278.0	36
9	PIPE	9	7	6	2.5	278.0	36
10	PIPE	10	14	5	2.5	730.0	38
11	PIPE	11	14	9	2.5	730.0	38
12	PIPE	12	8	4	2.5	800.0	38
13	PIPE	13	8	4	2.5	800.0	38
14	PIPE	14	9	14	2.5	730.0	38
15	PIPE	15	14	9	2.5	730.0	38
16	PIPE	16	7	7	2.5	120.0	36
17	PIPE	17	7	7	2.5	120.0	36
18	PIPE	18	7	7	2.5	120.0	36
19	PIPE	19	7	7	2.5	120.0	36
20	PIPE	20	20	2.0	150.0	120.0	0.0
21	PIPE	21	22	2.0	200.0	120.0	10.0
22	PIPE	22	22	2.0	150.0	120.0	0.0
23	PIPE	23	23	2.0	150.0	120.0	0.0
24	PIPE	24	24	2.0	150.0	120.0	0.0
25	PIPE	25	25	2.0	120.0	120.0	0.0
26	PIPE	26	26	2.0	250.0	120.0	10.5
27	PIPE	27	10	2	2.0	509.0	25.4
28	PIPE	28	2	2	2.0	120.0	36
29	PIPE	29	3.8	3.8	3.8	10.5	10.5
30	PIPE	30	2	2	2.0	120.0	36
31	PIPE	31	2	2	2.0	120.0	36
32	PIPE	32	2	2	2.0	120.0	36
33	PIPE	33	2	2	2.0	120.0	36
34	PIPE	34	2	2	2.0	120.0	36
35	PIPE	35	2	2	2.0	120.0	36
36	PIPE	36	2	2	2.0	120.0	36

PIPE NETWORK ANALYSIS AND OPTIMIZATION  
 JOB: FOUR STAR SUBDIVISION GRINDER PUMP - HYDROMATIC SPGA 4.5

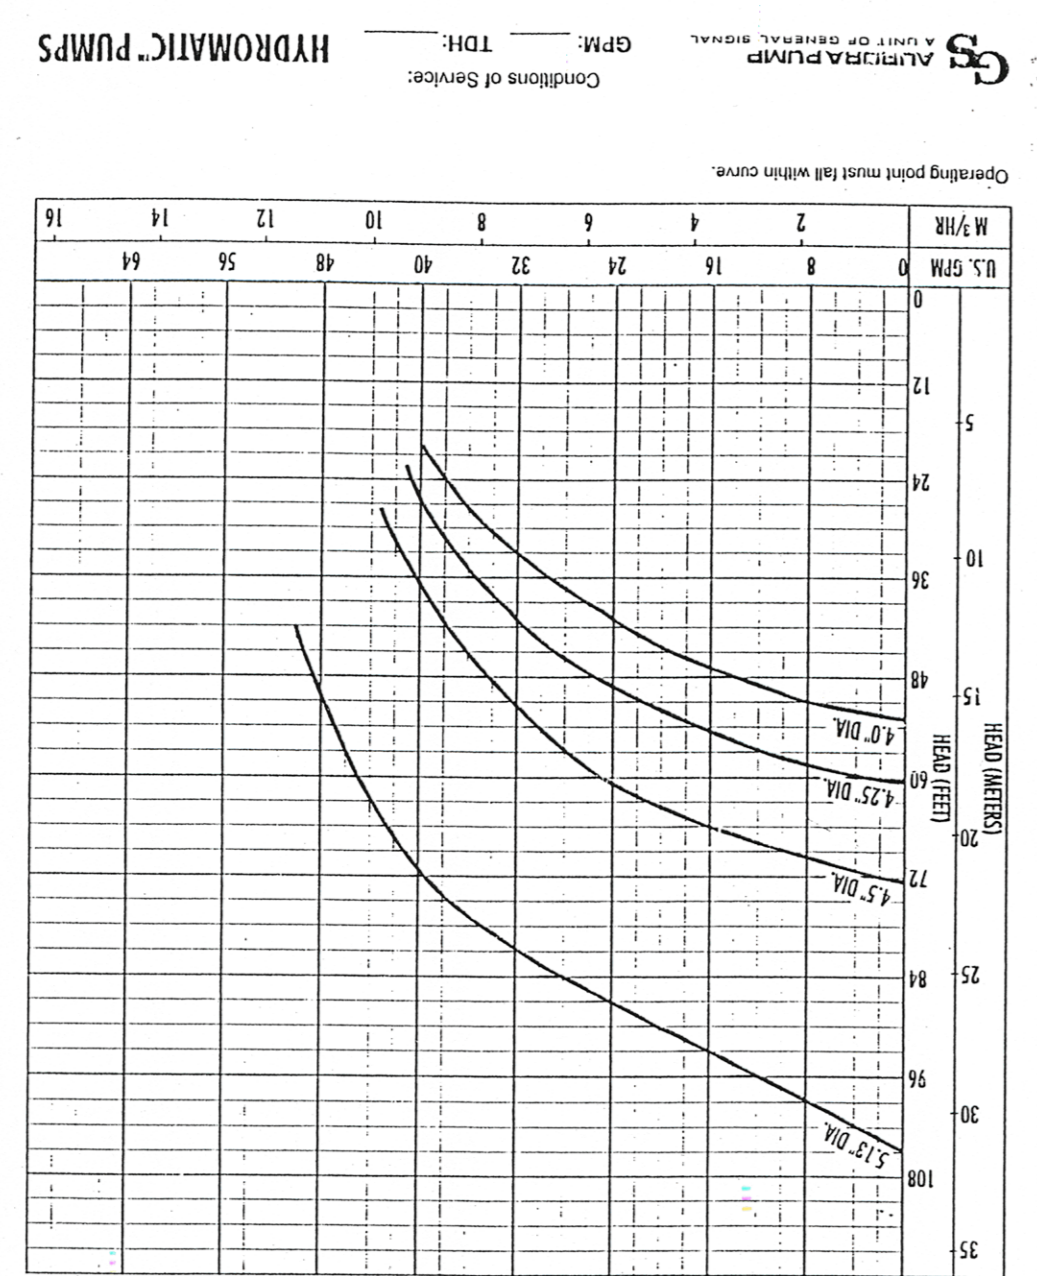

SPGA Performance Curve  
 Model: 3450 Discharge: 1-1/4"

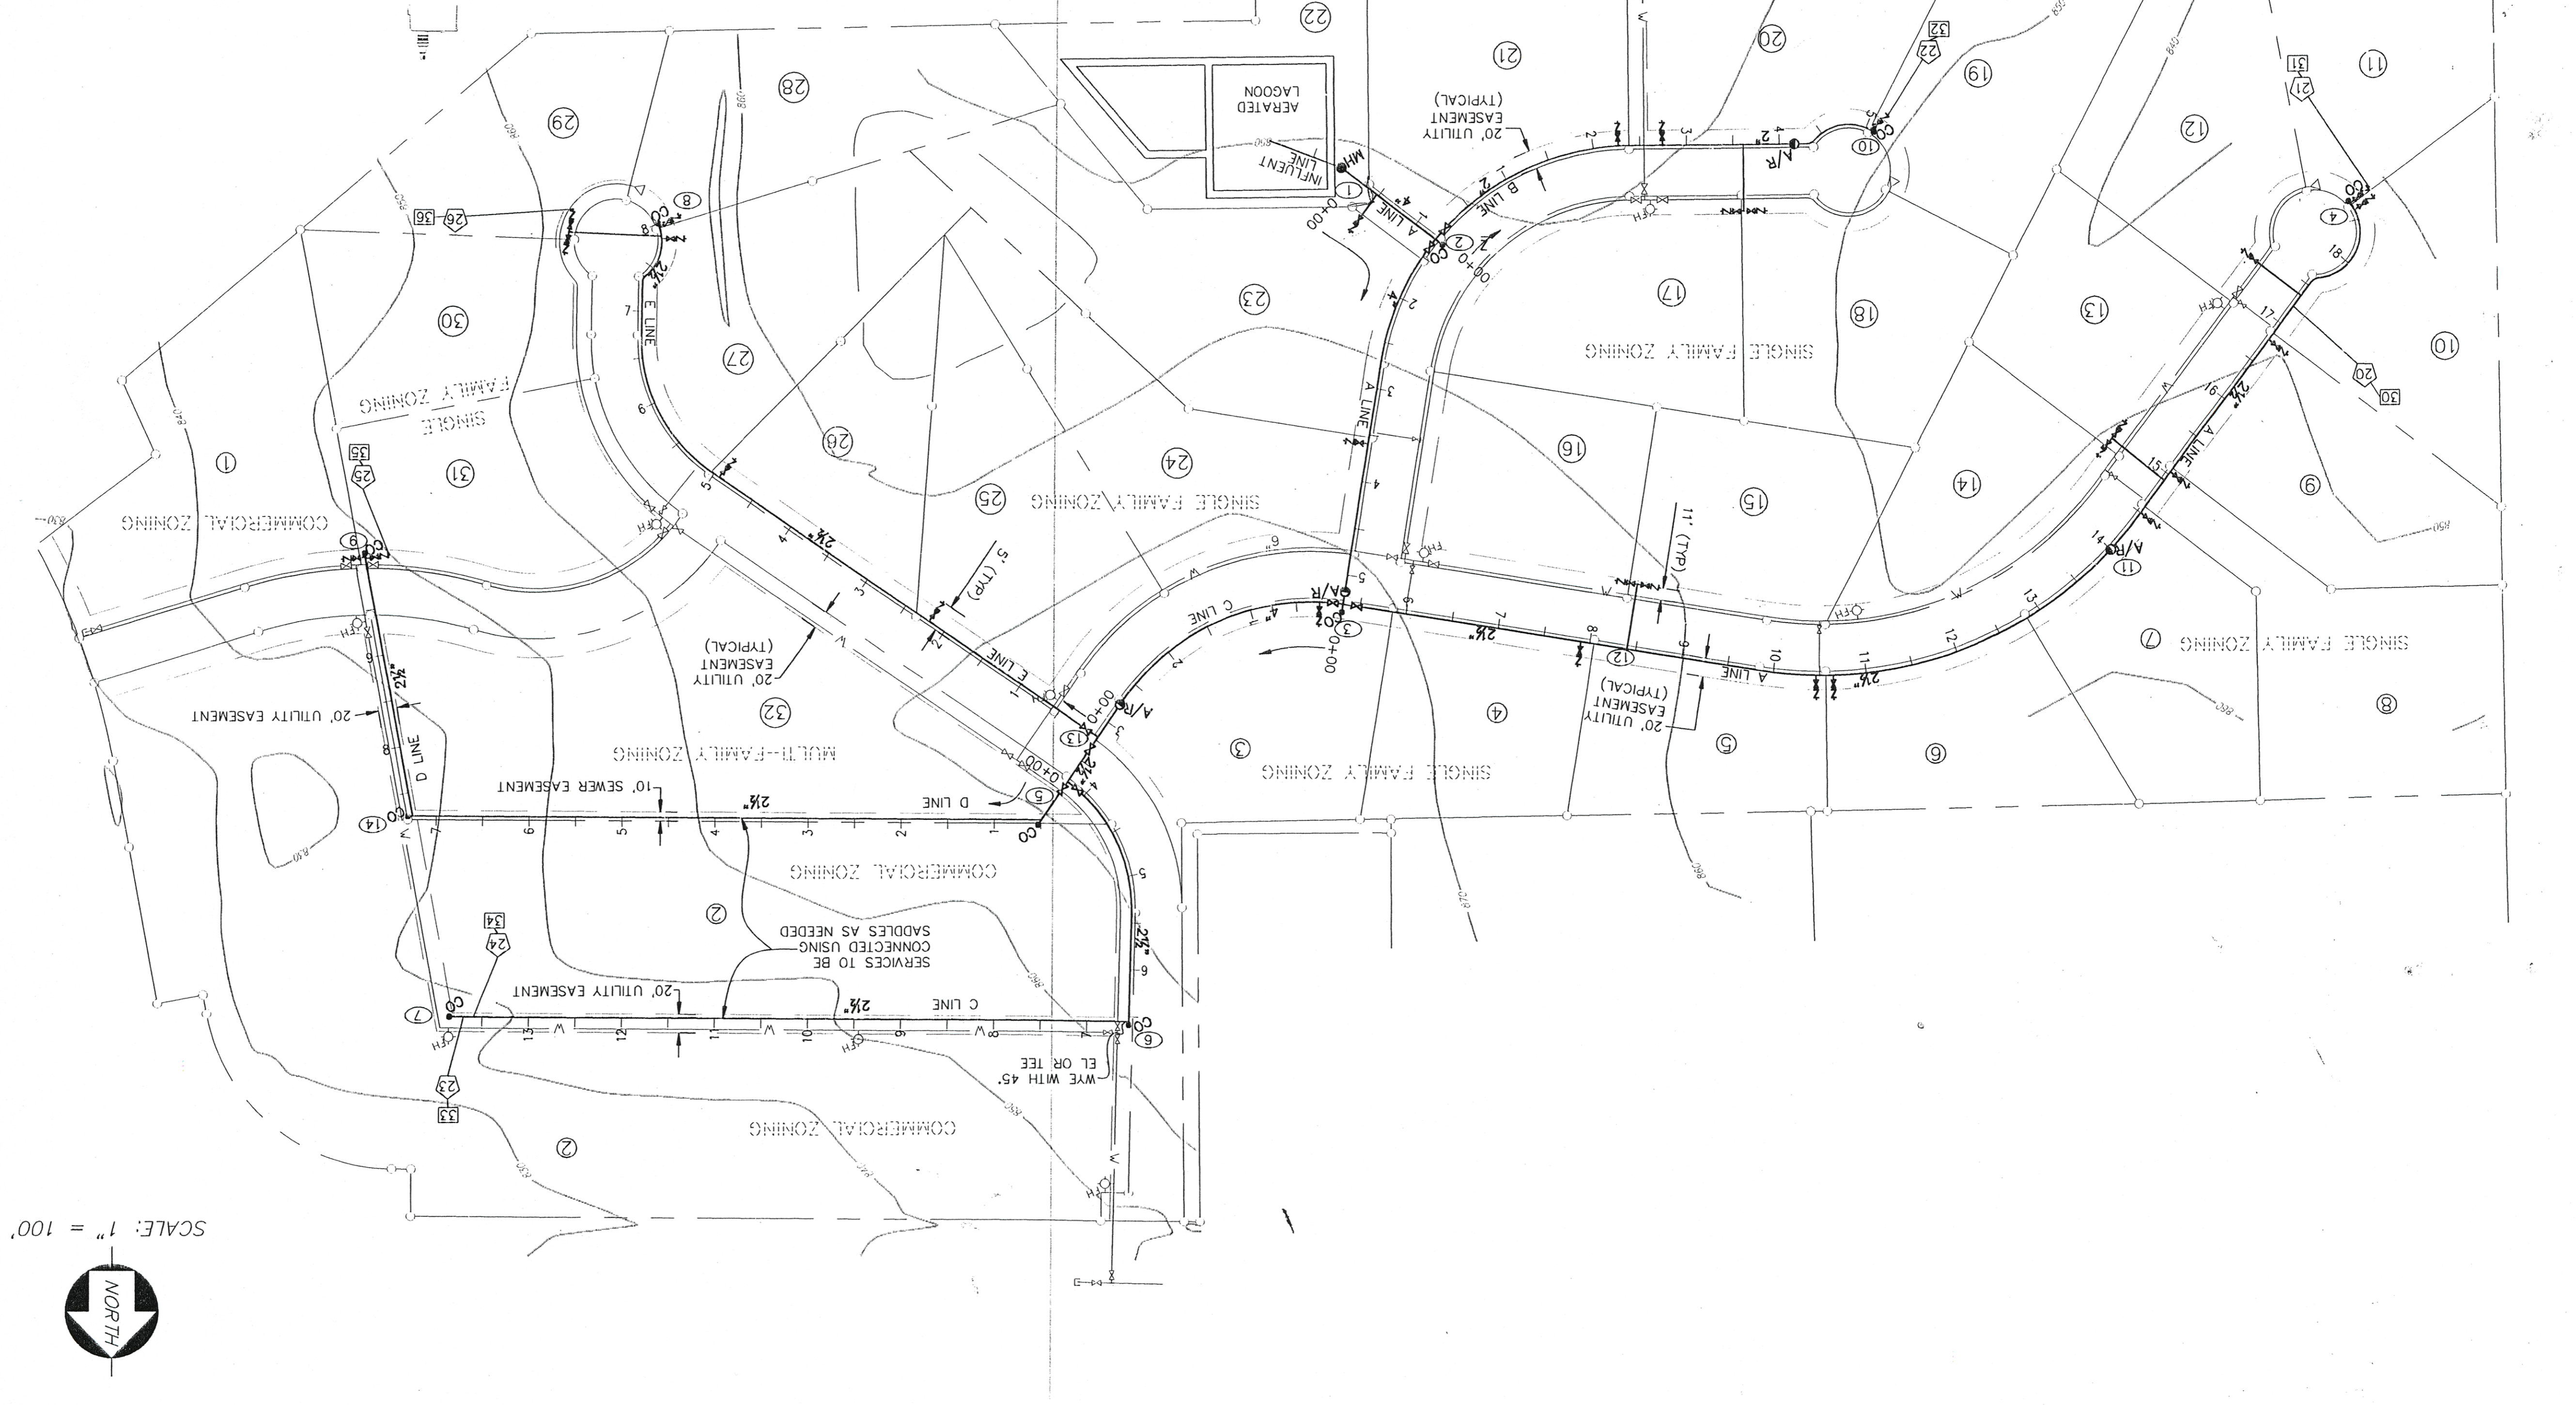

SCALE: 1" = 100'

DATE: 4/28/07  
 PROJECT: ED & SHIRLEY BRIGHT CALLAWAY COUNTY, MO  
 SHEET TITLE: FOUR STAR SUBDIVISION  
 ENGINEERING & SURVEYING  
 MISSOURI PROFESSIONAL ENGINEERS & SURVEYORS  
 MISSOURI 65203  
 300 ST. JAMES STREET  
 COLUMBIA, MISSOURI 65203



OWNERS: ED & SHIRLEY BRIGHT  
 1695 COUNTY ROAD 342  
 FULTON, MISSOURI 65251  
 (573) 642-5636

- QUANTITIES:
- 510 LF 2" PVC
  - 4210 LF 2 1/2" PVC
  - 860 LF 4" PVC
  - 1 EA 2" GATE VALVES
  - 4 EA 2 1/2" GATE VALVES
  - 2 EA 4" GATE VALVES
  - 4 EA AIR RELEASE VALVES
  - 10 EA CLEANOUTS
  - 1 EA STANDARD MANHOLE
  - 2 EA 4" CROSS
  - 1 EA 4"x2" REDUCER
  - 1 EA 4"x2 1/2" REDUCER
  - 2 EA 2 1/2"x2 1/2" TEES
  - 2 EA 2 1/2"x2 1/2" TEES
  - 2 EA 2 1/2" WYES
  - 28 EA SERVICES
  - 120 LF CRUSHED ROCK BACKFILL

- LEGEND
- GATE VALVE
  - FIRE HYDRANT & VALVE
  - FLUSH HYDRANT & VALVE
  - CAP & THRUST BLOCK
  - WATER LINE
  - SANITARY SEWER LINE
  - SEWER CLEANOUT
  - SEWER MANHOLE
  - EASEMENT LINE
  - CONTOUR LINE
  - PROPERTY LINE
  - LOT NUMBER
  - HYDRAULIC ANALYSIS PUMP NODE
  - HYDRAULIC ANALYSIS TANK NODE
  - HYDRAULIC ANALYSIS LINE NODE
  - SEWER LINE SIZE DESIGNATION

- NOTES:
1. CONTRACTOR RESPONSIBLE TO LOCATE ALL UTILITIES IN PROJECT AREA BEFORE CONSTRUCTION.
  2. ALL CONSTRUCTION SHALL MEET THE REQUIREMENTS OF THE STATE OF MISSOURI CLEAN WATER REGULATIONS.
  3. ALL GATE VALVES, AIR RELEASE VALVES, AND CLEANOUTS MUST BE LOCATED BEHIND THE ROAD DITCHES. SERVICES SHALL BE EXTENDED 5' ONTO THE LOT IT SERVES OR AT LEAST 10' BEHIND THE WATERLINE.
  4. MINIMUM BURY UNDER DITCHES IS 24"
  5. WYE WITH 45° EL OR TEE AT 90° BENDS.
  6. WYE WITH 45° EL OR TEE AT 90° BENDS.

