



Aquila Networks – MPS System
Load Factor = 47%

Rebuttal Schedule JMT-2
Docket No. EO-2002-384

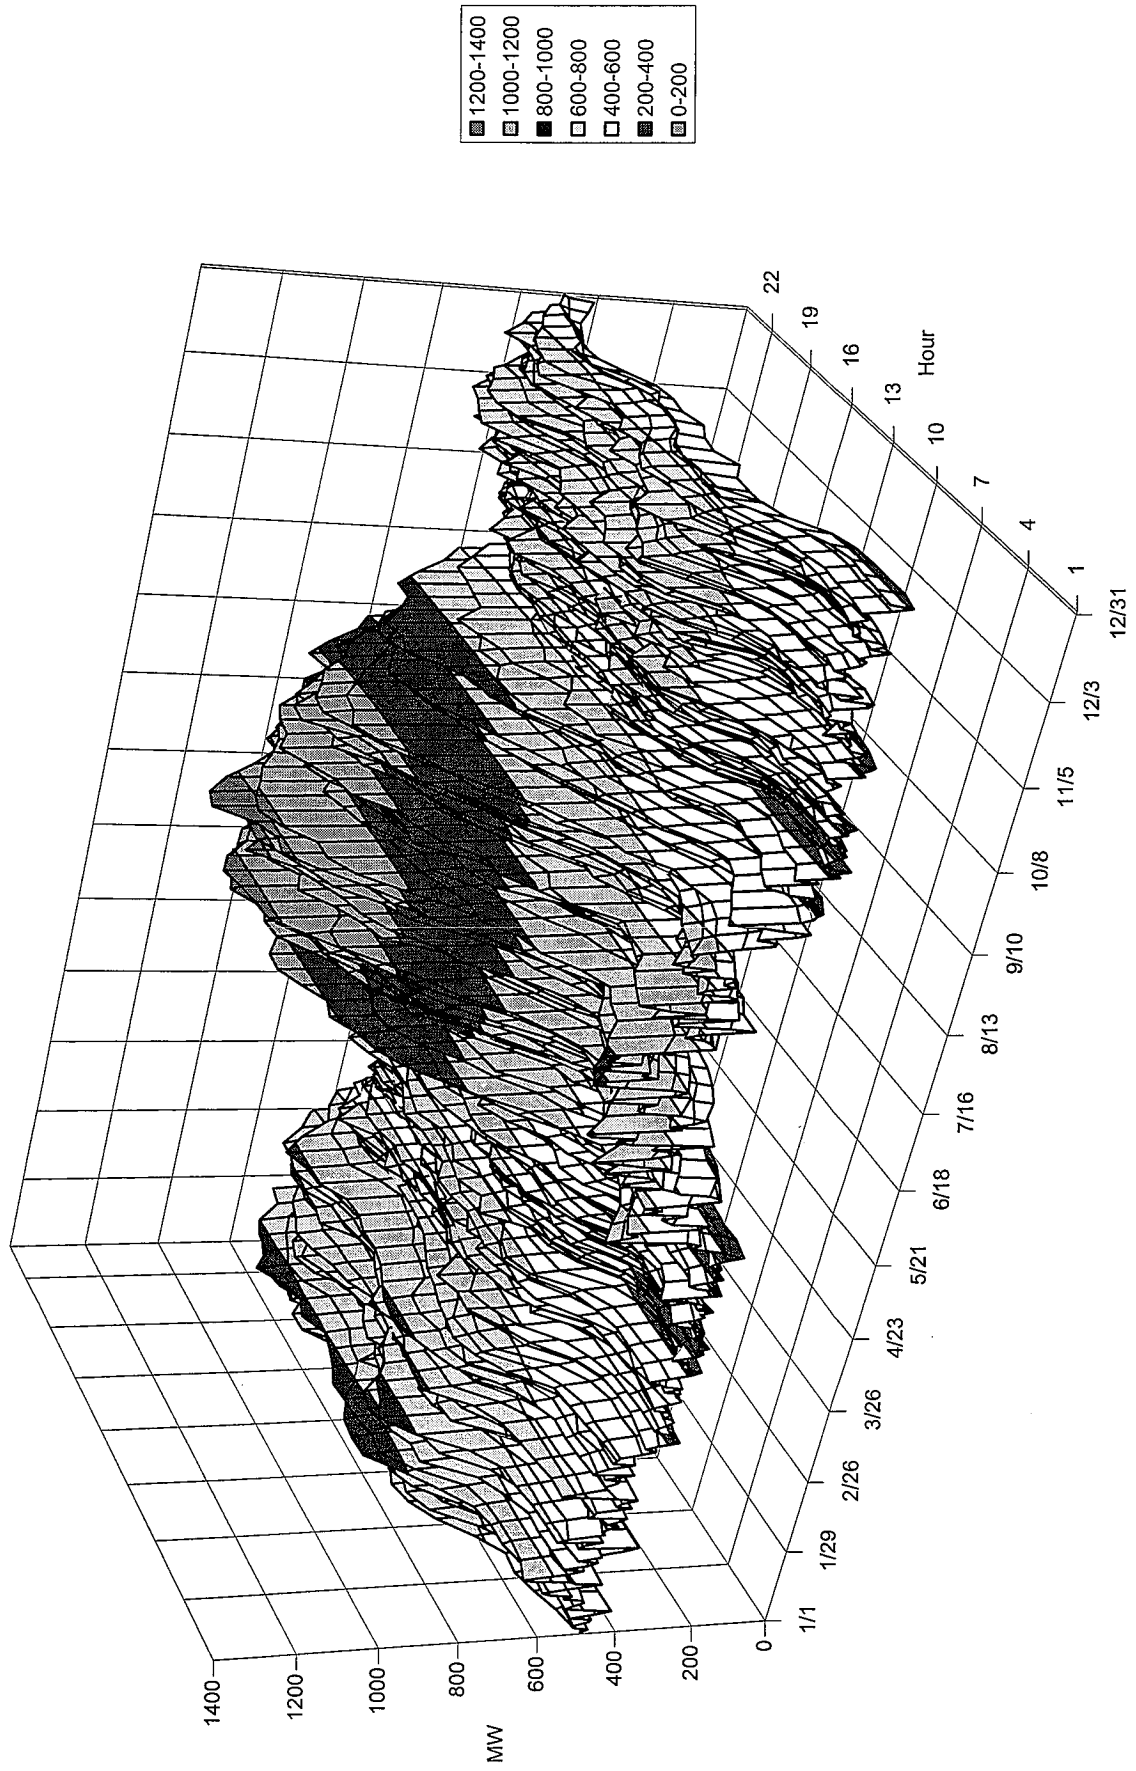


Aquila Networks – MPS Residential General Use
Load Factor = 32%

Rebuttal Schedule JMT-2
Docket No. EO-2002-384

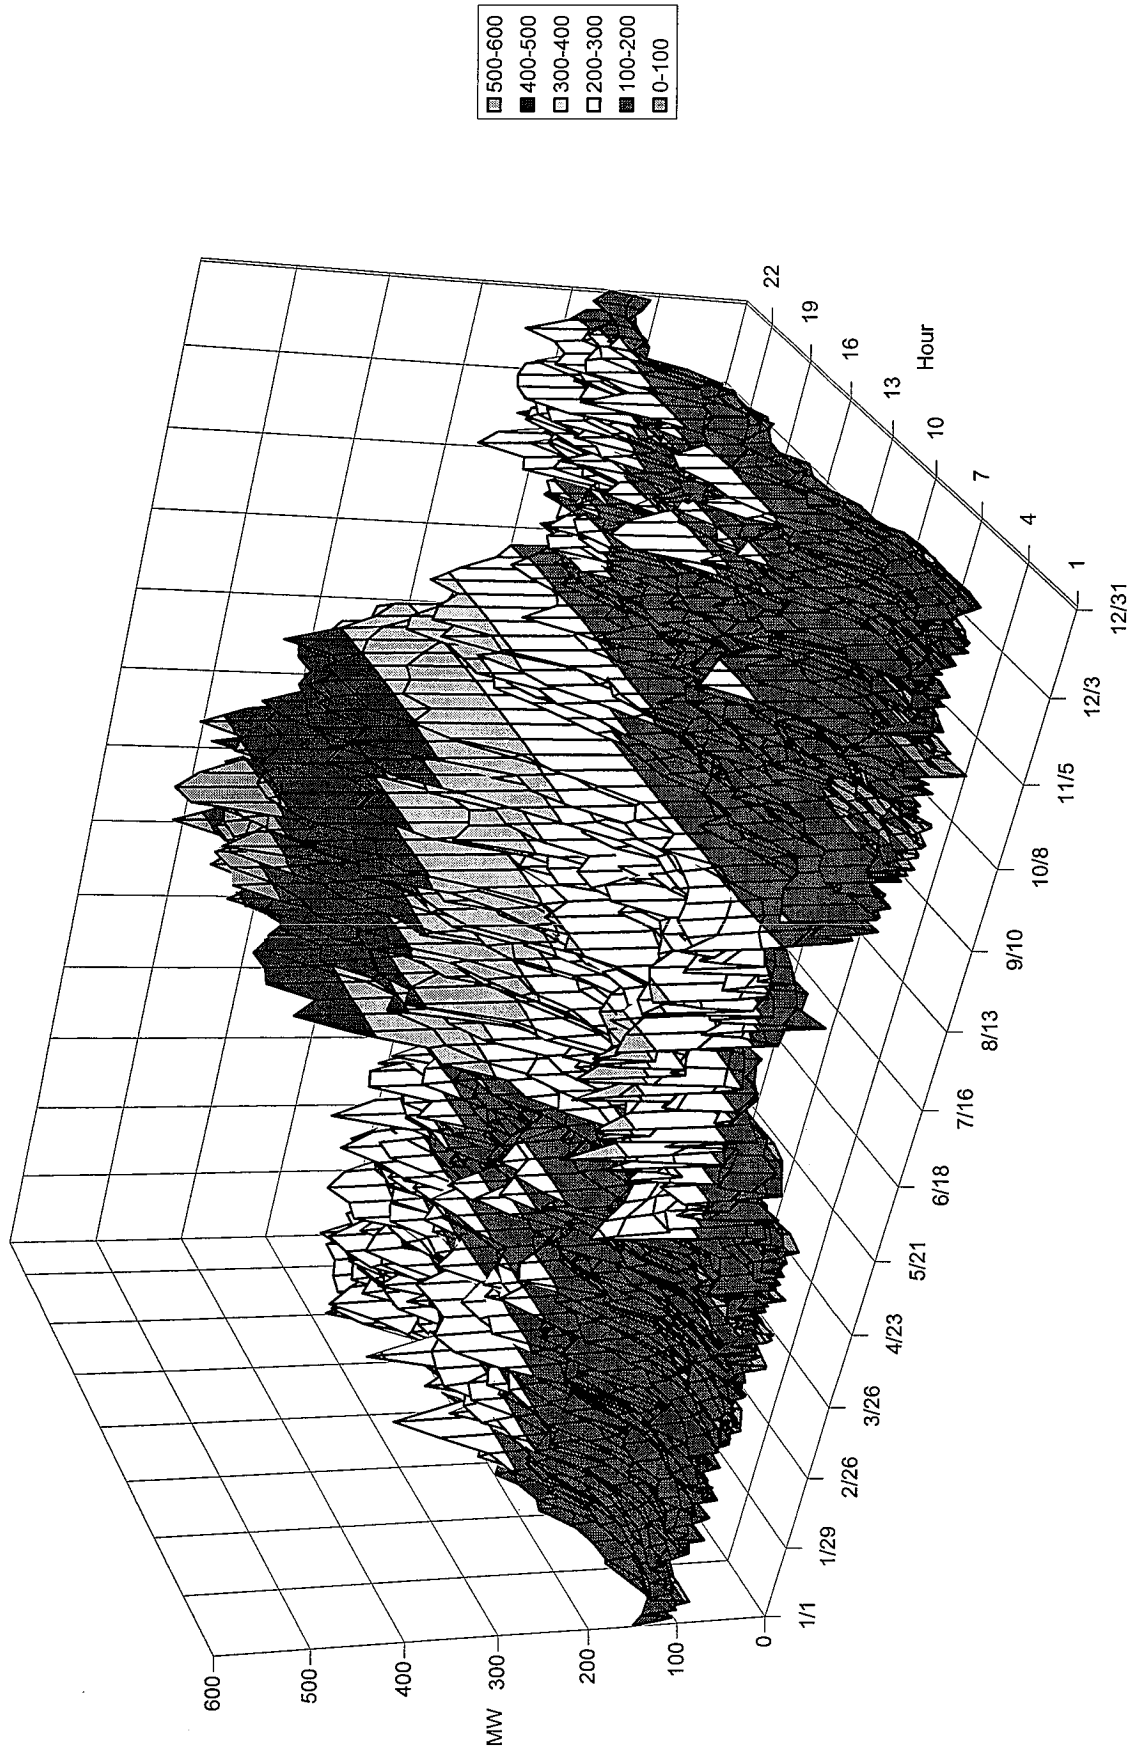


Aquila Networks – MPS Residential Space Heat
 Load Factor = 33% (LF on Summer Max. Demand = 52%)


Rebuttal Schedule JMT-2
 Docket No. EO-2002-384

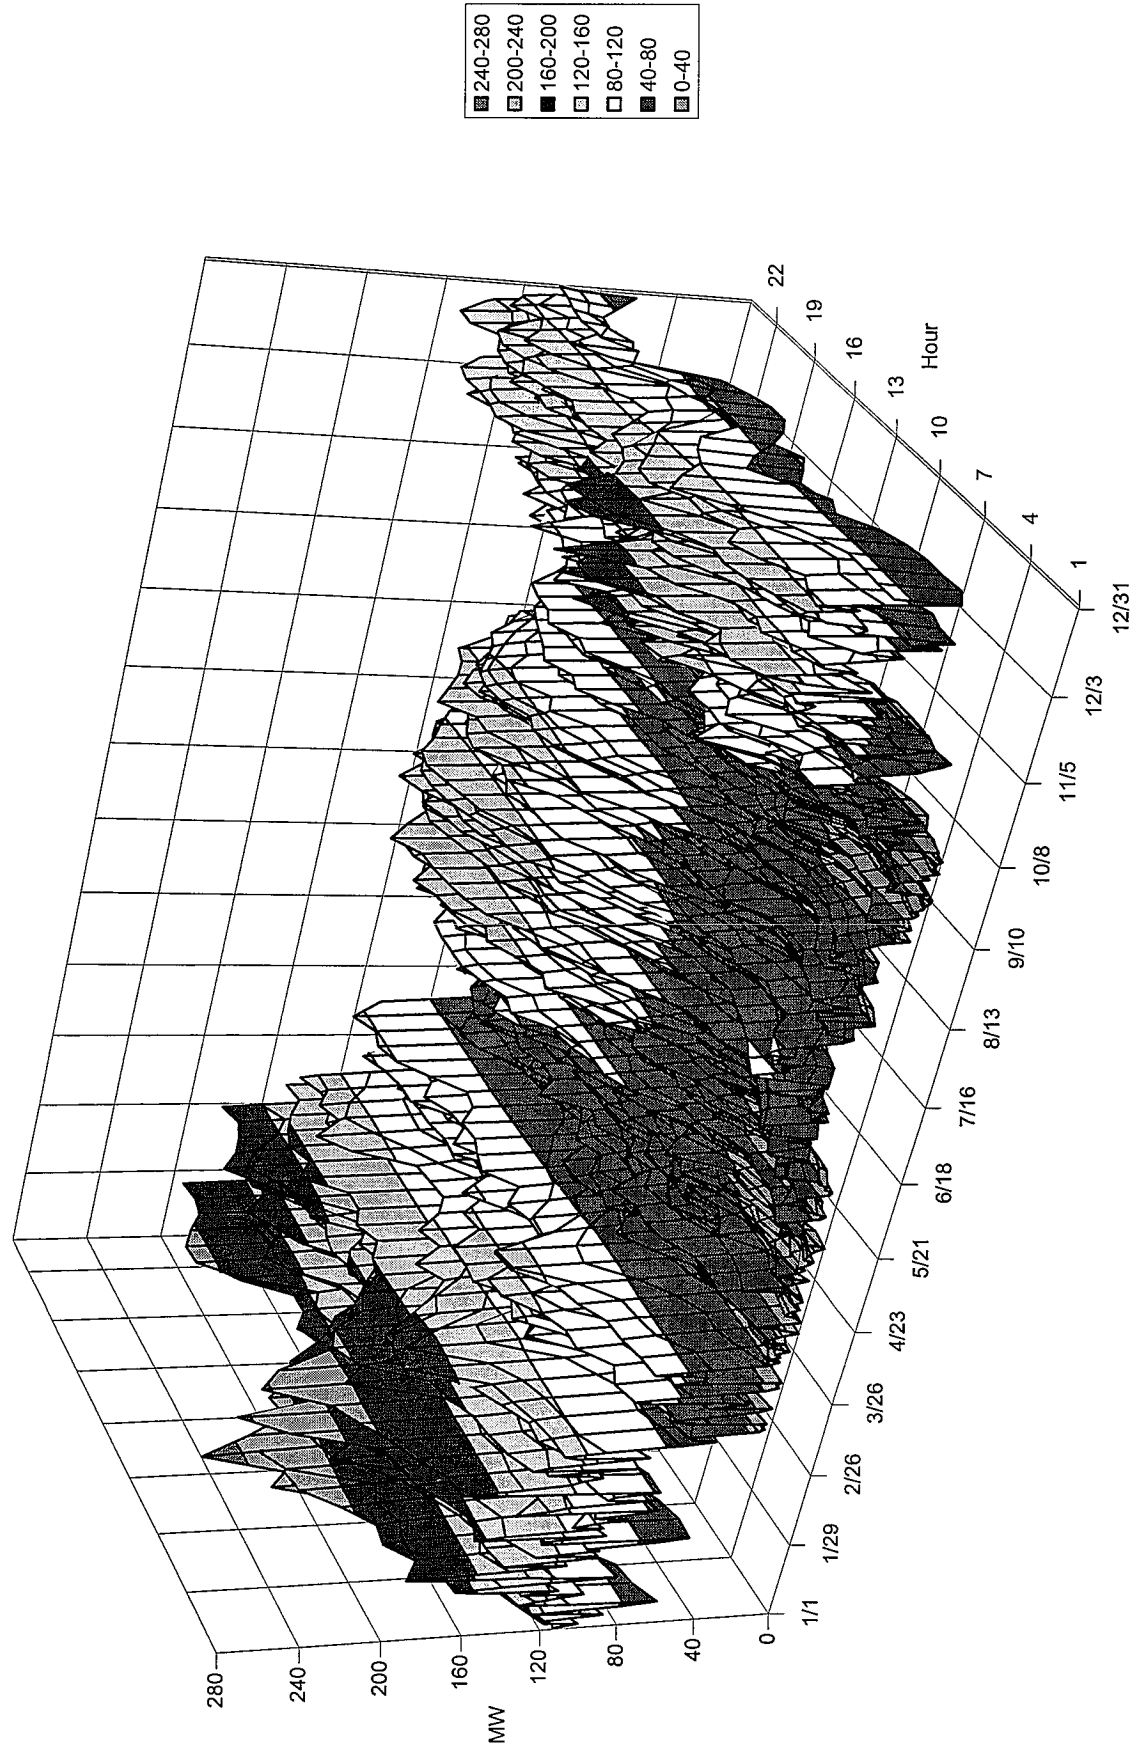

Aquila Networks – MPS Small General Service
Load Factor = 43%


Rebuttal Schedule JMT-2
Docket No. EO-2002-384

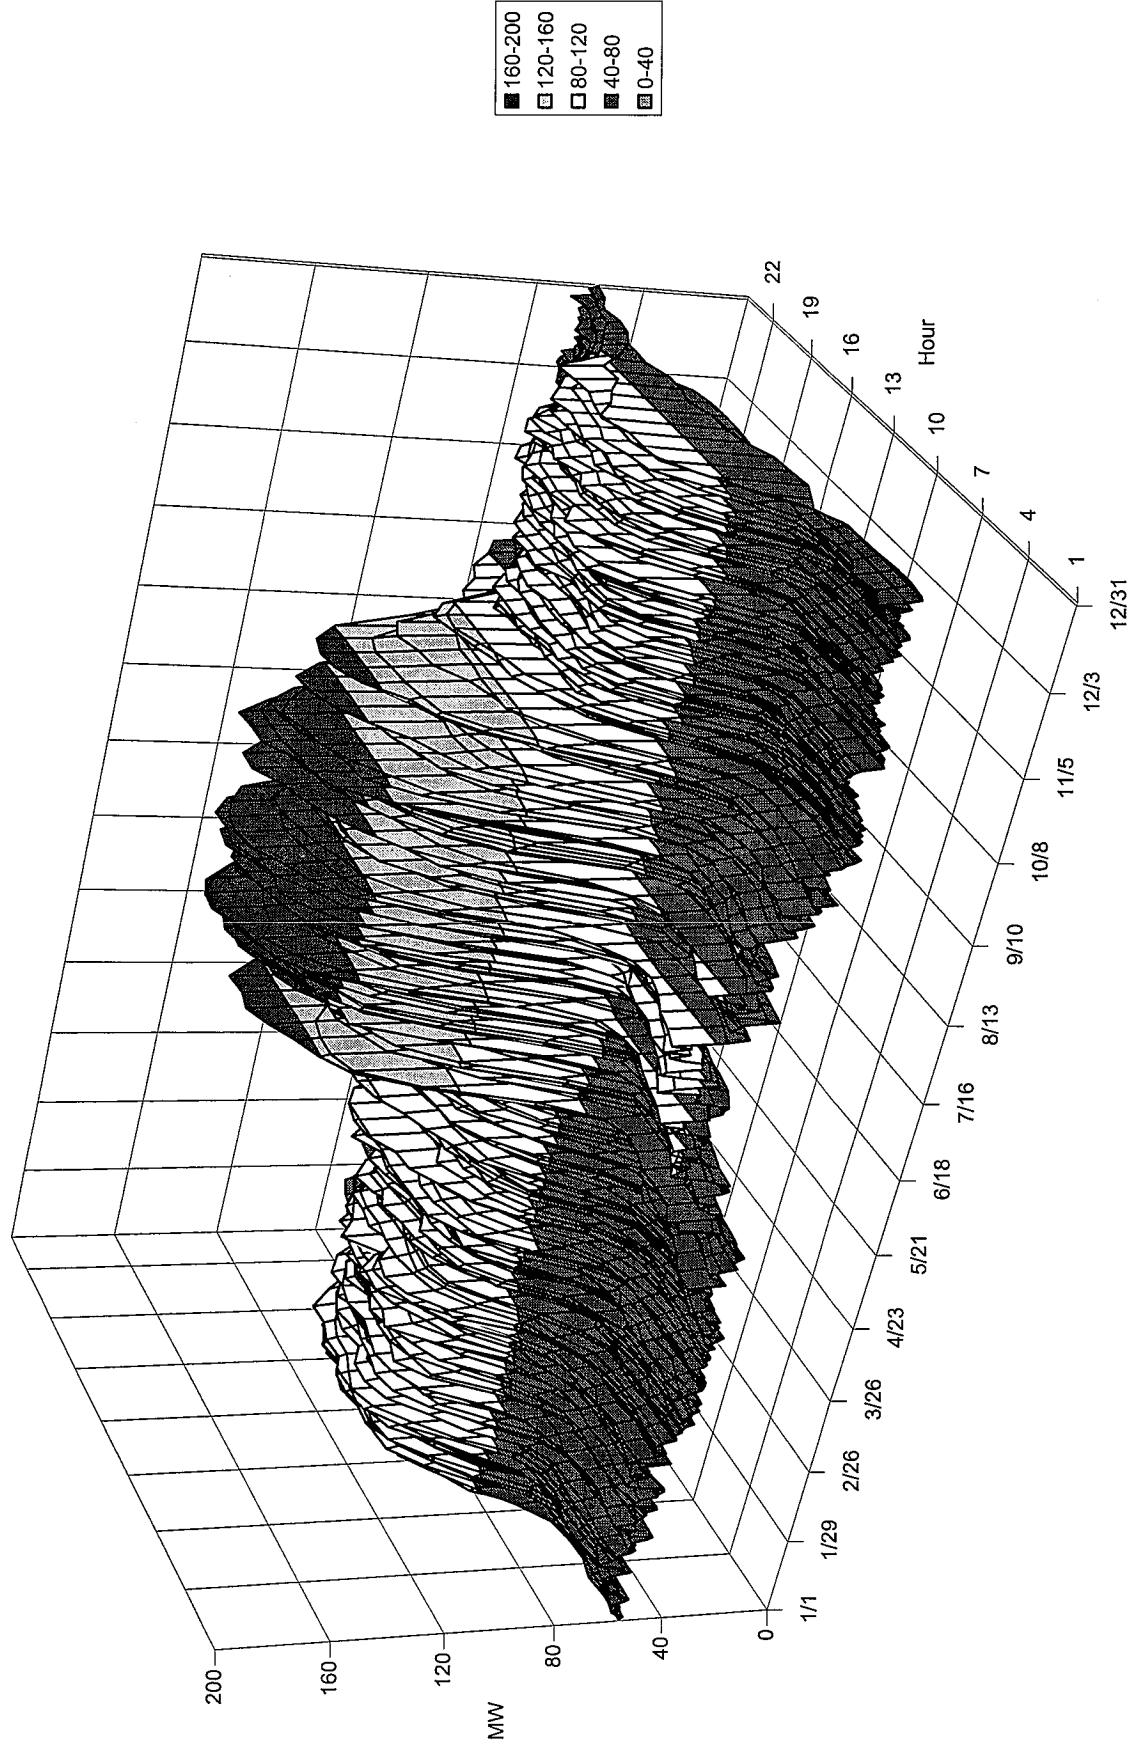

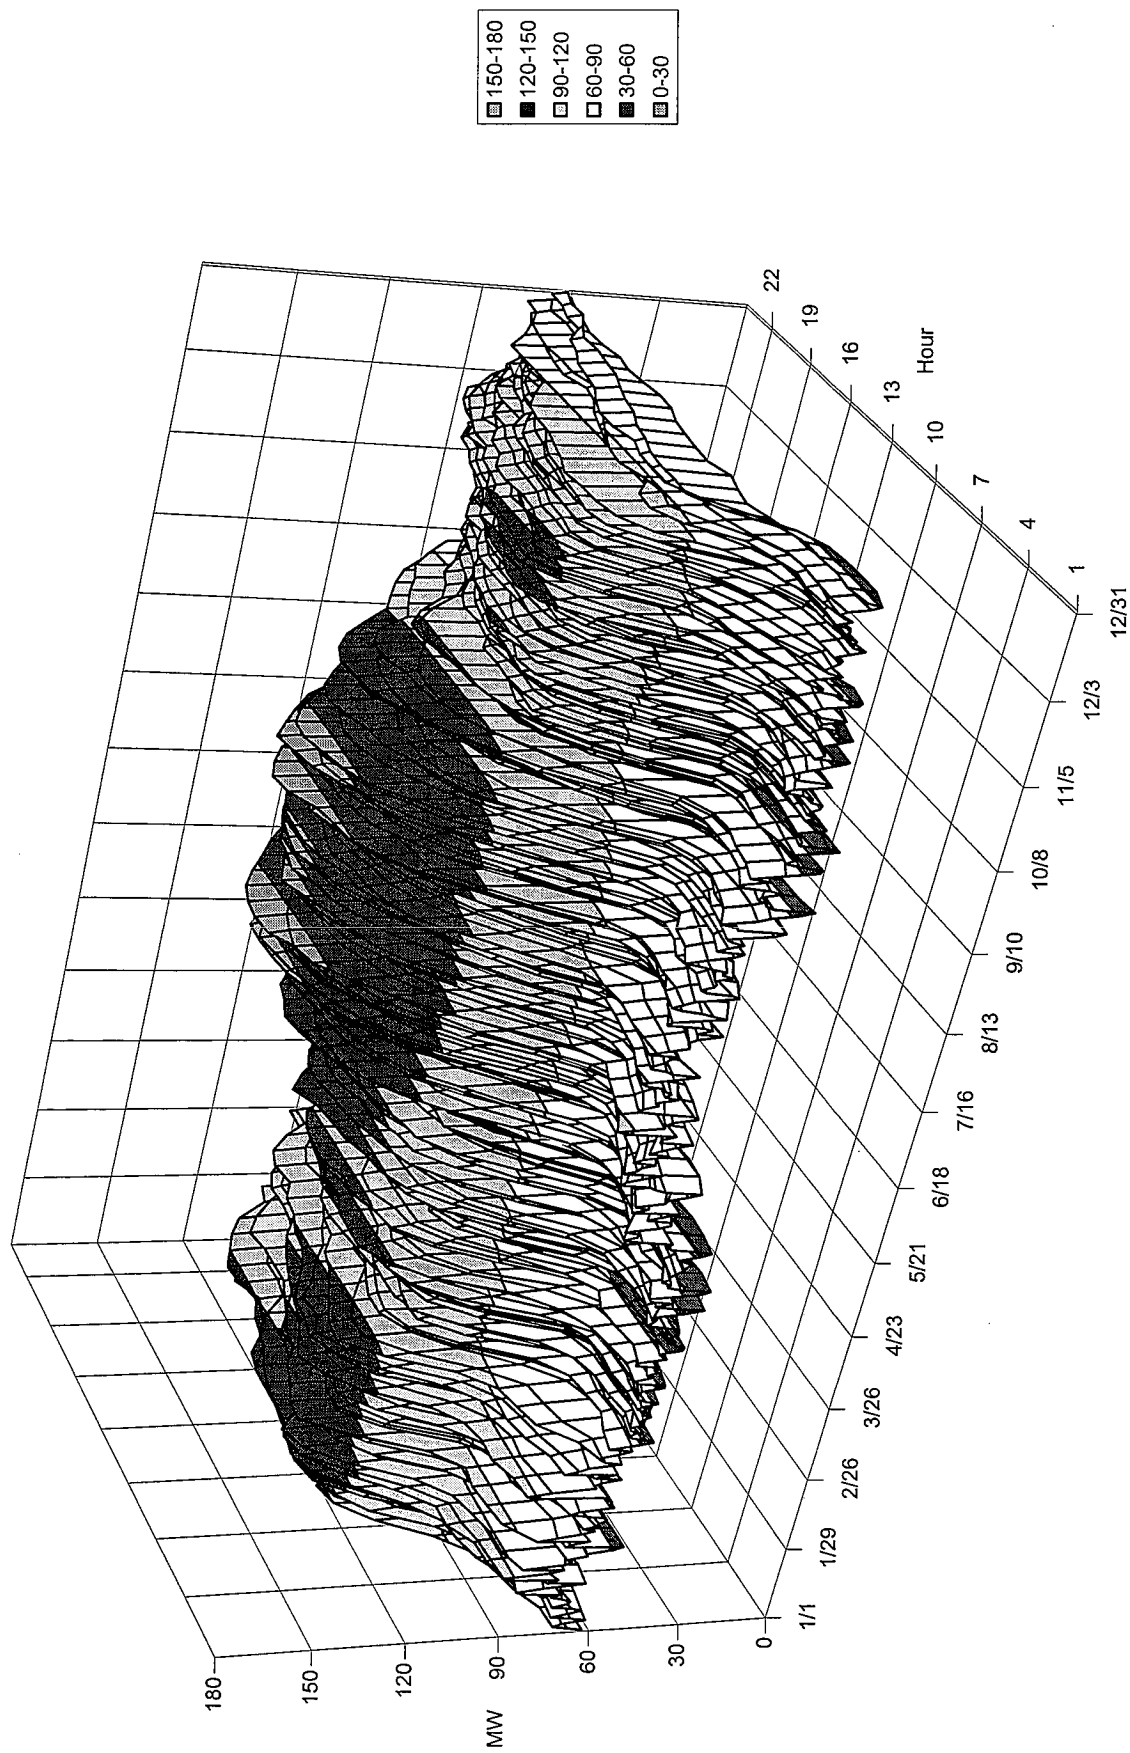

Aquila Networks – MPS Large Power Service
Load Factor = 69%

Rebuttal Schedule JMT-2
Docket No. EO-2002-384

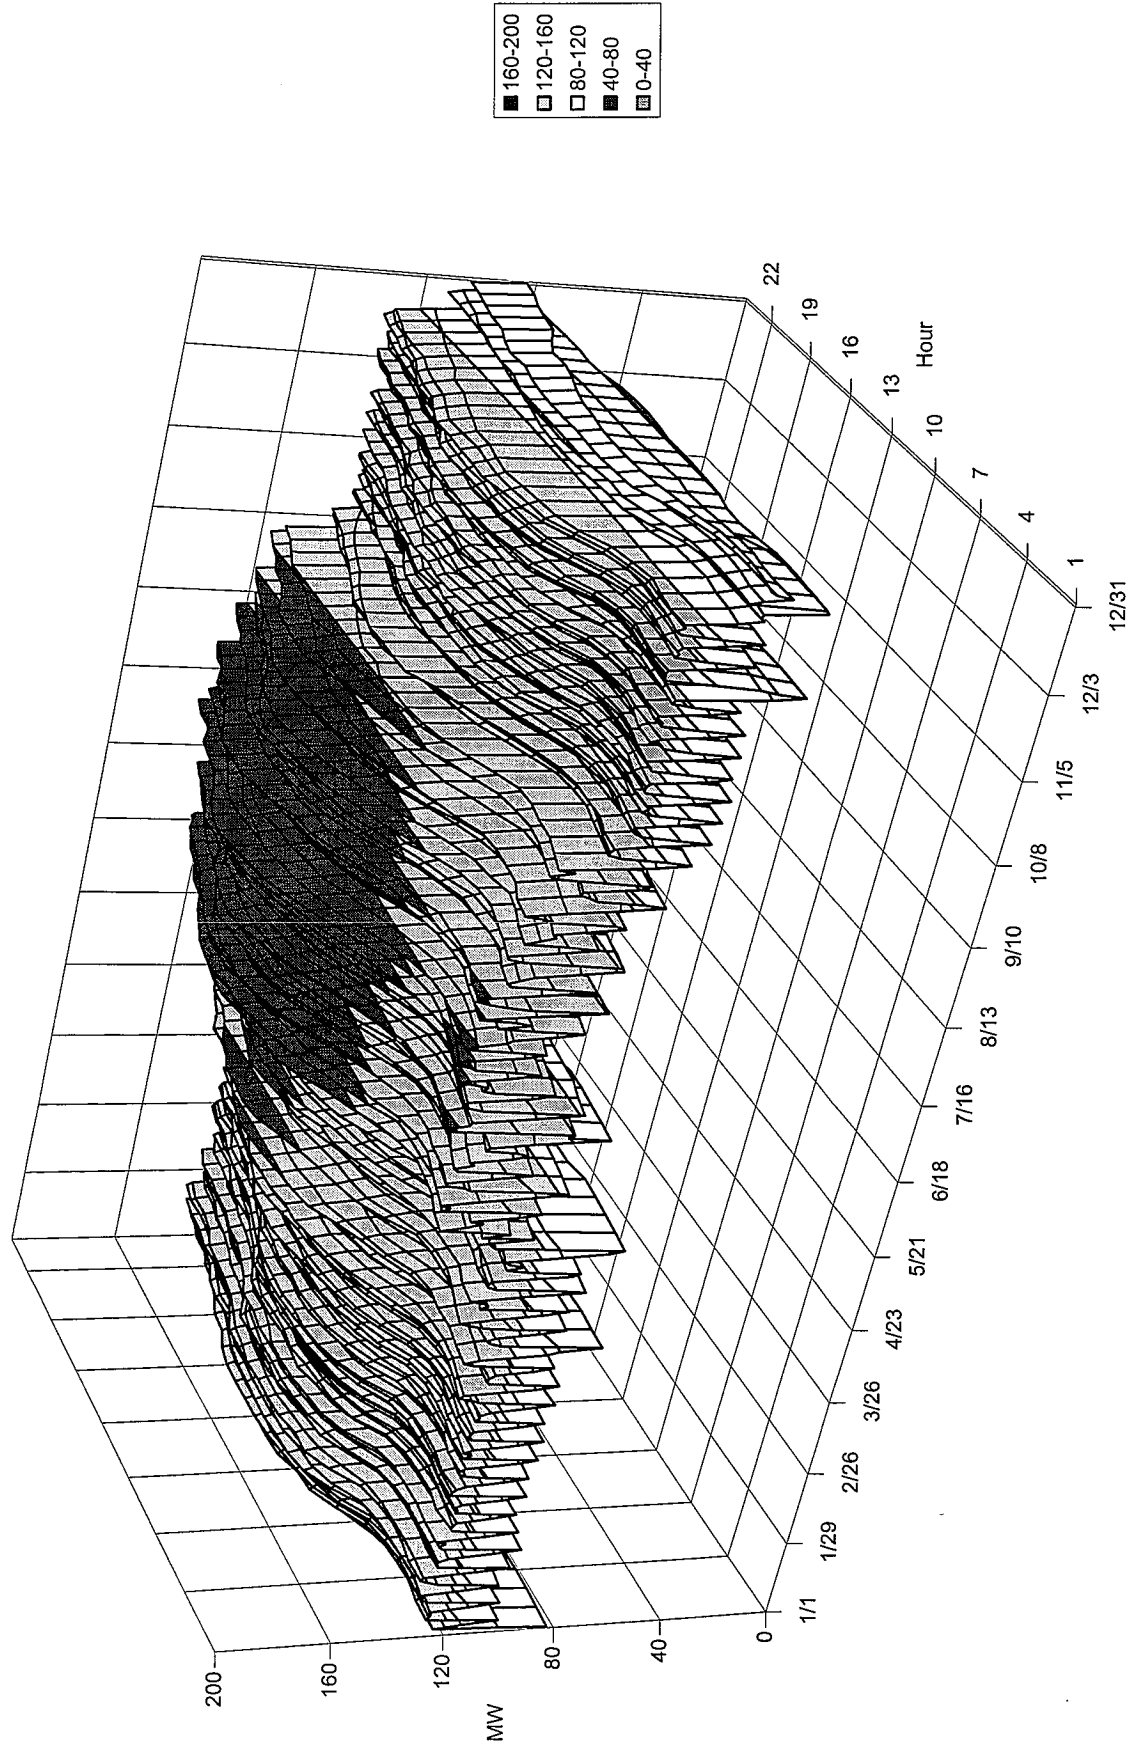

Aquila Networks – MPS System
Load Factor = 47%

Rebuttal Schedule JMT-2
Docket No. EO-2002-384

