



AQUILA GENERATION STACK AND LOAD - 2006

Supply Stack & Load Duration Curve

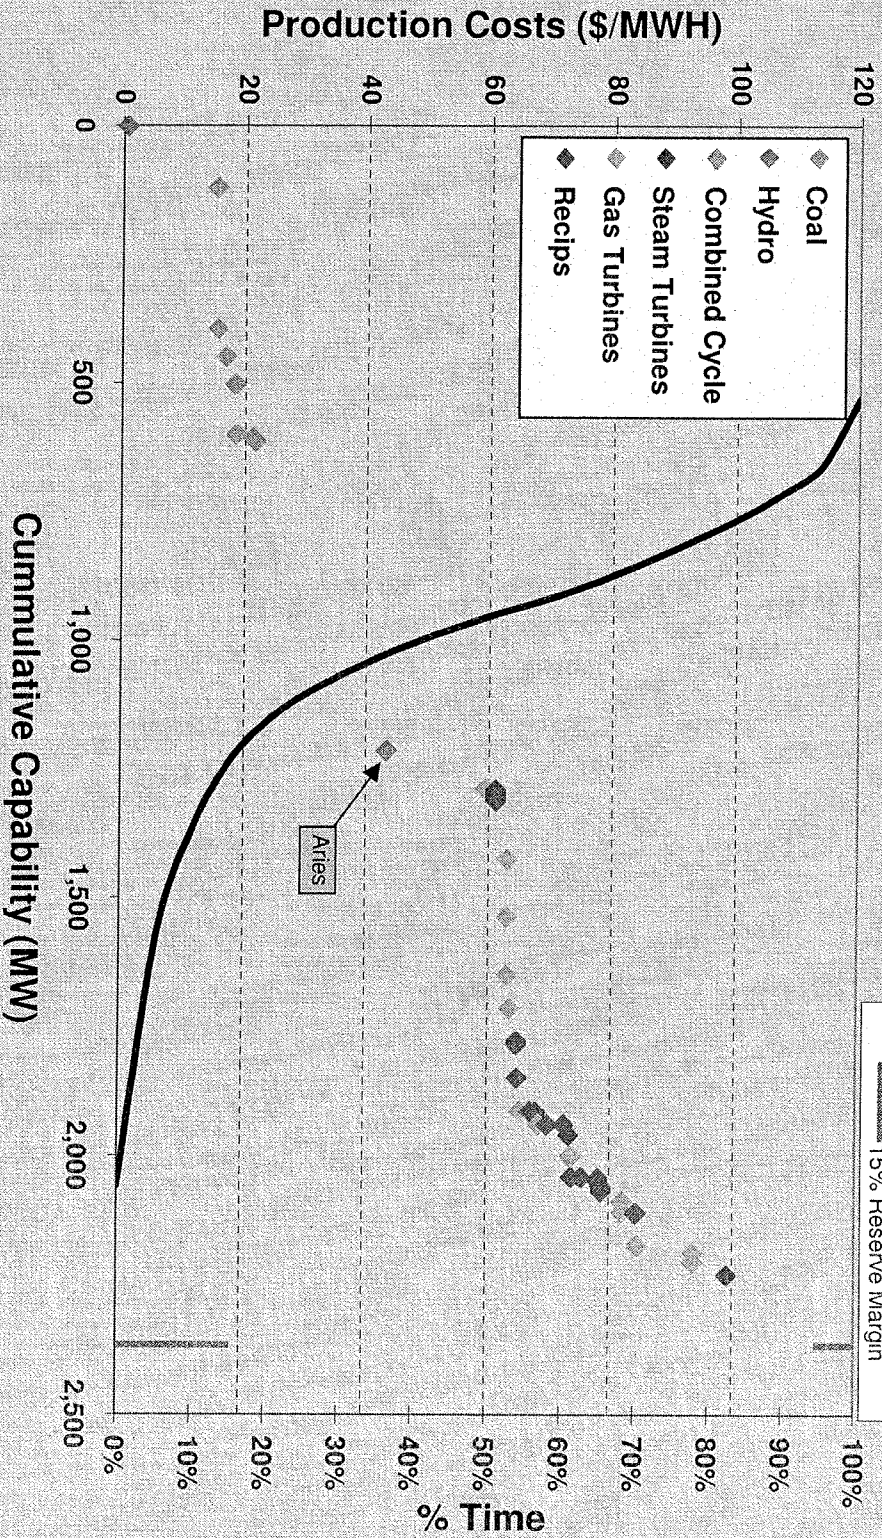





COSTS TO RATE PAYERS OF A SIMPLE CYCLE PEAKING PLANT COMPARED TO ARIES - RATE BASED

Appendix A

Simple Cycle Peaking Plant vs. Aries

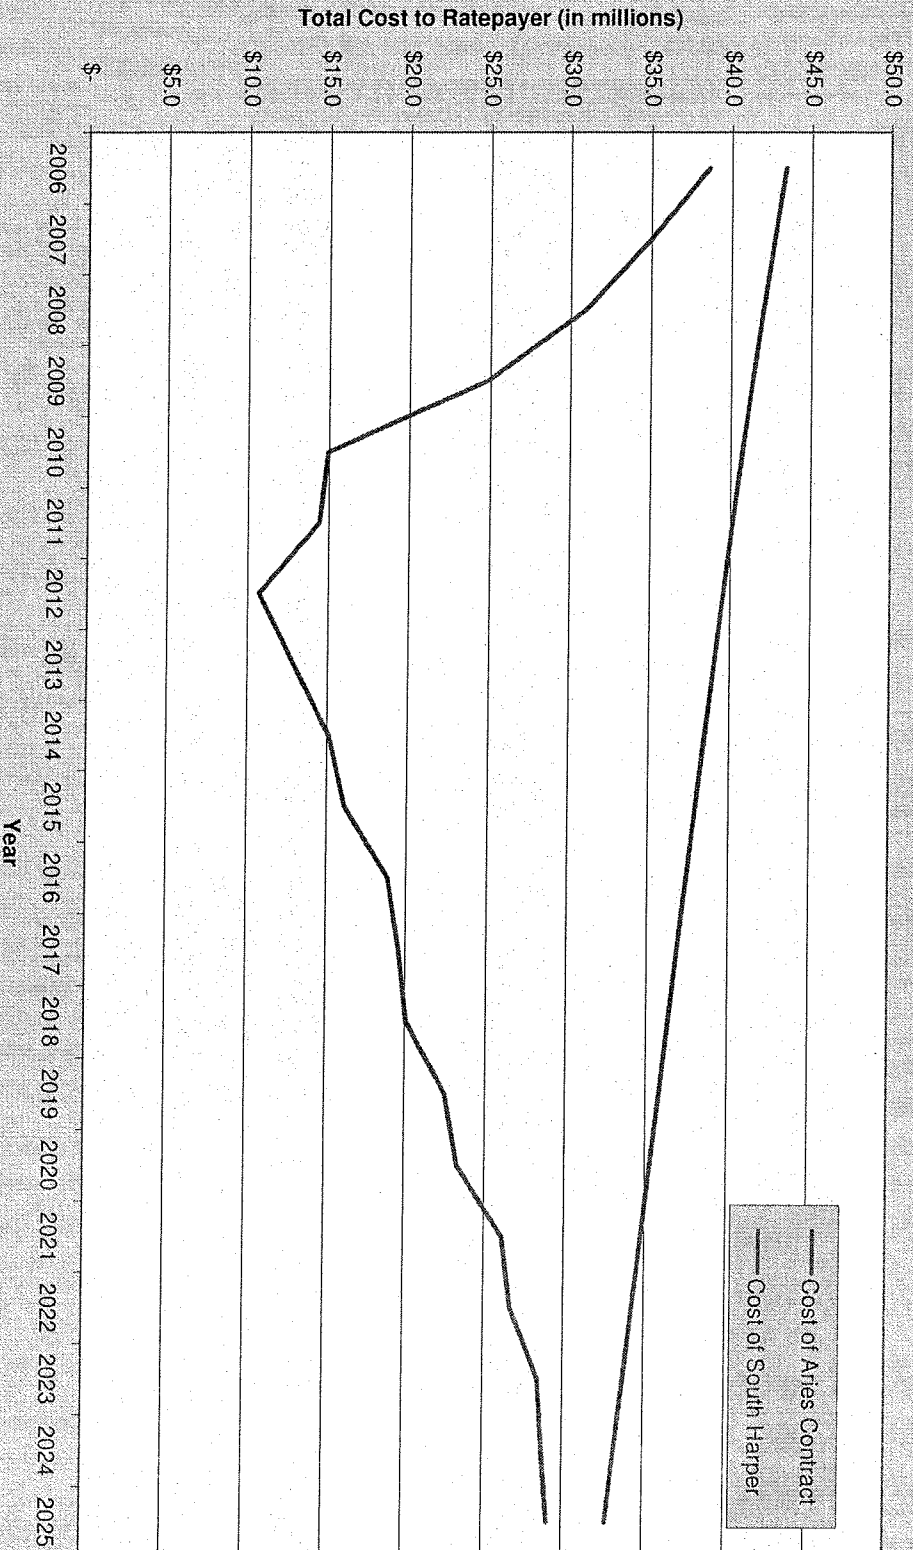





SAVINGS TO RATE PAYERS BY CONTRACTING WITH ARIES - RATE BASED

Appendix A

Savings to Ratepayer by Contracting with Aries instead of a Simple Cycle Peaking Plant

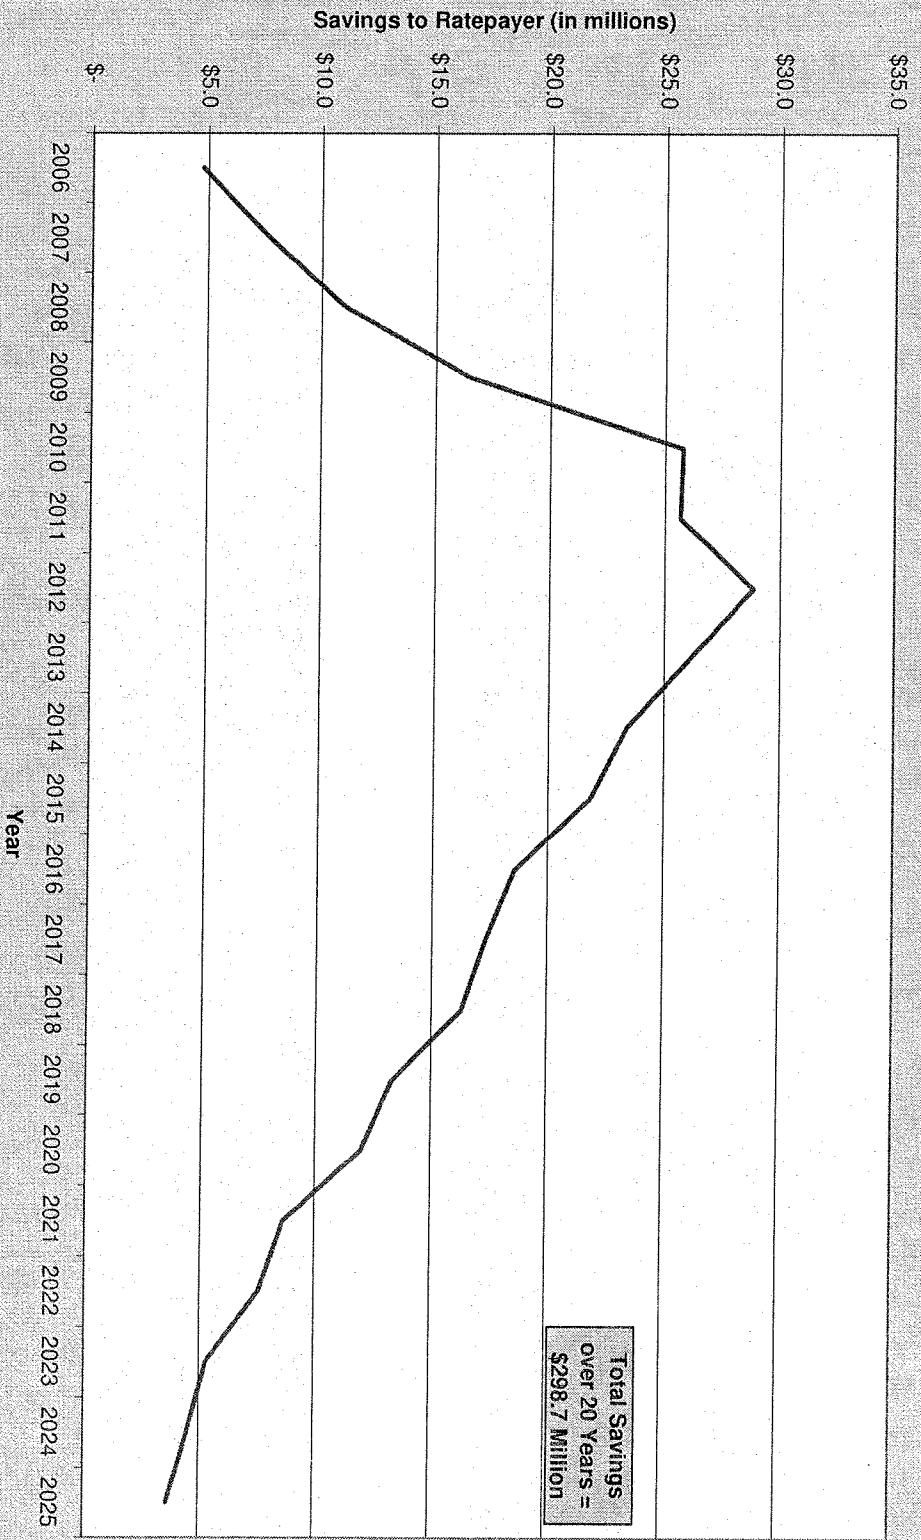

Decision to Build South Harper Peaking Facility

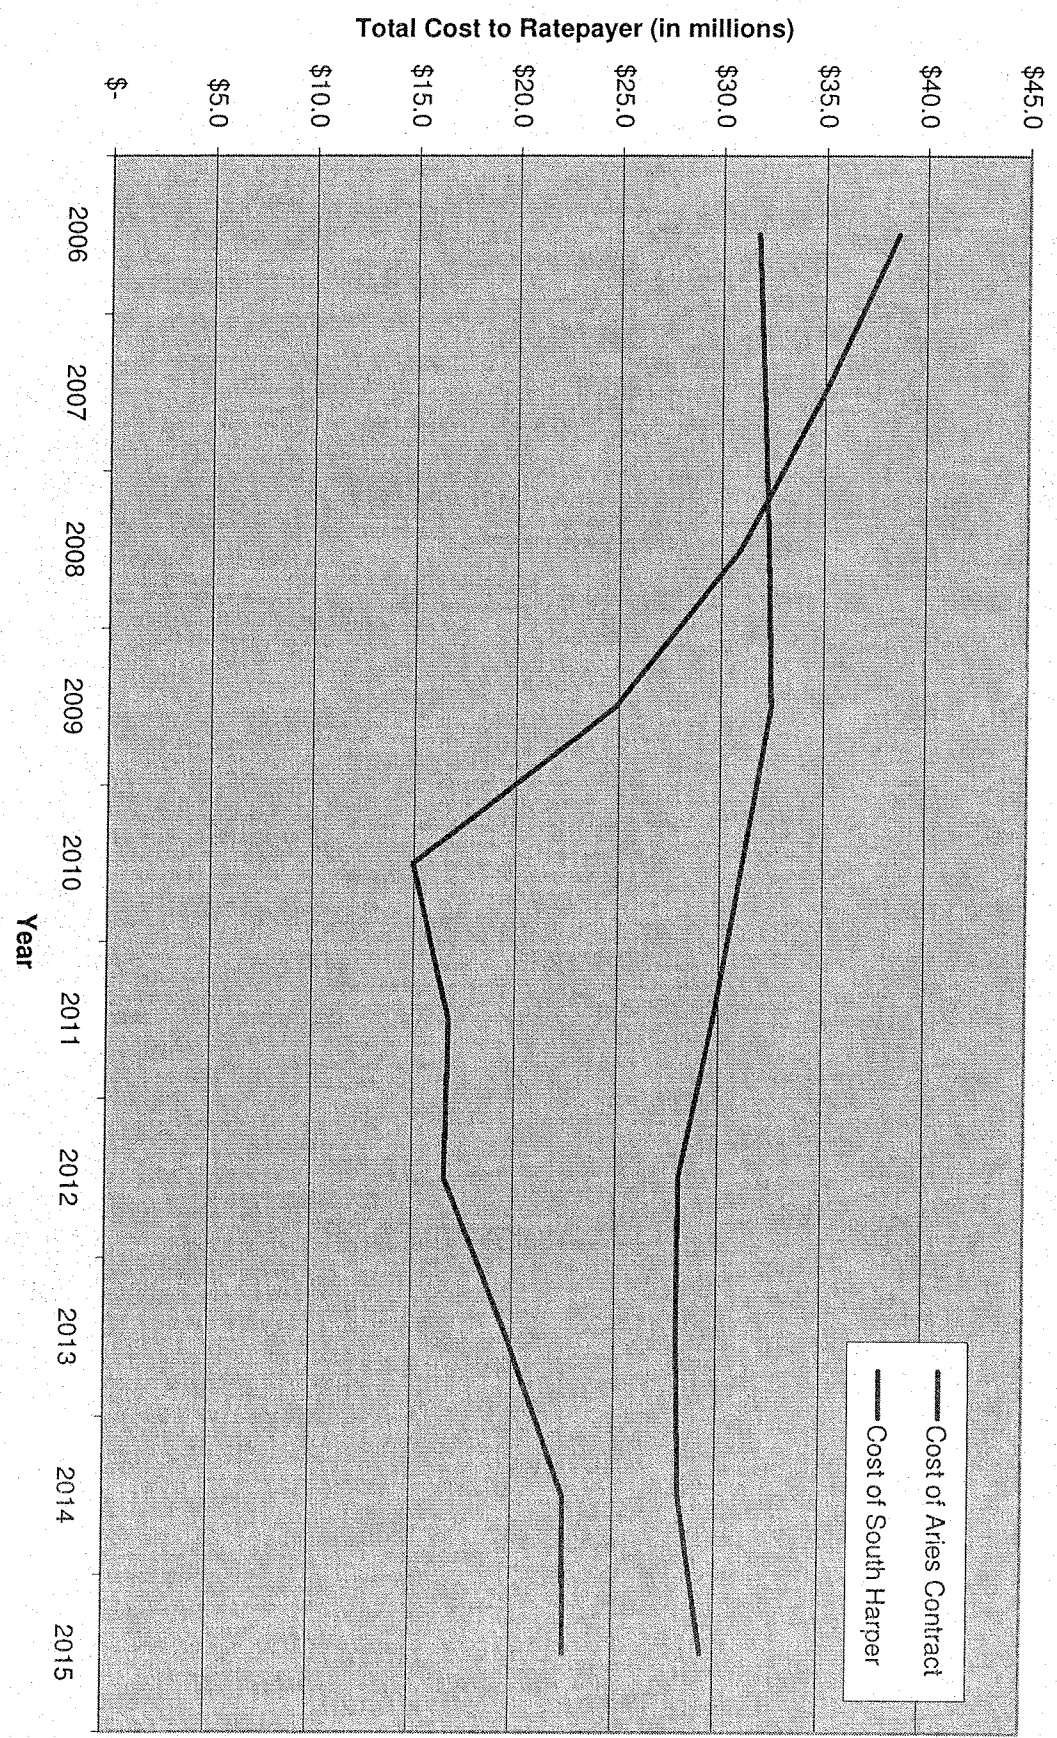

Savings to Ratepayer by Contracting with Aries instead of Building South Harper

