

EVERGY MISSOURI WEST

**TRANSMISSION AND
DISTRIBUTION ANALYSIS**

INTEGRATED RESOURCE PLAN

4 CSR 240-22.045

APRIL 2021



TABLE OF CONTENTS

SECTION 1: ADEQUACY OF THE TRANSMISSION AND DISTRIBUTION NETWORKS	2
1.1 OPPORTUNITIES TO REDUCE TRANSMISSION POWER AND ENERGY LOSSES	2
1.2 DISTRIBUTION SYSTEM OVERVIEW	5
1.3 ANNUAL SCOPE OF WORK	8
1.4 HISTORIAN/NETWORK MANAGER	10
1.5 GEOGRAPHIC INFORMATION SYSTEM (GIS)	11
1.6 SYNERGI	12
1.7 CAPACITY PLANNING	13
1.8 CIRCUIT RATING STUDY	14
1.9 CONTINGENCY PLANNING	15
1.10 N-1 CONTINGENCY	15
1.11 DISTRIBUTION VOLTAGE	16
1.12 LOSS STUDIES	17
1.13 EVERGY GREEN CIRCUITS ANALYSIS	17
1.14 DISTRIBUTION TRANSFORMER EFFICIENCY ANALYSIS	17
1.15 CONDITION	19
1.16 URD CABLE REPLACEMENT PROGRAMS	19
1.17 CABLE ASSESSMENT PROGRAM	19
1.18 WORST PERFORMING CIRCUIT ANALYSIS	20
1.19 POLE REPLACEMENT AND REINFORCEMENT PROGRAM	20
1.20 LATERAL IMPROVEMENT PROGRAM	21
1.21 ASSESSMENT OF INTERCONNECTING NEW FACILITIES	22
1.22 ASSESSMENT OF TRANSMISSION UPGRADES FOR POWER PURCHASES	22
1.23 ASSESSMENT OF TRANSMISSION OR DISTRIBUTION IMPROVEMENTS WITH RESPECT TO COST EFFECTIVENESS OF DSM OR SUPPLY-SIDE RESOURCES	23
1.23.1 CAPACITOR AUTOMATION EFFORTS	23
1.23.2 VOLTAGE MANAGEMENT PROGRAM	24
SECTION 2: AVOIDED TRANSMISSION AND DISTRIBUTION COST	25
2.1 IMPACT OF DSM ON DISTRIBUTION EXPANSION	25
SECTION 3: ANALYSIS OF TRANSMISSION NETWORK PERTAINENT TO A RESOURCE ACQUISITION STRATEGY	27
3.1 TRANSMISSION ASSESSMENTS	27
3.1.1 TRANSMISSION ASSESSMENT FOR CONGESTION UPGRADES	27
3.1.2 TRANSMISSION ASSESSMENT FOR ADVANCE TECHNOLOGIES	28

3.1.3	AVOIDED TRANSMISSION COST ESTIMATE	29
3.1.4	REGIONAL TRANSMISSION UPGRADE ESTIMATE	29
3.1.5	REVENUE CREDITS ESTIMATE	30
3.1.6	TIMING OF NEEDED RESOURCES ESTIMATE	31
3.2	USE OF RTO TRANSMISSION EXPANSION PLAN	31
3.2.1	UTILITY PARTICIPATION IN RTO TRANSMISSION PLAN	31
3.2.2	ANNUAL REVIEW OF RTO EXPANSION PLANS	32
3.2.3	ANNUAL REVIEW OF SERVICE TERRITORY EXPANSION PLAN.....	33
3.2.4	DOCUMENTATION AND DESCRIPTION OF ANNUAL REVIEW OF RTO OVERALL AND UTILITY-SPECIFIC EXPANSION PLANS.....	33
3.2.5	AFFILIATE BUILD TRANSMISSION PROJECT DISCUSSION	34
3.3	RTO EXPANSION PLAN INFORMATION.....	35
3.4	TRANSMISSION UPGRADES REPORT	35
3.4.1	TRANSMISSION UPGRADES REPORT – PHYSICAL INTERCONNECTION WITHIN RTO.....	35
3.4.2	TRANSMISSION UPGRADES REPORT – DELIVERABILITY ENHANCEMENT WITHIN RTO.....	36
3.4.3	TRANSMISSION UPGRADES REPORT – PHYSICAL INTERCONNECTION OUTSIDE RTO.....	37
3.4.4	TRANSMISSION UPGRADES REPORT – DELIVERABILITY ENHANCEMENT OUTSIDE RTO.....	37
3.4.5	TRANSMISSION UPGRADES REPORT – ESTIMATE OF TOTAL COST	37
3.4.6	TRANSMISSION UPGRADES REPORT – COST ESTIMATES	39
SECTION 4: ADVANCED TECHNOLOGY ANALYSIS.....		41
4.1	TRANSMISSION UPGRADES FOR ADVANCED TRANSMISSION TECHNOLOGIES.....	41
4.2	DISTRIBUTION UPGRADES FOR ADVANCED DISTRIBUTION TECHNOLOGIES	41
4.3	OPTIMIZATION OF INVESTMENT IN ADVANCED TRANSMISSION AND DISTRIBUTION TECHNOLOGIES	42
4.3.1	OPTIMIZATION OF INVESTMENT – TOTAL COSTS AND BENEFITS.....	42
4.3.2	OPTIMIZATION OF INVESTMENT – COST OF ADVANCED GRID INVESTMENTS.....	43
4.3.3	OPTIMIZATION OF INVESTMENT – COST OF NON- ADVANCED GRID INVESTMENTS.....	43
4.3.4	OPTIMIZATION OF INVESTMENT – REDUCTION OF RESOURCE COSTS	43

4.3.5	OPTIMIZATION OF INVESTMENT – REDUCTION OF SUPPLY-SIDE COSTS.....	43
4.4	COST EFFECTIVENESS OF INVESTMENT IN ADVANCED TRANSMISSION AND DISTRIBUTION TECHNOLOGIES	43
4.4.1	COST EFFECTIVENESS – INCREMENTAL COSTS ADVANCED GRID TECHNOLOGIES VS NON-ADVANCED GRID TECHNOLOGIES	44
4.4.2	COST EFFECTIVENESS – INCREMENTAL BENEFITS ADVANCED GRID TECHNOLOGIES VS NON-ADVANCED GRID TECHNOLOGIES	44
4.4.3	OPTIMIZATION OF INVESTMENT – NON-MONETARY FACTORS	44
4.4.4	OPTIMIZATION OF INVESTMENT – SOCIETAL BENEFIT	44
4.4.5	OPTIMIZATION OF INVESTMENT – OTHER UTILITY- IDENTIFIED FACTORS.....	45
4.4.6	OPTIMIZATION OF INVESTMENT –OTHER NON-UTILITY IDENTIFIED FACTORS.....	46
4.5	NON-ADVANCED TRANSMISSION AND DISTRIBUTION INCLUSION	46
4.5.1	NON-ADVANCED TRANSMISSION AND DISTRIBUTION REQUIRED ANALYSIS	46
4.5.2	NON-ADVANCED TRANSMISSION AND DISTRIBUTION ANALYSIS DOCUMENTATION.....	47
4.6	ADVANCED TRANSMISSION AND DISTRIBUTION REQUIRED COST-BENEFIT ANALYSIS.....	47
4.6.2	ADVANCED GRID TECHNOLOGIES UTILITY’S EFFORTS DESCRIPTION	48
	SECTION 5: UTILITY AFFILIATION.....	49
	SECTION 6: FUTURE TRANSMISSION PROJECTS	51

TABLE OF FIGURES

Figure 1: CHRONUS.....	10
Figure 2: GIS Screenshot	11
Figure 3: Synergi Screenshot	12
Figure 4: Screenshot from Cable De-rating Program.....	15

TABLE OF TABLES

Table 1: Cost Analysis for 161kV Transmission Line Loss Reduction	4
Table 2: SPP 2021 Transmission Losses by Area	5
Table 3: Distribution Planning - Annual Scope of Work	9
Table 4: SPP Projected ATRR Allocated to Evergy Missouri West.....	29
Table 5: Region-Wide 2021 Revenue Requirements for SPP Projects Owned by Evergy Missouri West.....	30
Table 6: Evergy Missouri West Transmission Projects 2021 SPP STEP	39
Table 7: Transmission Upgrade Costs Allocated to Evergy Missouri West.....	40

TABLE OF APPENDICES

Appendix 4.5.A: 2020 SPP Integrated Transmission Planning Assessment Report

Appendix 4.5.B: 2021 SPP Transmission Expansion Plan Report

Appendix 4.5.C: 2021 SPP Transmission Expansion Plan Report Appendix 1

Appendix 4.5.D: Electric Loss Study for Test Year 2016 for the Evergy and GMO Systems

Appendix 4.5.E: Evergy Green Circuits Analysis

INDEX OF RULES COMPLIANCE

22.045 Transmission and Distribution Analysis

(1).....	2
(1) (A).....	2
(1) (B).....	22
(1) (C).....	22
(1) (D).....	23
(2).....	25
(3) (A).....	27
(3) (A) 1.....	27
(3) (A) 3.....	29
(3) (A) 4.....	29
(3) (A) 5.....	30
(3) (A) 6.....	31
(3) (A)2.....	28
(3) (B).....	31
(3) (B) 1.....	31
(3) (B) 2.....	33
(3) (B) 3.....	33
(3) (B) 4.....	33
(3) (B)5.....	34
(3) (C).....	35
(3) (D).....	35
(3) (D) 1.....	35
(3) (D) 2.....	36
(3) (D) 3.....	37
(3) (D) 4.....	37
(3) (D) 5.....	37
(3) (D) 6.....	39
(3).....	27
(4).....	41
(4) (A).....	41
(4) (B).....	41
(4) (C).....	42
(4) (C) 1.....	42
(4) (C) 1. A.....	43
(4) (C) 1. B.....	43

(4) (C) 1. C.	43
(4) (C) 1. D.	43
(4) (C) 2.	43
(4) (C) 2. A.	44
(4) (C) 2. B.	44
(4) (C) 2. C.	44
(4) (C) 3.	44
(4) (C) 3. A.	45
(4) (C) 3. B.	45
(4) (C) 3. C.	45
(4) (C) 3. D.	45
(4) (C) 4.	45
(4) (C) 5.	46
(4) (D)	46
(4) (D) 1.	46
(4) (D) 2.	47
(4) (E)	47
(4) (E) 1.	48
(4) (E) 2.	48
(5)	49

VOLUME 4.5: TRANSMISSION AND DISTRIBUTION ANALYSIS

HIGHLIGHTS

- Evergy transmission losses as a percent of peak load served are low relative to the SPP footprint as a whole.
- SPP did not identify any economic projects in the Evergy Missouri West footprint during its 2020 Integrated Transmission Planning (ITP) process.
- SPP identified one reliability project in the Evergy Missouri West footprint through its 2020 ITP process, which was a breaker replacement due to the short circuit portion of the study with a need date of 6/1/2022.

PURPOSE: This rule specifies the minimum standards for the scope and level of detail required for transmission and distribution network analysis and reporting.

SECTION 1: ADEQUACY OF THE TRANSMISSION AND DISTRIBUTION NETWORKS

(1) The electric utility shall describe and document its consideration of the adequacy of the transmission and distribution networks in fulfilling the fundamental planning objective set out in 4 CSR 240-22.010. Each utility shall consider, at a minimum, improvements to the transmission and distribution networks that—

1.1 OPPORTUNITIES TO REDUCE TRANSMISSION POWER AND ENERGY LOSSES

(A) Reduce transmission power and energy losses. Opportunities to reduce transmission network losses are among the supply-side resources evaluated pursuant to 4 CSR 240-22.040(3). The utility shall assess the age, condition, and efficiency level of existing transmission and distribution facilities and shall analyze the feasibility and cost-effectiveness of transmission and distribution network loss-reduction measures. This provision shall not be construed to require a detailed line-by-line analysis of the transmission and distribution systems, but is intended to require the utility to identify and analyze opportunities for efficiency improvements in a manner that is consistent with the analysis of other supply-side resource options;

Electrical losses in a transmission line are primarily dependent on the specific characteristics of the line (conductor type, line length, etc.) and the amount of power flowing (I^2R) on the transmission line. Evergy uses 161kV transmission lines (approximately 800 miles) for the majority of its load serving substations and many of Evergy Missouri West's existing 161kV transmission lines use a single 795 ACSR conductor per phase on H-frame wood structures. This design provides a normal line rating of 250 MVA and an emergency rating of 281 MVA for summer conditions. For increased transmission capability and lower line losses, Evergy Transmission Engineering recommends two different line designs depending on

location: two 795 ACSR conductors per phase on H-frame wood if the line is located in a rural area or single 1192 ACSS on steel structures if the line is located in an urban area. The bundled 795 ACSR design provides a normal line rating of 501 MVA and an emergency rating of 563 MVA for summer conditions and the single 1192 ACSS provides a normal and emergency line rating of 591 MVA for summer conditions. The updated conductor reduces the line's electrical resistance and results in reduced transmission losses. Transmission Engineering estimated the cost to rebuild a transmission line at \$1.6 million per mile in rural areas and \$1.85 million per mile in urban areas.

In order to “analyze the feasibility and cost-effectiveness of transmission network loss-reduction measures”, Evergy Transmission Planning staff analyzed the costs and loss reductions associated with rebuilding five of Evergy Missouri West's most heavily loaded 161kV transmission lines. This analysis involved calculating new impedances values for the five transmission lines converted to the preferred conductor based on location and performing a loadflow analysis to determine the level of loss reduction for the rebuilt lines. Results of this analysis for 2021 summer peak conditions are shown in Table 1 below.

Table 1: Cost Analysis for 161kV Transmission Line Loss Reduction

Current Line Information					
161kV Transmission Line		Line Length	Impedance		
From	TO	MILE	R (pu)	X (pu)	B (pu)
Nashua	Liberty West	7.04	0.00321	0.02068	0.01035
Western Electric	Longview	3.62	0.00167	0.01025	0.00550
Blue Springs East	Grain Valley	4.62	0.00267	0.01038	0.00695
Orrick	Sibley Plant	5.39	0.00402	0.01644	0.00757
Industrial Park	Eastowne	1.76	0.00055	0.00484	0.00282
EMW Losses (MW)					23
Rebuild Line Information					
161kV Transmission Line		Line Length	Impedance		
From	TO	MILE	R (pu)	X (pu)	B (pu)
Nashua	Liberty West	7.04	0.00160	0.01452	0.01459
Western Electric	Longview	3.62	0.00108	0.01039	0.00539
Blue Springs East	Grain Valley	4.62	0.00138	0.01325	0.00688
Orrick	Sibley Plant	5.39	0.00123	0.01112	0.01117
Industrial Park	Eastowne	1.76	0.00040	0.00363	0.00365
Total Cost					\$37,948,000.00
EMW Losses (MW)					22.6
Loss Reduction (MW)					0.4
Loss Reduction (kW)					400
Cost per kW					\$94,870.00

The average cost of loss reduction for these five transmission lines is \$94,870/kW. Clearly, transmission loss reduction is not cost effective for Evergy when compared to the cost of new supply side resources. This is mainly due to the fact that Evergy already has a relatively low loss transmission system.

The Evergy transmission system is a relatively low loss network due to good line design, concentration of load, and the distribution of its generation resources throughout its service territory. As shown in Table 2, Evergy’s projected transmission loss as a percent of peak load served for 2021 summer peak load conditions is only 1.5%. The comparative value for the rest of the Southwest Power Pool (SPP) is 2.4%.

Table 2: SPP 2021 Transmission Losses by Area

Area	Load MW	Loss MW	% Loss
652	4,441.4	222.5	5.0%
640	3,737.2	137.5	3.7%
534	1,265.5	43.0	3.4%
515	616.1	20.9	3.4%
531	402.3	13.0	3.2%
526	6,550.9	187.7	2.9%
544	1,099.3	29.2	2.7%
536	6,138.9	146.2	2.4%
525	1,754.0	36.9	2.1%
524	6,762.5	137.4	2.0%
520	10,474.7	207.5	2.0%
Evergy Metro & Missouri West Combined	5,860.2	85.7	1.5%
645	2,883.3	33.3	1.2%
523	1,468.6	16.7	1.1%
650	772.3	8.4	1.1%
546	756.4	8.1	1.1%
545	296.4	3.1	1.0%
659	283.9	1.2	0.4%
542	547.8	2.2	0.4%
527	315.9	0.6	0.2%
SPP	56,427.5	1341.0	2.4%

1.2 DISTRIBUTION SYSTEM OVERVIEW

The Evergy Missouri West planning groups (Supply, Transmission, and Distribution) assimilates a broad set of engineering inputs to determine how the company will invest in improving the respective systems to meet ongoing load growth, system reliability, operational efficiency and asset optimization needs. The Distribution Planning group analyzes data, identifies patterns, develops electrical model's representative of the Evergy distribution system, and performs studies to understand and prioritize system improvement needs.

For Evergy Missouri West, the suburban areas of the system require the build-out of the distribution system due to the development of open land. The highest load growth is seen on the fringe, demanding investments to serve new emerging electrical loads – largely a capacity issue. New circuits require expanding substation breaker positions and circuits must be effectively tied together to allow for contingency switching and to disperse the load across a larger number of circuits. Many investments like this are in the five-year plan, particularly in the Liberty and Blue Springs areas.

The rural areas have the most widespread infrastructure components and have the fewest or most limited emergency ties, where any load manipulation can cause large disturbances to customers' voltage. Distribution Planning carefully examines these systems to ensure customer voltages are within tolerance, a process that demands high-quality mapping and device load data. With so many widespread components, acquiring data has become one of the greatest challenges in these areas. One specific project completed to address rural voltage issues was the Merwin Corners 5-mile circuit reconductor project, in the Belton service territory. Projects to convert the 161/25kV to a 161/34kV system have been initiated in the five-year plan. These projects also seek to improve voltage conditions in the Belton service area.

To the North, the City of St. Joseph behaves from a planning perspective like a mini version of the Kansas City Metro Area. The overall electrical energy demand remains stable, with pockets of growth and areas of load decline. The growth areas are on the city's eastern fringe, while the inner core is experiencing reoccupation of old abandoned buildings. For Distribution Planning, the 34kV system in St Joseph presents a unique challenge. While suitable for rural sub-transmission or distribution purposes, the 34kV becomes problematic in dense, urban centers like St Joseph. First, 34kV system is not as reliable as the 161kV transmission system. Second, the reliability suffers when many customers are tied to one 34kV circuit; one incident could cause a wide-spread outage. The Distribution Planning group

will, over time, reduce the geographic reach of the 34kV while meeting immediate load and contingency requirements of the distribution system.

The Distribution Planning group is tasked with elevating the highest priority and highest-risk projects to a point where investments are made earlier than those with lower priorities and risk profiles. Many years of constant review have provided the group with a robust set of criteria within which these problems are evaluated, and even today process improvements are being made to further analyze how well to build out the distribution system to assure cost-effectiveness.

Furthermore, the Long-Term Planning component handled by Distribution Planning assures strategic long-term investments are made. Solutions are selected based upon how well they fit into an area-plan, not only the cost-effectiveness for the immediate need. Between the robust planning criteria and the strategic long-term vision, Distribution Planning will continue to construct the distribution system capable of serving tomorrow's needs by making appropriate investments when they are needed.

On the suburban fringe, Distribution Planning determines outgrowth patterns to identify substation sites well ahead of the need. To the South and West of Lee's Summit, two sites have already been purchased as future substation sites (Raymore East and Sampson Road). On the Northern edge of Evergy Missouri West's metro area, the Kent substation site has already been purchased in anticipation of future load growth. Within the 20-year plan, ten separate new substations or substation expansions will accommodate growth as Kansas City sprawls outward. Distribution Planning constantly reviews the build-out of the distribution system on the suburban fringe as development in Kansas City continues this growth pattern North, South, and East of the current Metro Area.

In St Joseph, the future vision would remove the capacity-limited 34kV sub-transmission system and replace it with a 161kV-fed system of distribution

substations. An improvement to reliability and capacity, this would eliminate a duplicate layer of maintenance, simultaneously shrinking circuit sizes to reduce a customer's exposure to outages and bringing higher-voltage lines into the St Joseph metro area. Several projects to minimize the footprint of 34 kV system in the St Joseph service area have been initiated in the five-year plan. Specific projects include installing Sunset 161/12kV substation and decommissioning Oak Street and Quaker Oats 34.5/12kV substations.

The rural areas of the service territory are envisioned to one day have entirely remotely-received load and condition data – a completely automated system. Today, load information is difficult to obtain and costly for field load checks during peak periods. Strategic and timely decisions can better be made with abundant characteristic data for the components being studied. Efforts are underway to systematically bring all rural components up to metro-area data acquisition standards. A specific example of these efforts is the deployment of Current Fault Circuit Indicators (CFCI) throughout the Evergy Missouri West service footprint.

The goal of Distribution Planning is to assure that every investment optimizes capital spend and balances risk, meets current and future needs, and is built strategically when and where they are needed. Many tools and a great deal of information is processed and analyzed to develop these strategic plans.

1.3 ANNUAL SCOPE OF WORK

Throughout each year, Distribution Planning prepares several system studies to determine weaknesses or risks to reliability and to assess the overall adequacy of our distribution system. Much of the work focuses on increasing reliability and prioritizing work based upon cost, scope, impact, and effectiveness. This work is centered around five (5) specific areas: capacity, contingency, voltage, condition, and compliance. The table below illustrates the various deliverables associated with each focus area:

Table 3: Distribution Planning - Annual Scope of Work


Category	Study Name	Deliverable
Capacity	Load Preservation, 5-Year System Expansion-Load, Peak Load Study, 15-Year Forecast, Circuit Rating Study	Black Start Plan, Budgetary Recommendations, Distribution Load Book, Forecasted Substation Loads, Circuit Rating utilized for Operational Guidance
Contingency	5-Year System Expansion-Contingency, N-1 Contingency, N-1 Transformer Contingency, Fault Location Isolation Service Restoration (FLSR)	Budgetary Recommendations, Circuit Contingency Plan, Transformer Contingency Plan, Grid Modernization
Voltage & Losses	Phase Balancing, Voltage Drop, System Efficiency Studies, Capacitor, Voltage Regulation	Load-Swap Recommendations, Voltage Management Schemes, System Loss Studies, Capacitor Installations, Substation Tap Settings
Condition	Worst Performing Circuits, Circuit Review, Short Circuit, Other Reviews	Budgetary Recommendations, Grid Modernization, Customer-Required Special Studies
Compliance	MO/KS Load Split, EIA 861 Annual Circuit Count	Non-metered Power flow Across State lines, Circuit Count for Voltages 35 kV & below

To complete this identified scope of work, Distribution Planning Engineers utilize a variety of tools that make use of the device loads and system schematics as input. There are several tools currently in use at Evergy Missouri West to collect and process this information.

1.4 HISTORIAN/NETWORK MANAGER

The new Energy Management System (EMS) was placed in-service in 2016. With this product, Evergy Missouri West also utilizes the CHRONUS data archive tool, which now contains device loads and other historical system characteristics. Once all system components are merged into the new system, CHRONUS will be the primary archive for engineers to find and extract load and voltage history. The figure below provides a snapshot of the data extracted from CHRONUS.


Figure 1: CHRONUS

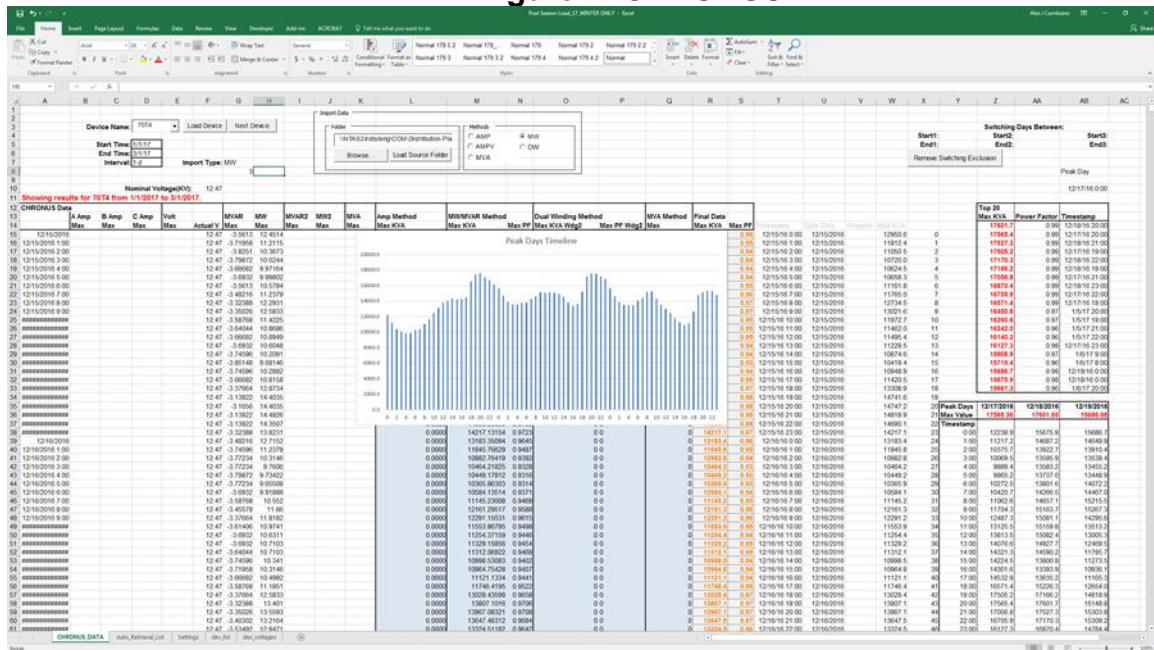

1.5 GEOGRAPHIC INFORMATION SYSTEM (GIS)

Every Missouri West is upgrading from G/Technology to ESRI's GIS (Geographic Information System) application. Although base operations and capabilities of G/Tech and ESRI are similar, the advanced functionality and mapping features in ESRI support greater integration across Every Missouri West software stack. The Distribution Planning engineers will use the GIS application to acquire model data for use in Synergi. Device characteristics and connectivity drive load-flow models in use by Distribution Planning engineer. The figure below provides a snapshot of GIS.

Figure 2: GIS Screenshot

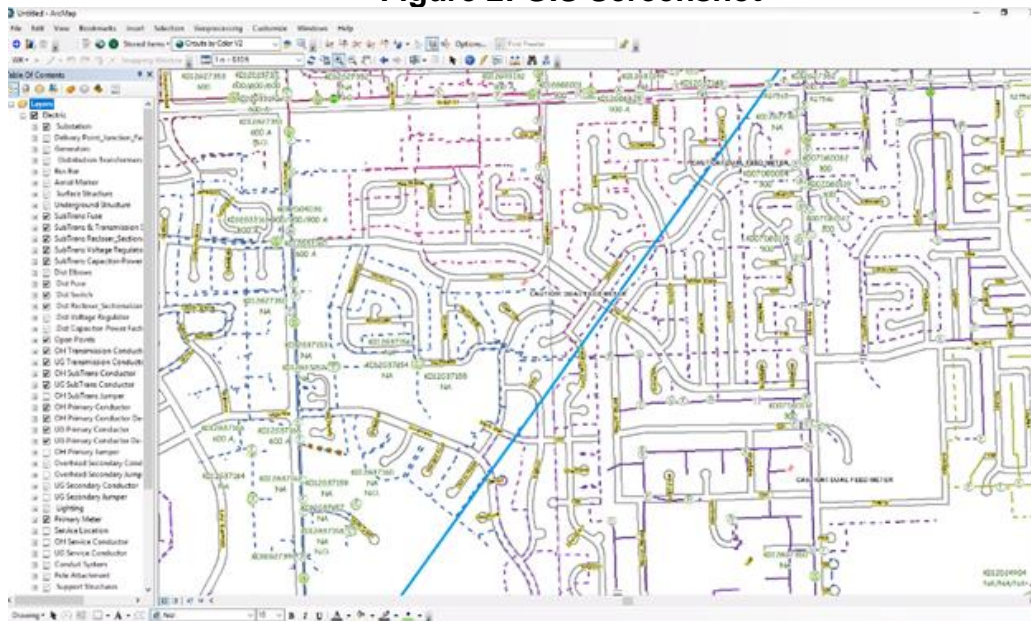

1.6 SYNERGI

A multipurpose tool primarily used by engineers to analyze load flow characteristics of distribution feeders. Evergy also provides fault current information to customer's electrical contractors when performing arc-flash studies, a process which requires the use of Synergi. The figure below provides a snapshot of the Synergi software program multipurpose tool primarily used by engineers to analyze load flow characteristics of distribution feeders. Evergy Missouri West is also responsible for providing fault current information to customer's electrical contractors when performing arc-flash studies, a process which requires the use of Synergi. The figure below provides a snapshot of the Synergi software program.

Figure 3: Synergi Screenshot



1.7 CAPACITY PLANNING

Device loads, such as substation transformer and distribution circuit loads are collected annually from several remote-sensing sources. This load data is compared to previous years' loads and device maximum loading to determine how the load is changing over time and if any component is overloaded and in need of an upgrade. These types of problems are given a higher priority than others to assure continued reliability.

1.8 CIRCUIT RATING STUDY

Using adjusted loads, Distribution Planning will determine ratings for each circuit. This study is done in several diverse ways depending on the configuration and style of the distribution components under review. The most complex of these studies deals with underground feeder cables within duct bank, which de-rate each other by mutual heating. Distribution Planning uses circuit loads to determine capacity 'choke-points' to rate the circuit. These ratings are provided to Operations to determine alarm setpoints and become an integral part of the N-1 Contingency Study. These ratings are also compared with native device loads to determine where normal-load capacity expansions are needed, leading to budget recommendations.

Figure 4: Screenshot from Cable De-rating Program

Description Duct Bank from M.H. 2312 East to M.H. 2313
Rows 6 # of Positions
Columns 2
Ambient 22
Earth Rho 90

<i>Position</i>	<i>Circuit</i>	<i>load factor</i>	<i>running load</i>	<i>vertical</i>	<i>horiz. Voltage</i>	<i>Nom Ckt Voltage</i>	<i>Duct Type</i>	<i>Cable Type</i>
1	1561	0.67	204	77.8	5.6	13	4.5"-Fibre	1-400 KCM-3C PILC
2	7472	0.67	35	77.8	12.9	13	4.5"-Fibre	1-400 KCM-3C PILC
3	1574	0.67	201	70.5	5.6	13	4.5"-Fibre	1-750 KCM-3C PILC
4	1511	0.67	123	70.5	12.9	13	4.5"-Fibre	1-750 KCM-3C PILC
5	1743	0.67	185	63.2	5.6	13	4.5"-Fibre	1-750 KCM-3C PILC
7	1567	0.67	109	55.9	5.6	13	4.5"-Fibre	1-750 KCM-3C PILC
9	7432	0.67	228	48.6	5.6	13	4.5"-Fibre	1-750 KCM-3C PILC
10	1522	0.67	178	48.6	12.9	13	4.5"-Fibre	1-750 KCM-3C PILC
11	1523	0.67	180	41.3	5.6	13	4.5"-Fibre	1-750 KCM-3C PILC
12	1512	0.67	195	41.3	12.9	13	4.5"-Fibre	1-750 KCM-3C PILC

<i>Circuit</i>	<i>Load (A)</i>	<i>Oper. Temp.</i>	<i>Norm. Amp.</i>	<i>Norm. MVA</i>	<i>Emerg. Amp.</i>	<i>Emerg. MVA</i>
1561	204	50.6	380	8.68	428	9.78
7472	35	37.8	369	8.44	418	9.55
1574	201	45.1	522	11.93	575	13.15
1511	123	40.6	520	11.88	575	13.15
1743	185	44.0	522	11.94	575	13.15
1567	109	40.3	522	11.93	575	13.15
7432	228	45.7	536	12.26	575	13.15
1522	178	42.4	533	12.19	575	13.15
1523	180	41.0	544	12.44	575	13.15
1512	195	41.7	546	12.47	575	13.15

1.9 CONTINGENCY PLANNING

Contingency Planning is similar to Capacity Planning in its view of loads compared to device capacity but deals in an N-1 contingency setting. Every Missouri West designs its system to withstand a failure of any one component at a given time. It is the responsibility of Distribution Planning Engineers to determine system weaknesses which do not comply with these criteria and to make the necessary changes to allow emergency switching to restore power without overloading backup devices. These issues have a secondary priority in the budgetary process.

1.10 N-1 CONTINGENCY

The annual contingency study will provide the earliest indication of system improvement needs. It is more likely wire upgrades will be needed in the case of feeder or transformer loss, rather than there being simply too much native load on a single feeder or substation transformer. For Distribution Planning, the N-1 Contingency Study is a very systematic and complex process due to the magnitude

of the individual distribution system circuit components. Synergi is the primary software tool in use to determine the load flow across a circuit. Distribution Planning engineers divide circuits into segments of load and establish switching orders for restoration in the case of a feeder or substation transformer loss. Using GIS models and load data, Synergi determines how that load is dispersed across the circuit by allocating the load based on the by-phase connected KVA on each circuit.

By using the Synergi model to rearrange configuration of circuitry, Distribution Planning can detect where mapping errors exist, where low voltage can be problematic, and where wire sizes can limit how the distribution system is operated. Contingency Planning is an intensely complex process taking significant engineering time to determine system weaknesses for a given planning year. The study is completed every year for loss of every distribution feeder and substation transformer.

These weaknesses are identified and analyzed to determine the impact to system reliability and are ranked against each other correspondingly. This ranking, energy efficiency impacts, reliability and customer impact risks, and the project cost determine whether a system improvement is constructed or not. Distribution Planning therefore must not only identify the weakness but provide some budgetary estimation and project description. It also becomes the responsibility of Distribution Planning to thoroughly communicate why a project exists throughout the company, until it becomes part of the approved budget and is handed-off to a design engineer for sponsorship.

1.11 DISTRIBUTION VOLTAGE

At the customer-end of any given line, distribution voltage must be maintained within specific tolerances. It is the responsibility of Distribution Planning to assure system-level issues do not adversely affect the voltage received by Evergy customers. To do this, GIS models are used in a load-flow program called Synergi to simulate voltage levels in the field. In addition to supplying adequate voltage

levels to our customers, we strive to maintain an efficient low-loss distribution system. Several examples of this are the annual load balancing efforts and capacitor studies to optimize voltage levels and reduce system losses.

1.12 LOSS STUDIES

Another method of analyzing overall system efficiency is through the performance of system loss studies. These are done periodically, and the information gathered is used by Planning Engineering as well as in rate case filings. The most recent system loss study was performed by Siemens in June 2018. A complete copy of this study, “Electric Loss Study for Test Year 2016 for the Evergy and GMO Systems”, can be found in Appendix 4.5.D

1.13 EVERGY GREEN CIRCUITS ANALYSIS

Another example of Evergy Missouri West’s efforts to improve overall circuit efficiency and reduce system losses was to utilize a study commissioned by Evergy and completed by EPRI (Electric Power Research Institute). This study analyzed various loss reduction options such as phase balancing, capacitor controls, reconductoring, tarhas been used by Planning Engineering to optimize their approach to circuit construction, configuration, and operation for both Evergy Metro and Evergy Missouri West service areas. A complete copy of this study, “Green Circuits Analysis Study,” can be found in Appendix 4.5.E.

1.14 DISTRIBUTION TRANSFORMER EFFICIENCY ANALYSIS

Currently, Evergy Missouri West purchases transformers based on the Total Ownership Cost (TOC), which includes the transformer purchase price as well as the cost of the no-load and load-losses associated with each transformer, capitalized over a 30-year expected transformer life. Transformer manufacturers are required to follow Department of Energy (DOE) transformer efficiency standards and those standards are one factor they consider when optimizing transformers, along with variables related to our specific system. The most recent update to the DOE’s efficiency standards were made in 2016.

1.15 CONDITION

Another important focus area for Distribution Planning Engineering deals with component conditions and their effect on reliability as it relates to capacity, contingency, voltage, and overall system efficiency. Ongoing strategic planning to maintain reliability must account for device degradation over time, and planning engineers look for cost-effective replacement or maintenance opportunities where they coincide with capacity expansion plans. By working with the Asset Management group to determine the best course of action, these replacements in some cases are combined into Distribution Planning's capacity expansion projects – an increase in project scope from the normal course of action. System expansion to proactively replace degraded system components can be a more cost-effective solution than the “run-to-failure” strategy.

1.16 URD CABLE REPLACEMENT PROGRAMS

Currently, there are two cable replacement programs in existence at Evergy: 1) Proactive Cable Replacement, and 2) Reactive Cable Replacement.

The Proactive Cable Replacement/Rehabilitation program targets Underground Residential Distribution (URD) primary cable loops and laterals that are shown to have elevated risk of failure based on engineering analysis. Cable failure data is collected on an ongoing basis and compiled to show area results and trends. The analysis of this data helps prioritize the areas that are selected for our proactive programs.

The Reactive Cable Replacement program addresses service reliability issues associated with URD primary cable. Evergy collects condition history and performs lifecycle analysis on failed cables.

1.17 CABLE ASSESSMENT PROGRAM

In the Cable Assessment Program, the insulation properties of individual cable segments are evaluated using a partial discharge test which evaluates the cable's integrity. Based on the results of these tests, a decision is made on which cable

segments to replace.

1.18 WORST PERFORMING CIRCUIT ANALYSIS

The High Outage Count Customer Program, also known as the “Worst Performing Circuits” Program, is a circuit-based program addressing service reliability issues associated with customers experiencing abnormally high outage counts. Evergy identifies high outage count customers, investigates their outage events, and develops solutions to improve their circuit reliability. The Company uses the definition found in the MPSC reliability rule, 4 CSR 240-23.010 (6) to identify the top five percent (5%) worst performing circuits and to prioritize work needed to improve their reliability.

Analyzing annual outage management records and field ultrasound inspection results assist in understanding root causes and the ensuing remedial action required to mitigate future incidents. The top ranked five percent (5%) high outage count customer circuits are analyzed annually to ensure reliability improvements are being achieved.

1.19 POLE REPLACEMENT AND REINFORCEMENT PROGRAM

The Distribution Pole Replacement/Reinforcement Program addresses reliability issues associated with the condition of distribution poles. Evergy annually conducts a ground-line inspection of the system to determine if there is a need to replace or reinforce distribution poles. The evaluation includes an examination for indications of decay and/or fungi at or below ground level, hollowness, and shell rot. When a pole is identified for replacement or reinforcement, the Company uses an independent contractor who is an expert in pole evaluation, maintenance, and repair, to prioritize and coordinate pole maintenance or replacement. The work is prioritized based on greatest risk to safety and impact to customer reliability.

1.20 LATERAL IMPROVEMENT PROGRAM

The Lateral Improvement Program addresses system-wide distribution reliability performance. Evergy conducts analysis to identify unfavorable reliability metrics. The systematic approach used determines root causes of irregular system component performances—such as pole or cross-arm failure, cutouts, arrester malfunction, grounding issues, undetected equipment vandalism and/or other undetected damage, among others. Detailed condition assessments and risk-modeling are used to formulate solutions concentrated on specific reliability issues. Projects are prioritized based on the magnitude and impact of customer outage.

1.21 ASSESSMENT OF INTERCONNECTING NEW FACILITIES

(B) Interconnect new generation facilities. The utility shall assess the need to construct transmission facilities to interconnect any new generation pursuant to 4 CSR 240-22.040(3) and shall reflect those transmission facilities in the cost benefit analyses of the resource options;

Any Evergy generation resource addition that would impact transmission level (>60 kV) flows would have to proceed through the Southwest Power Pool (SPP) Generation Interconnection process before it could be interconnected to the transmission system. The Interconnection process as detailed in SPP's Federal Energy Regulatory Commission (FERC) approved transmission tariff provisions allows customers detailed transmission studies and interconnection estimates for connecting to and using Evergy's transmission system. The resource addition would also have to go through the SPP Aggregate Facility Study process to obtain firm transmission service for delivery of generation to load.

1.22 ASSESSMENT OF TRANSMISSION UPGRADES FOR POWER PURCHASES

(C) Facilitate power purchases or sales. The utility shall assess the transmission upgrades needed to purchase or sell pursuant to 4 CSR 240-22.040(3). An estimate of the portion of costs of these upgrades that are allocated to the utility shall be reflected in the analysis of preliminary supply-side candidate resource options; and

Evergy is member of the Southwest Power Pool (SPP), a Regional Transmission Organization (RTO) mandated by the Federal Energy Regulatory Commission to ensure reliable supplies of power, adequate transmission infrastructure, and competitive wholesale prices of electricity. As a member of SPP, Evergy participates in the regional transmission expansion plan processes of the RTO, including requesting firm transmission service through the Aggregate Facility Study (AFS) process, which evaluates the transmission upgrades necessary for delivery of power purchases.

1.23 ASSESSMENT OF TRANSMISSION OR DISTRIBUTION IMPROVEMENTS WITH RESPECT TO COST EFFECTIVENESS OF DSM OR SUPPLY-SIDE RESOURCES

(D) Incorporate advanced transmission and distribution network technologies affecting supply-side resources or demand-side resources. The utility shall assess transmission and distribution improvements that may become available during the planning horizon that facilitate or expand the availability and cost effectiveness of demand-side resources or supply-side resources. The costs and capabilities of these advanced transmission and distribution technologies shall be reflected in the analyses of each resource option.

1.23.1 CAPACITOR AUTOMATION EFFORTS

Evergy is operating its MO West capacitor automation program over a 4G cellular system. Although Evergy has upgraded 48% of its capacitor control fleet, we are constantly reviewing additional controller and capacitor upgrades.

Control upgrades allow for:

- Remote engineering and control
- Enhanced data availability
- Better internal diagnostics

The business case for automated capacitors includes:

- Enhancements considered when upgrading legacy capacitor locations:
 - Voltage Override
 - Neutral Sensing
 - Limiting number of switching operations per day
 - Ability to change setpoints remotely
 - Ability to obtain power quality data for improved customer service
- Enhancement of safety for Evergy workers
 - Five-minute time delay in control for a close after an open
 - One-minute timer for close after faceplate control operation

- Reduction of O&M Costs
 - Limiting number of capacitor patrols due to near real time data
 - Limiting number of customer voltage complaints
 - Potentially extending life of existing capacitor switches
- Improved Distribution and Transmission Power Factor
 - Enhance System Stability
 - Enhance system volt/VAr response
 - Increase system efficiency
- Enabling component in advanced voltage management schemes

1.23.2 VOLTAGE MANAGEMENT PROGRAM

Evergy is working on a territory wide voltage management program under our STP initiative. Although being vetted throughout the STP process, the voltage management program will likely have consideration for the following voltage augmentation schemes:

- Peak Demand Management
- Conservation Voltage Reduction
- Volt-VAR Optimization
- Energy Efficiency

As the review process continues, main components of our evaluation will be as follows:

- Assessment of impact on intelligent grid assets e.g. capacitors, voltage regulators, Load Tap Changers (LTCs), etc...
- Circuit, substation and system voltage management
- Improved process for adjusting intelligent grid asset set points
- Remote control of intelligent grid assets
- Functional and business impact of each voltage management scheme

This project will involve replacing electromechanical and non-communicating intelligent grid devices. These new devices will support standard industry specifications.

SECTION 2: AVOIDED TRANSMISSION AND DISTRIBUTION COST

(2) Avoided Transmission and Distribution Cost. The utility shall develop, describe, and document an avoided transmission capacity cost and an avoided distribution capacity cost. The avoided transmission and distribution capacity costs are components of the avoided demand cost pursuant to 4 CSR 240-22.050(5)(A).

The Evergy transmission projects included in the SPP regional planning processes for reliability improvement or economic benefits would not be impacted by the implementation of DSM (Demand Side Management) programs. Therefore, the only avoided cost for transmission facilities are the transmission equipment additions associated with distribution facility expansions.

2.1 IMPACT OF DSM ON DISTRIBUTION EXPANSION

As in the 2018 IRP submittal, Evergy made assumptions regarding planned system expansion projects in areas that are designated as “growth areas” versus areas designated as “established areas”. Again, targeting was focused on capital projects associated within established areas since targeted DSM programs were unlikely to be able to delay the need to expand substations on the fringe of metro-area growth because these areas contained significant “green space” with large areas that remain undeveloped.

Distribution Planning’s annual review of 15-year load projections revealed the fact that loads for these “established areas” continue to flatten and more commonly, decline, which has eliminated the need for expansion projects in these areas. It seems reasonable that as load growth has fallen off in the established areas, that efficiencies gained by replacing older heating/cooling units, lighting, and other older appliances, would begin to significantly impact peak loads for these areas.

Except for the St. Joseph Downtown area, Evergy Missouri West lacks the type of urban core found within the downtown KC area. This limits the number of substations that can be categorized as being in “established areas”. Combined with modest to flat load growth, and in some cases declining loads, Evergy Missouri West substations located with established areas do not offer the same opportunity for targeted DSM efforts. The few areas that are established either have sufficient capacity available to absorb current growth rates or are in load decline. These areas will continue to be monitored by Distribution Planning to determine if future opportunities for targeted DSM might become available. Should economic conditions improve, and/or significant re-development occurs in these established areas, it seems reasonable that there may be sufficient opportunities to target DSM to avoid/eliminate the cost to expand substation capacities for these areas.

SECTION 3: ANALYSIS OF TRANSMISSION NETWORK PERTAINENT TO A RESOURCE ACQUISITION STRATEGY

(3) Transmission Analysis. The utility shall compile information and perform analyses of the transmission networks pertinent to the selection of a resource acquisition strategy. The utility and the Regional Transmission Organization (RTO) to which it belongs both participate in the process for planning transmission upgrades.

3.1 TRANSMISSION ASSESSMENTS

(A) The utility shall provide, and describe and document, its—

3.1.1 TRANSMISSION ASSESSMENT FOR CONGESTION UPGRADES

1. Assessment of the cost and timing of transmission upgrades to reduce congestion and/or losses, to interconnect generation, to facilitate power purchases and sales, and to otherwise maintain a viable transmission network;

SPP's Integrated Transmission Planning Process (ITP) is an annual planning cycle that assesses near- and long-term economic and reliability transmission needs. The ITP produces a ten-year transmission expansion plan each year, combining near-term, ten-year, and North American Electric Reliability Corporation transmission planning (TPL-001-4) compliance assessments into one study. A 20-year assessment is performed once every five years unless otherwise directed by the SPP Board of Directors. The ITP process seeks to target a reasonable balance between long-term transmission investments and congestion costs to customers.

The 2020 Integrated Transmission Plan looked ahead 10 years to ensure the SPP region could deliver energy reliably and economically, facilitate public policy objectives, seek solutions with neighboring regions and maximize benefits to end-use customers. Three distinct scenarios were considered to account for variations in system conditions over ten years. These scenarios considered requirements to

support firm deliverability of capacity for reliability while exploring rapidly evolving technology that may influence the transmission system and energy industry. The scenarios included varied wind projections, utility-scale and distributed solar, energy storage resources, generation retirements and electric vehicles. Ultimately, the analysis resulted in the approval of a portfolio of 54 transmission projects across the SPP region at a cost of approximately \$532 million. Evergy Missouri West received one transmission project as a result of the 2020 ITP study – a breaker replacement identified in the short circuit portion of the ITP study. The need date for the project is 6/1/2022.

3.1.2 TRANSMISSION ASSESSMENT FOR ADVANCE TECHNOLOGIES

2. Assessment of transmission upgrades to incorporate advanced technologies;

Three distinct scenarios were considered during Southwest Power Pool's 2020 Integrated Transmission Planning process. These scenarios considered requirements to support firm deliverability of capacity for reliability while exploring rapidly evolving technology that may influence the transmission system and energy industry. The scenarios included varied wind projections, utility-scale and distributed solar, energy storage resources, generation retirements and electric vehicles. Transmission upgrades were selected based on their ability to meet the varied needs identified in all scenarios.

Evergy currently uses optical ground wire (OPGW) for most or all of new shield wire installations. This gives not only superior lightning performance, due to the lower resistance of the OPGW compared to conventional galvanized steel strand shield wires, but also provides a high capacity path for internal communications and system protection functions. The standard OPGW options provide either 48 or 72 single mode fibers per shield wire.

3.1.3 AVOIDED TRANSMISSION COST ESTIMATE

3. Estimate of avoided transmission costs; 22.045 Transmission and Distribution Analysis,

The Evergy transmission projects included in the SPP regional planning processes for reliability improvement or economic benefits would not be impacted by the implementation of DSM programs. Therefore, the only avoided cost for transmission facilities are the transmission equipment additions associated with distribution facility expansions.

3.1.4 REGIONAL TRANSMISSION UPGRADE ESTIMATE

4. Estimate of the portion and amount of costs of proposed regional transmission upgrades that would be allocated to the utility, and if such costs may differ due to plans for the construction of facilities by an affiliate of the utility instead of the utility itself, then an estimate, by upgrade, of this cost difference;

Table 4 below shows the SPP projected annual transmission revenue requirement allocated to Evergy for regional transmission upgrades.

Table 4: SPP Projected ATRR Allocated to Evergy Missouri West

Year	Projected Region-Wide Revenue Requirement	Allocated to the EMW Zone	Allocation to the EMW Native System Load
2021	\$548,344,441	\$21,850,747	\$21,463,859
2022	\$552,236,015	\$21,880,948	\$21,493,526
2023	\$514,206,103	\$20,179,199	\$19,821,908
2024	\$502,467,850	\$19,709,312	\$19,360,341
2025	\$487,979,700	\$19,136,760	\$18,797,926
2026	\$472,887,797	\$18,541,669	\$18,213,372
2027	\$457,679,255	\$17,942,222	\$17,624,538
2028	\$442,122,062	\$17,329,759	\$17,022,920
2029	\$426,540,049	\$16,716,370	\$16,420,391

The region-wide revenue requirement includes amounts for projects owned by Transource Missouri. Transource Missouri is a wholly-owned subsidiary of

Transource Energy, LLC, which is a joint venture between Evergy and American Electric Power (“AEP”). GXP owns 13.5 percent of Transource Energy and AEP owns the other 86.5 percent.

3.1.5 REVENUE CREDITS ESTIMATE

5. Estimate of any revenue credits the utility will receive in the future for previously built or planned regional transmission upgrades; and

Table 5: Region-Wide 2021 Revenue Requirements for SPP Projects Owned by Evergy Missouri West

Evergy Missouri West SPP-Directed Projects	2021 Region-Wide Revenue Requirement
Projects with NTCs issued prior to June 19, 2010	
Nevada 2- 69kV Lines & Substation	\$3,495
Craig 69kV Interconnection	\$0
Martin City/Grandview 161kV	\$0
Longview Wavetrapp Project	\$0
Loma Vista-Montrose 161kV	\$44,128
Edmond 161kV Substation	\$52,823
Clinton 161kV/69kV Trfmer	\$14,196
S.Harper 161kV -line Term.	\$33,177
Glenaire JCT of Liberty 69kV	\$20,579
Total	\$168,398
Projects with NTCs issued after June 19, 2010	
St Joe-Series Reactor 161kV	\$2,081
Total	\$2,081
Projects with a Need Date after October 1 ,2015	
Iatan Stranger 345kV Voltage Conversion	\$182,934
Total	\$182,934
Total Evergy Missouri SPP-Directed Projects	\$353,413

3.1.6 TIMING OF NEEDED RESOURCES ESTIMATE

6. Estimate of the timing of needed transmission and distribution resources and any transmission resources being planned by the RTO primarily for economic reasons that may impact the alternative resource plans of the utility.

The SPP 2020 ITP portfolio did not contain any economic projects in the Evergy Missouri West service territory, thus there are no transmission resources planned by the RTO that would impact the alternative resource plans of Evergy.

3.2 USE OF RTO TRANSMISSION EXPANSION PLAN

(B) The utility may use the RTO transmission expansion plan in its consideration of the factors set out in subsection (3)(A) if all of the following conditions are satisfied:

See response to Section 3.1.1 above for description of SPP RTO transmission expansion planning processes.

3.2.1 UTILITY PARTICIPATION IN RTO TRANSMISSION PLAN

1. The utility actively participates in the development of the RTO transmission plan;

Evergy actively participates in the development of SPP transmission expansion plans through a number of related activities. These include participation in the Model Development Working Group (MDWG), the Transmission Working Group (TWG), and regional transmission expansion workshops

Participation in the MDWG involves reviewing and updating the transmission planning models used for regional transmission expansion analysis. This includes adding Evergy transmission projects into the planning models and providing a substation level load forecast for the seasonal and future years planning models. The expected generation dispatch required to meet Evergy load requirements is

also included in these models. These models form the basis for the reliability analysis needed to identify future transmission projects to maintain reliable service and reduce transmission congestion.

The Transmission Working Group (TWG) is responsible for planning criteria to evaluate transmission additions, seasonal Available Transfer Capability (ATC) calculations, seasonal flowgate ratings, oversight of coordinated planning efforts, and oversight of transmission contingency evaluations. The TWG works with individual transmission owners on issues of coordinated planning and North American Electric Reliability Corporation (NERC) and SPP compliance. The TWG coordinates the calculation of the ATC for commerce maintaining regional reliability, while ensuring study procedures and criteria are updated to meet the regional needs of SPP, in cooperation with governing regulatory entities. The TWG is responsible for publication of seasonal and future reliability assessment studies on the transmission system of the SPP region. The TWG works closely with the Economic Studies Working Group (ESWG) to develop the scope documents used to direct the analysis and studies performed for the ITP process.

SPP hosts three to four ITP workshops annually to get stakeholder input to the transmission planning process and provide analysis results for stakeholder review. The workshops allow SPP stakeholders to provide input on assumptions for economic analysis review identified needs and proposed solutions selected by SPP. Evergy proposes projects through SPP's FERC Order No. 1000 process, reviews selected transmission projects in its area and coordinates with SPP regarding details within its area that may affect proposed solutions. In other instances, Evergy offers an operating guide to mitigate a transmission problem and avoid new transmission construction.

3.2.2 ANNUAL REVIEW OF RTO EXPANSION PLANS

2. The utility reviews the RTO transmission overall expansion plans each year to assess whether the RTO transmission expansion plans, in the

judgment of the utility decision makers, are in the interests of the utility's Missouri customers;

Evergy reviews transmission projects in its area, coordinates with SPP regarding details within its area that may affect proposed solutions, or requests restudy for projects that it believes are not required. Evergy planning personnel participate throughout the year within the planning process providing insight and review of the transmission plans. In some instances, Evergy may be able to offer an operating guide to mitigate a transmission problem and avoid or delay new transmission construction. Also, Evergy personnel participate in the overall approval of RTO expansion plans through the SPP approval process within the Markets and Operation Policy Committee and Members Committee.

3.2.3 ANNUAL REVIEW OF SERVICE TERRITORY EXPANSION PLAN

3. The utility reviews the portion of RTO transmission expansion plans each year within its service territory to assess whether the RTO transmission expansion plans pertaining to projects that are partially- or fully-driven by economic considerations (i.e., projects that are not solely or primarily based on reliability considerations), in the judgment of the utility decision-makers, are in the interests of the utility's Missouri customers;

Evergy reviews transmission plans and projects within its service territory that develop through the SPP RTO transmission expansion plan. Many are zonal projects providing additional obligations to serve or meet specific planning and bulk electric reliability criteria.

3.2.4 DOCUMENTATION AND DESCRIPTION OF ANNUAL REVIEW OF RTO OVERALL AND UTILITY-SPECIFIC EXPANSION PLANS

4. The utility documents and describes its review and assessment of the RTO overall and utility-specific transmission expansion plans; and

Evergy reviews transmission projects in its area and coordinates with SPP regarding details within its area that may affect proposed solutions. In other

instances, Evergy may be able to offer an operating guide to mitigate a transmission problem and avoid new transmission construction.

3.2.5 AFFILIATE BUILD TRANSMISSION PROJECT DISCUSSION

5. If any affiliate of the utility intends to build transmission within the utility's service territory where the project(s) are partially- or fully-driven by economic considerations, then the utility shall explain why such affiliate built transmission is in the best interest of the utility's Missouri customers and describe and document the analysis performed by the utility to determine whether such affiliate-built transmission is in the interest of the utility's Missouri customers.

Transource Energy, LLC ("Transource"), a joint venture between Evergy and American Electric Power ("AEP"), was created to build and invest in transmission infrastructure. Transource will pursue competitive transmission projects in the SPP region, the MISO and PJM regions, and potentially other regions in the future. Evergy owns 13.5 percent of Transource and AEP owns the other 86.5 percent of Transource.

At this point, it is Evergy's intent to pursue, develop, construct, and own through its interest in Transource – rather than through Evergy Metro and/or Evergy Missouri West – any future regional and inter-regional transmission projects subject to regional cost allocation. While it is premature to determine the specific impact on the regionally allocated costs resulting from constructing projects within Transource, it is anticipated that the partnership between Evergy and AEP will provide for a financially strong, cost-competitive, and technically proficient transmission development entity. The scale, execution experience, and engineering expertise that Transource expects to be able to bring to the projects should provide benefits to customers through lower construction costs, better access to capital, and operational efficiencies.

3.3 RTO EXPANSION PLAN INFORMATION

(C) The utility shall provide copies of the RTO expansion plans, its assessment of the plans, and any supplemental information developed by the utility to fulfill the requirements in subsection (3)(B) of this rule.

The following SPP regional transmission planning reports are provided as attachments to this report.

2020 SPP Integrated Transmission Planning Assessment Report

2021 SPP Transmission Expansion Plan Report

2021 SPP Transmission Expansion Plan Report Appendix 1

The 2020 SPP Integrated Transmission Planning Assessment is described in Section 3.1.1 above. The 2021 SPP Transmission Expansion Plan (STEP) Report and Project List summarize 2020 activities that impact future development of the SPP transmission grid. Six distinct areas of transmission planning are discussed in this report: Transmission Services, Generation Interconnection, Integrated Transmission Planning, High Priority Studies, Sponsored Upgrades, and Interregional Coordination.

3.4 TRANSMISSION UPGRADES REPORT

(D) The utility shall provide a report for consideration in 4 CSR 240-22.040(3) that identifies the physical transmission upgrades needed to interconnect generation, facilitate power purchases and sales, and otherwise maintain a viable transmission network, including:

3.4.1 TRANSMISSION UPGRADES REPORT – PHYSICAL INTERCONNECTION WITHIN RTO

1. A list of the transmission upgrades needed to physically interconnect a generation source within the RTO footprint;

It is not possible to provide a specific list of transmission upgrades needed to physically interconnect a generation resource within the SPP footprint. Any generation interconnection request within the SPP must proceed through the generation interconnection process as defined by the SPP transmission tariff. That process will examine the specific location proposed for generator interconnection and develop the necessary transmission upgrades needed at that location.

3.4.2 TRANSMISSION UPGRADES REPORT – DELIVERABILITY ENHANCEMENT WITHIN RTO

2. A list of the transmission upgrades needed to enhance deliverability from a point of delivery within the RTO including requirements for firm transmission service from the point of delivery to the utility's load and requirements for financial transmission rights from a point of delivery within the RTO to the utility's load;

In the SPP, requests for firm transmission service are processed through the Aggregate Facility Study (AFS) process. The AFS process is performed two times per year by collectively analyzing specific transmission service requests, including those associated with generation interconnection requests, across the entire SPP footprint. These service reservations are modeled based on control area to control area transfers. The transmission system is assessed with these potential service requests and, where needed, transmission improvements are identified that would enable the service to occur without standard or criteria violations. All transmission customers are allocated cost responsibility for portions of the various upgrades needed to deliver all of the transmission service requests. Transmission customers may adjust their conditions following the posting of the preliminary results if their initial conditions were not met; otherwise, the request will be considered withdrawn. This is an iterative process until all conditions are met. The remaining transmission customers with service requests in the process agree to the projects needed to deliver the remaining transmission service and share the

resulting upgrade costs. Those remaining upgrade projects are included in the next SPP transmission expansion plan process.

Because of the iterative nature of the Aggregate Facility Study process it is not possible to identify specific transmission upgrades needed to deliver energy from a resource in the RTO footprint to Evergy until the process for a specific transmission service request has been completed.

3.4.3 TRANSMISSION UPGRADES REPORT – PHYSICAL INTERCONNECTION OUTSIDE RTO

3. A list of transmission upgrades needed to physically interconnect a generation source located outside the RTO footprint;

It is not possible to develop a list of specific upgrades needed to interconnect a generation resource located outside the SPP without actually making a generation interconnection request at a specific location.

3.4.4 TRANSMISSION UPGRADES REPORT – DELIVERABILITY ENHANCEMENT OUTSIDE RTO

4. A list of the transmission upgrades needed to enhance deliverability from a generator located outside the RTO including requirements for firm transmission service to a point of delivery within the RTO footprint and requirements for financial transmission rights to a point of delivery within the RTO footprint;

It is not possible to develop a list of specific upgrades needed to deliver capacity and energy from a generation resource located outside the SPP without actually making a generation interconnection request and an associated transmission service request at a specific location.

3.4.5 TRANSMISSION UPGRADES REPORT – ESTIMATE OF TOTAL COST

5. The estimated total cost of each transmission upgrade; and

A list of Evergy Missouri West transmission projects included in the 2021 SPP Transmission Expansion Plan (STEP) is shown below in Table 6.

Table 6: Evergy Missouri West Transmission Projects 2021 SPP STEP

Transmission Project	Cost Estimate	Project Type	Need Date
Install new 345/161 transformer at Maryville.	\$12,600,000	ITP20	1/1/2033
Replace 2 breakers at the Lake Road 161 kV station with a 30 kA breakers	\$1,132,970	Regional Reliability	6/1/2022

The total estimated construction cost for these transmission upgrades is \$13,732,970. However, SPP has not yet issued a Notification to Construct, which directs project owners to begin construction on specific projects, for the first project listed.

3.4.6 TRANSMISSION UPGRADES REPORT – COST ESTIMATES

6. The estimated fraction of the total cost and amount of each transmission upgrade allocated to the utility.

A list of Evergy Missouri West transmission projects included in the 2021 SPP STEP and the portion of their estimated cost allocated to Evergy Missouri West is shown below in Table 7.

Table 7: Transmission Upgrade Costs Allocated to Evergy Missouri West

Transmission Project	Cost Estimate	% Allocated to Evergy Missouri West	Evergy Missouri West \$
Install new 345/161 transformer at Maryville.	\$12,600,000	67.4%	\$8,492,400
Replace 2 breakers at the Lake Road 161 kV station with a 30 kA breakers	\$1,132,970	67.4%	\$763,621

SECTION 4: ADVANCED TECHNOLOGY ANALYSIS

(4) Analysis Required for Transmission and Distribution Network Investments to Incorporate Advanced Technologies.

4.1 TRANSMISSION UPGRADES FOR ADVANCED TRANSMISSION TECHNOLOGIES

(A) The utility shall develop, and describe and document, plans for transmission upgrades to incorporate advanced transmission technologies as necessary to optimize the investment in the advanced technologies for transmission facilities owned by the utility. The utility may use the RTO transmission expansion plan in its consideration of advanced transmission technologies if all of the conditions in paragraphs (3)(B)1. Through (3)(B)3. are satisfied.

Evergy will use advanced technologies such as Hybrid Structure Design, Solid Dielectric Cables, and Fiber Optic Shield Wire where applicable in transmission upgrades included in the SPP regional transmission expansion plan.

4.2 DISTRIBUTION UPGRADES FOR ADVANCED DISTRIBUTION TECHNOLOGIES

(B) The utility shall develop, and describe and document, plans for distribution network upgrades as necessary to optimize its investment in advanced distribution technologies.

The STP includes a grid modernization program to invest in technology supporting advancement in distribution operation. The STP focuses on expanding automated grid operation through schemes like FLISR (Fault Location Isolation and Supply Restoration), VVO (Volt-VAR Optimization) and FLA (Fault Location Analysis) under our ADMX program. ADMX is an Evergy branded, architecture-based approach to ADMS that will capitalize on innovation, flexibility and adaptability.

ADMX's key benefit is the ability to execute each automated grid operation mode as makes sense for our business and asset deployment.

4.3 OPTIMIZATION OF INVESTMENT IN ADVANCED TRANSMISSION AND DISTRIBUTION TECHNOLOGIES

(C) The utility shall describe and document its optimization of investment in advanced transmission and distribution technologies based on an analysis of—

4.3.1 OPTIMIZATION OF INVESTMENT – TOTAL COSTS AND BENEFITS

1. Total costs and benefits, including:

4.3.1.1 Distribution Analysis

Evergy has not yet performed a comprehensive analysis to optimize investments in advanced distribution technologies.

Under the STP, Evergy will be completing an analysis on each ADMX module. The analysis will consider upfront and ongoing costs, licensing requirements, required field installations and overall system performance to support our STP operational goals.

In addition to the analysis completed under STP, certain voltage management schemes like peak demand management, will be modeled in Evergy's IRP process.

Each of the technologies are assessed for cost/benefit vs. alternative investments on an as needed basis. Many grid automation applications, intelligent grid assets and newer technologies are initially tested through a pilot project before wide-scale deployment. Pilots are prudent in order to verify correct operation and maintain an environment that is flexible.

4.3.2 OPTIMIZATION OF INVESTMENT – COST OF ADVANCED GRID INVESTMENTS

A. Costs of the advanced grid investments;

4.3.2.1 Distribution

Refer to comments in Section 4.3.1.1

4.3.3 OPTIMIZATION OF INVESTMENT – COST OF NON-ADVANCED GRID INVESTMENTS

B. Costs of the non-advanced grid investments;

4.3.3.1 Distribution

Refer to comments in Section 4.3.1.1

4.3.4 OPTIMIZATION OF INVESTMENT – REDUCTION OF RESOURCE COSTS

C. Reduced resource costs through enhanced demand response resources and enhanced integration of customer-owned generation resources; and

4.3.4.1 Distribution

Refer to comments in Section 4.3.1.1

4.3.5 OPTIMIZATION OF INVESTMENT – REDUCTION OF SUPPLY-SIDE COSTS

D. Reduced supply-side production costs;

4.3.5.1 Distribution

Refer to comments in Section 4.3.1.1

4.4 COST EFFECTIVENESS OF INVESTMENT IN ADVANCED TRANSMISSION AND DISTRIBUTION TECHNOLOGIES

2. Cost effectiveness, including

4.4.1 COST EFFECTIVENESS – INCREMENTAL COSTS ADVANCED GRID TECHNOLOGIES VS NON-ADVANCED GRID TECHNOLOGIES

A. The monetary values of all incremental costs of the energy resources and delivery system based on advanced grid technologies relative to the costs of the energy resources and delivery system based on non-advanced grid technologies;

4.4.1.1 Distribution

Refer to comments in Section 4.3.1.1

4.4.2 COST EFFECTIVENESS – INCREMENTAL BENEFITS ADVANCED GRID TECHNOLOGIES VS NON-ADVANCED GRID TECHNOLOGIES

B. The monetary values of all incremental benefits of the energy resources and delivery system based on advanced grid technologies relative to the costs and benefits of the energy resources and delivery system based on non-advanced grid technologies; and

4.4.2.1 Distribution

Refer to comments in Section 4.3.1.1

4.4.3 OPTIMIZATION OF INVESTMENT – NON-MONETARY FACTORS

C. Additional non-monetary factors considered by the utility;

4.4.3.1 Distribution

Refer to comments in Section 4.3.1.1

4.4.4 OPTIMIZATION OF INVESTMENT – SOCIETAL BENEFIT

3. Societal benefit, including:

4.4.4.1 Societal Benefit – Consumer Choice

A. More consumer power choices;

4.4.4.1.1 Distribution

Refer to comments in Section 4.3.1.1

4.4.4.2 Societal Benefit – Existing Resource Improvement

B. Improved utilization of existing resources;

4.4.4.2.1 Distribution

Refer to comments in Section 4.3.1.1

4.4.4.3 Societal Benefit – Price Signal Cost Reduction

C. Opportunity to reduce cost in response to price signals;

4.4.4.3.1 Distribution

Refer to comments in Section 4.3.1.1

4.4.4.4 Societal Benefit –

D. Opportunity to reduce environmental impact in response to environmental signals; Environmental Impact

4.4.4.4.1 Distribution

Refer to comments in Section 4.3.1.1

4.4.5 OPTIMIZATION OF INVESTMENT – OTHER UTILITY-IDENTIFIED FACTORS

4. Any other factors identified by the utility; and

4.4.5.1.1 Distribution

Refer to comments in Section 4.3.1.1

4.4.6 OPTIMIZATION OF INVESTMENT –OTHER NON-UTILITY IDENTIFIED FACTORS

5. Any other factors identified in the special contemporary issues process pursuant to 4 CSR 240-22.080(4) or the stakeholder group process pursuant to 4 CSR 240-22.080(5).

4.4.6.1.1 Distribution

Refer to comments in Section 4.3.1.1

4.5 NON-ADVANCED TRANSMISSION AND DISTRIBUTION INCLUSION

(D) Before the utility includes non-advanced transmission and distribution grid technologies in its triennial compliance filing or annual update filing, the utility shall—

4.5.1 NON-ADVANCED TRANSMISSION AND DISTRIBUTION REQUIRED ANALYSIS

1. Conduct an analysis which demonstrates that investment in each non-advanced transmission and distribution upgrade is more beneficial to consumers than an investment in the equivalent upgrade incorporating advanced grid technologies. The utility may rely on a generic analysis as long as it verifies its applicability; and

4.5.1.1 Distribution

Eversource is not proposing any new non-advanced distribution grid technologies or programs in this triennial IRP compliance filing.

Eversource understands that prior to including new non-advanced distribution grid technologies in future IRP filings, Eversource will conduct, describe, and document an analysis which demonstrates that investment in each non-advanced distribution upgrade is more beneficial to consumers than an investment in the equivalent upgrade incorporating advanced grid

technologies. Evergy further understands that we may present a generic analysis as long as we verify its applicability.

4.5.2 NON-ADVANCED TRANSMISSION AND DISTRIBUTION ANALYSIS DOCUMENTATION

2. Describe and document the analysis.

4.5.2.1 Distribution

Refer to comments in Section 4.5.1.1

4.6 ADVANCED TRANSMISSION AND DISTRIBUTION REQUIRED COST-BENEFIT ANALYSIS

(E) The utility shall develop, describe, and document the utility's cost benefit analysis and implementation of advanced grid technologies to include:

4.6.1.1 Distribution

Under the STP, Evergy will be completing an analysis on each ADMX module. The analysis will consider upfront and ongoing costs, licensing requirements, required field installations and overall system performance to support our STP operational goals.

In addition to the analysis completed under STP, certain voltage management schemes like peak demand management, will be modeled in Evergy's IRP process.

Each of the technologies are assessed for cost/benefit vs. alternative investments on an as needed basis. Many grid automation applications, intelligent grid assets and newer technologies are initially tested through a pilot project before wide-scale deployment. Pilots are prudent in order to verify correct operation and maintain an environment that is flexible.

4.6.2 ADVANCED GRID TECHNOLOGIES UTILITY'S EFFORTS DESCRIPTION

1. A description of the utility's efforts at incorporating advanced grid technologies into its transmission and distribution networks;

4.6.2.1 Distribution

Historical Advanced Grid Technology Deployments

The distribution grid in place at Evergy today is substantially “smart” having benefited from decades of power engineering expertise and adoption of relevant technology enhancements. The existing systems already execute a variety of sophisticated system operations and protection functions. Much of the automation has been accomplished through embedding incremental technological advancements into Evergy's asset and construction standards. The following sections describe many of the advanced distribution technologies that have and are currently being implemented at Evergy.

Evergy SmartGrid Demonstration Project

Evergy's SmartGrid Demonstration Project deployed an end-to-end SmartGrid (within Kansas City, MO) that provided a wide array of technologies and components. These were grouped into five (5) major sectors: Smart Distribution, Smart Metering, Interoperability and Security, Smart End-Use and Smart Generation. The DOE portion of the project was completed in 2015, with decommissioning of immature technologies through mid-2016. The final report was filed with the DOE in 2016. Please reference [Evergy Smart Grid Project](#) for additional details.

2. A description of the impact of the implementation of distribution advanced grid technologies on the selection of a resource acquisition strategy; and

Evergy will be taking steps under STP to implement various modules under our ADMX plan. The main near-term focuses are on automated switching and voltage

management schemes. These schemes will execute automation engines like Fault Location Isolation and Supply Restoration (FLISR) and peak demand management. In addition to these automation engines, upgraded SCADA applications will be implemented to coincide with the automation schemes enabling components of advanced grid technologies.

Complete project timelines are still being developed in coordination with our RFP process with FLISR and peak demand management schemes tentatively scheduled to be in moderately rolled out in late 2023.

SECTION 5: UTILITY AFFILIATION

(5) The electric utility shall identify and describe any affiliate or other relationship with transmission planning, designing, engineering, building, and/or construction management companies that impact or may be impacted by the electric utility. Any description and documentation requirements in sections (1) through (4) also apply to any affiliate transmission planning, designing, engineering, building, and/or construction management company or other transmission planning, designing, engineering, building, and/or construction management company currently participating in transmission works or transmission projects for and/or with the electric utility.

Transource Energy, LLC (“Transource”), a joint venture between Evergy and American Electric Power (“AEP”), was created to build and invest in transmission infrastructure. Transource will pursue competitive transmission projects in the SPP region, the MISO and PJM regions, and potentially other regions in the future. Evergy owns 13.5 percent of Transource and AEP owns the other 86.5 percent of Transource.

At this point, it is Evergy’s intent to pursue, develop, construct, and own through its interest in Transource – rather than through Evergy Metro and/or Evergy Missouri West – any future regional and inter-regional transmission projects

subject to regional cost allocation. While it is premature to determine the specific impact on the regionally allocated costs resulting from constructing projects within Transource, it is anticipated that the partnership between Evergy and AEP will provide for a financially-strong, cost-competitive, and technically-proficient transmission development entity. The scale, execution experience, and engineering expertise that Transource expects to be able to bring to the projects should provide benefits to customers through lower construction costs, better access to capital, and operational efficiencies.

SECTION 6: FUTURE TRANSMISSION PROJECTS

(6) The electric utility shall identify and describe any transmission projects under consideration by an RTO for the electric utility's service territory.

SPP is scheduled to complete another ITP assessment in 2021, but projects are not yet under consideration.