




ANCHOR TOWER

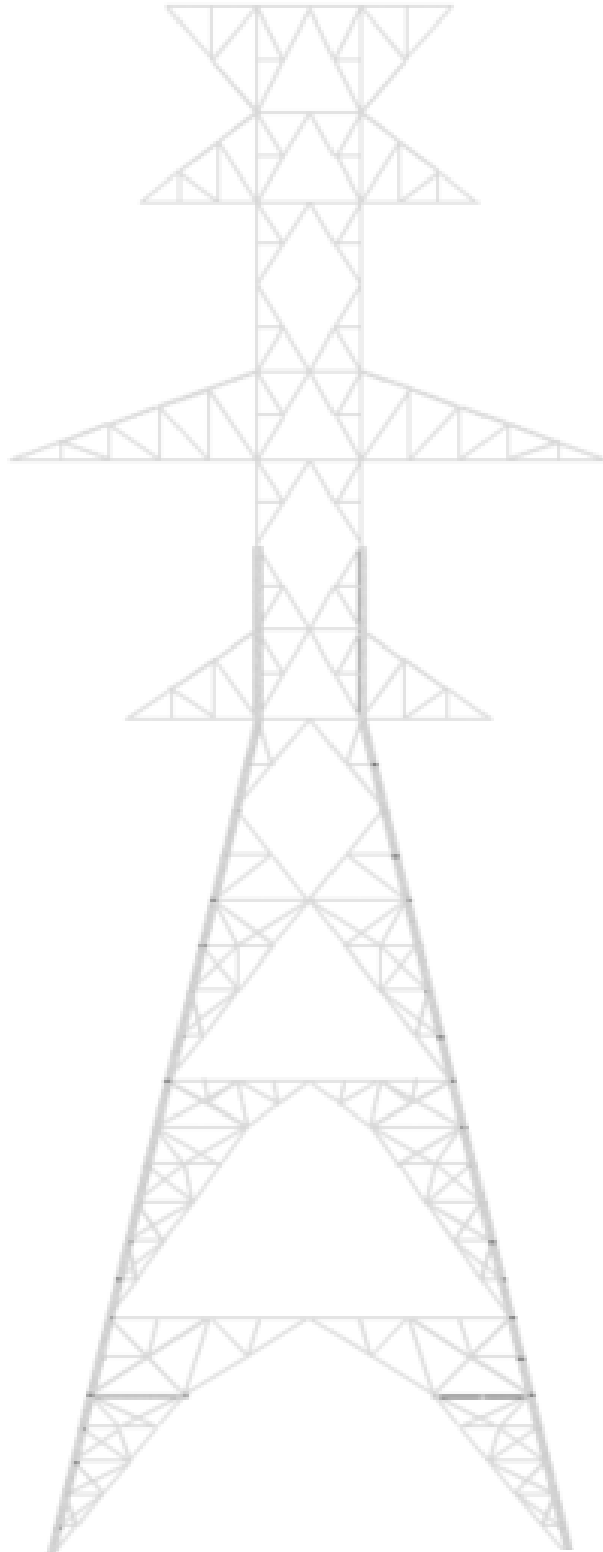


TANGENT TOWER

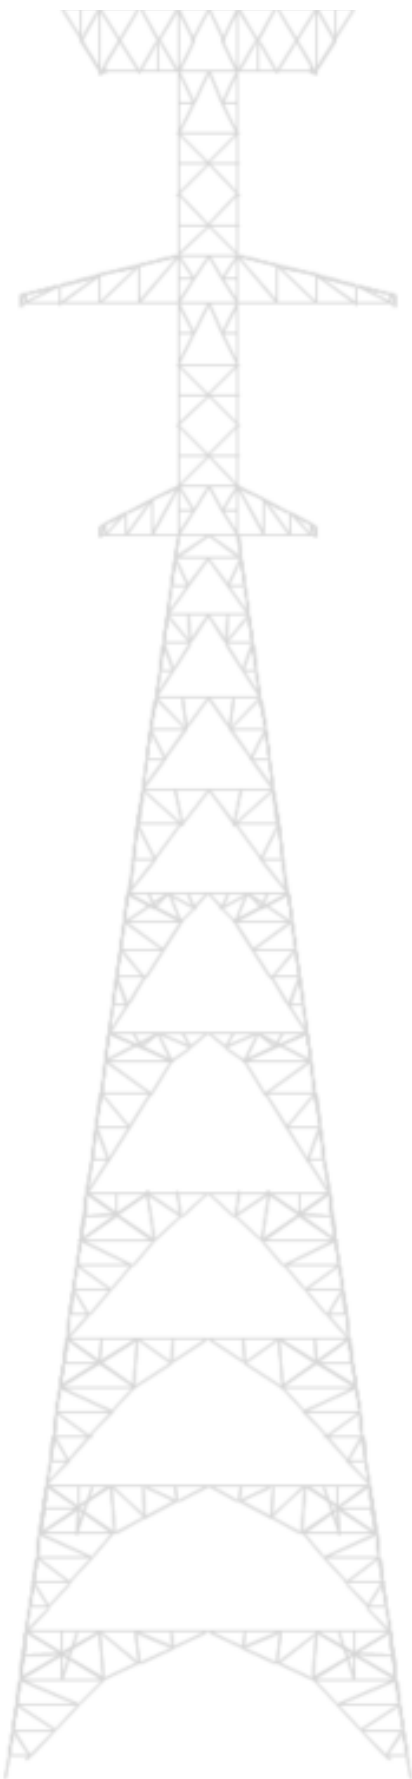


138kV SINGLE CIRCUIT TANGENT MONOPOLE TO BE INSTALLED (FALL 2028)

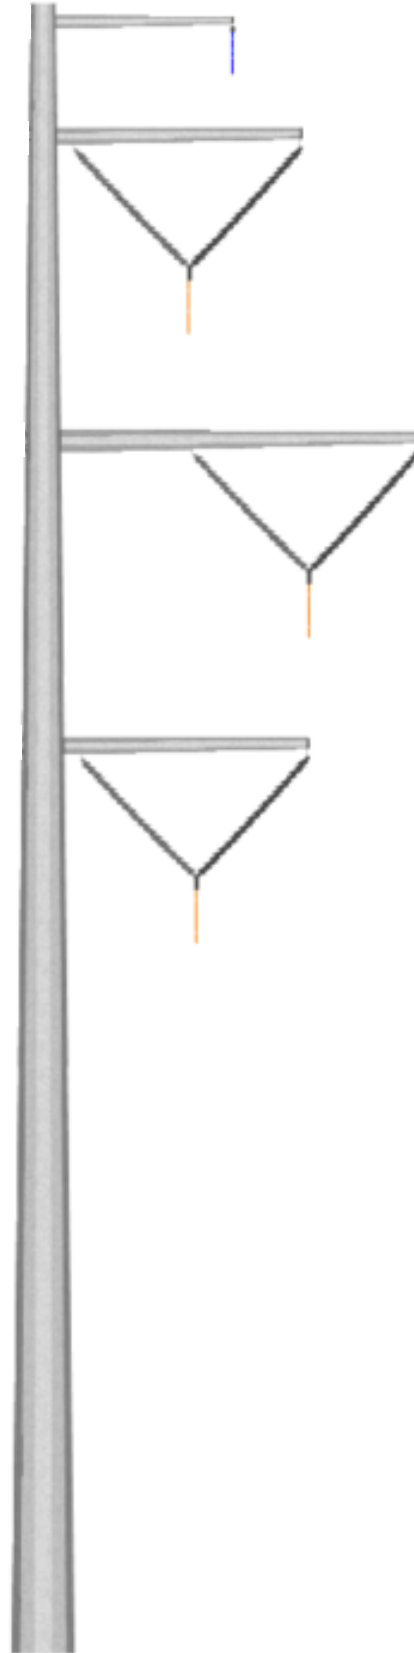


345kV/138kV FUTURE DOUBLE CIRCUIT TANGENT MONOPOLE

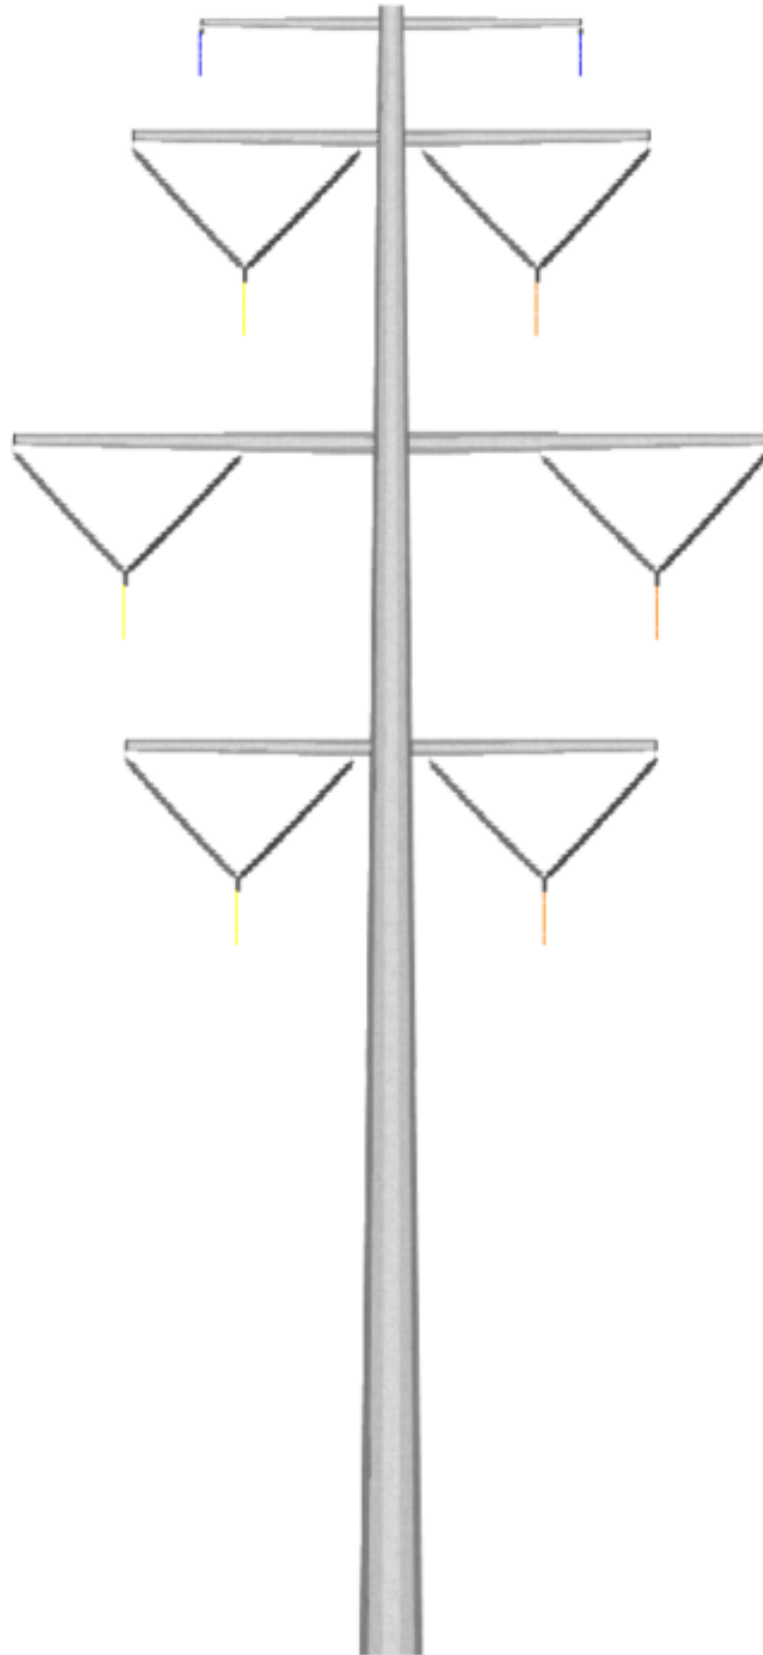


138kV SINGLE CIRCUIT RUNNING ANGLE MONOPOLE TO BE INSTALLED (FALL 2028)

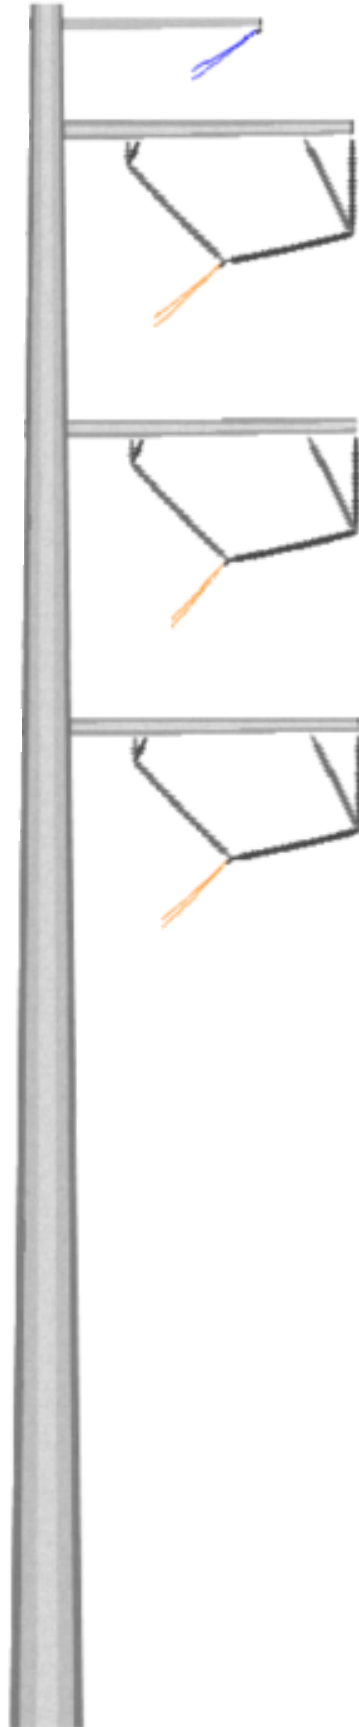

345kV/138kV FUTURE DOUBLE CIRCUIT RUNNING ANGLE MONOPOLE

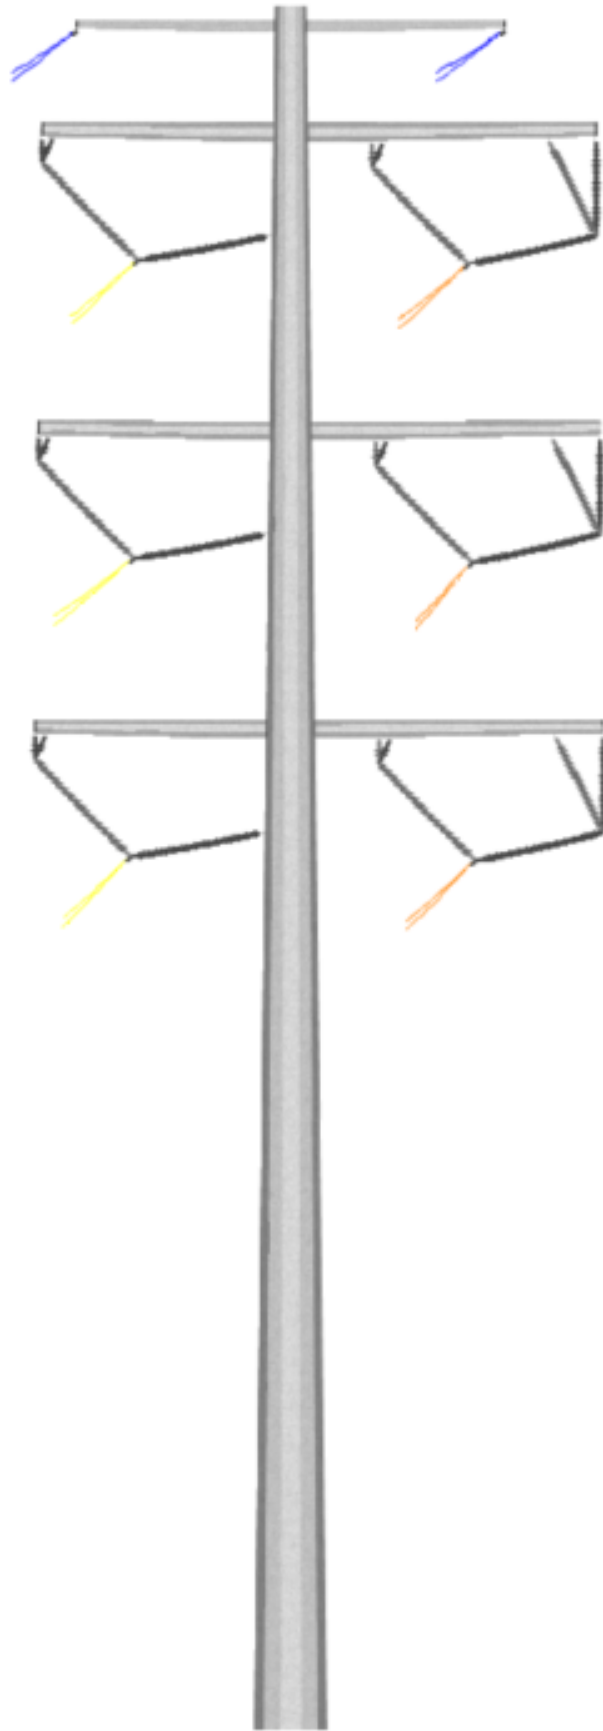

138kV SINGLE CIRCUIT DEAD-END MONOPOLE TO BE INSTALLED (FALL 2028)

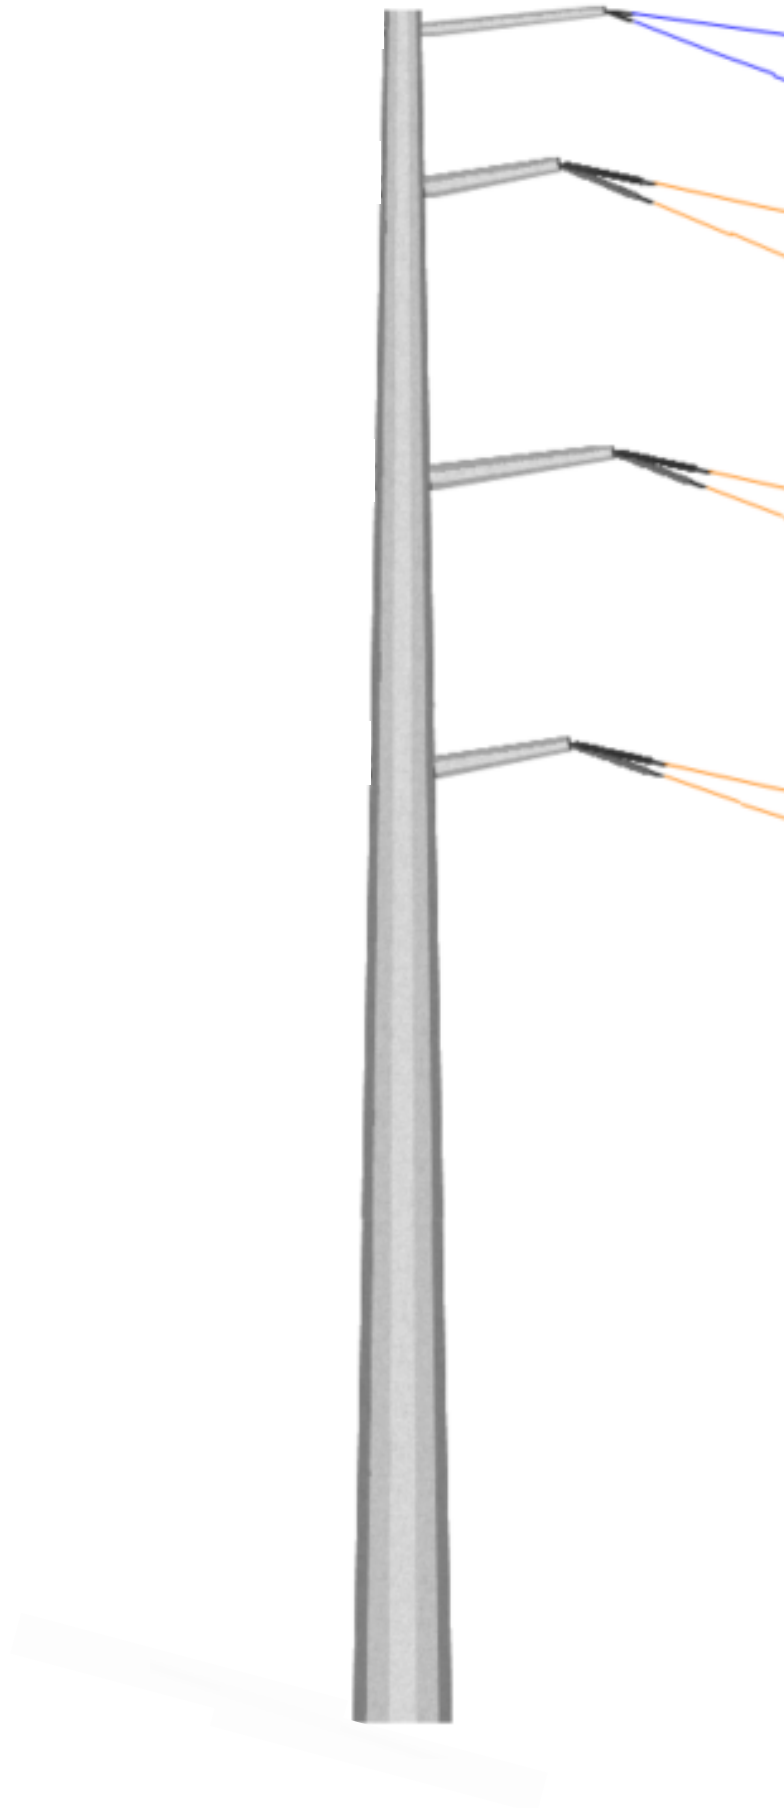

345kV/138kV FUTURE DOUBLE CIRCUIT DEAD-END MONOPOLE

