

Aquila Networks - LP System
Load Factor = 52%

FILED²

DEC 07 2005

Missouri Public
Service Commission



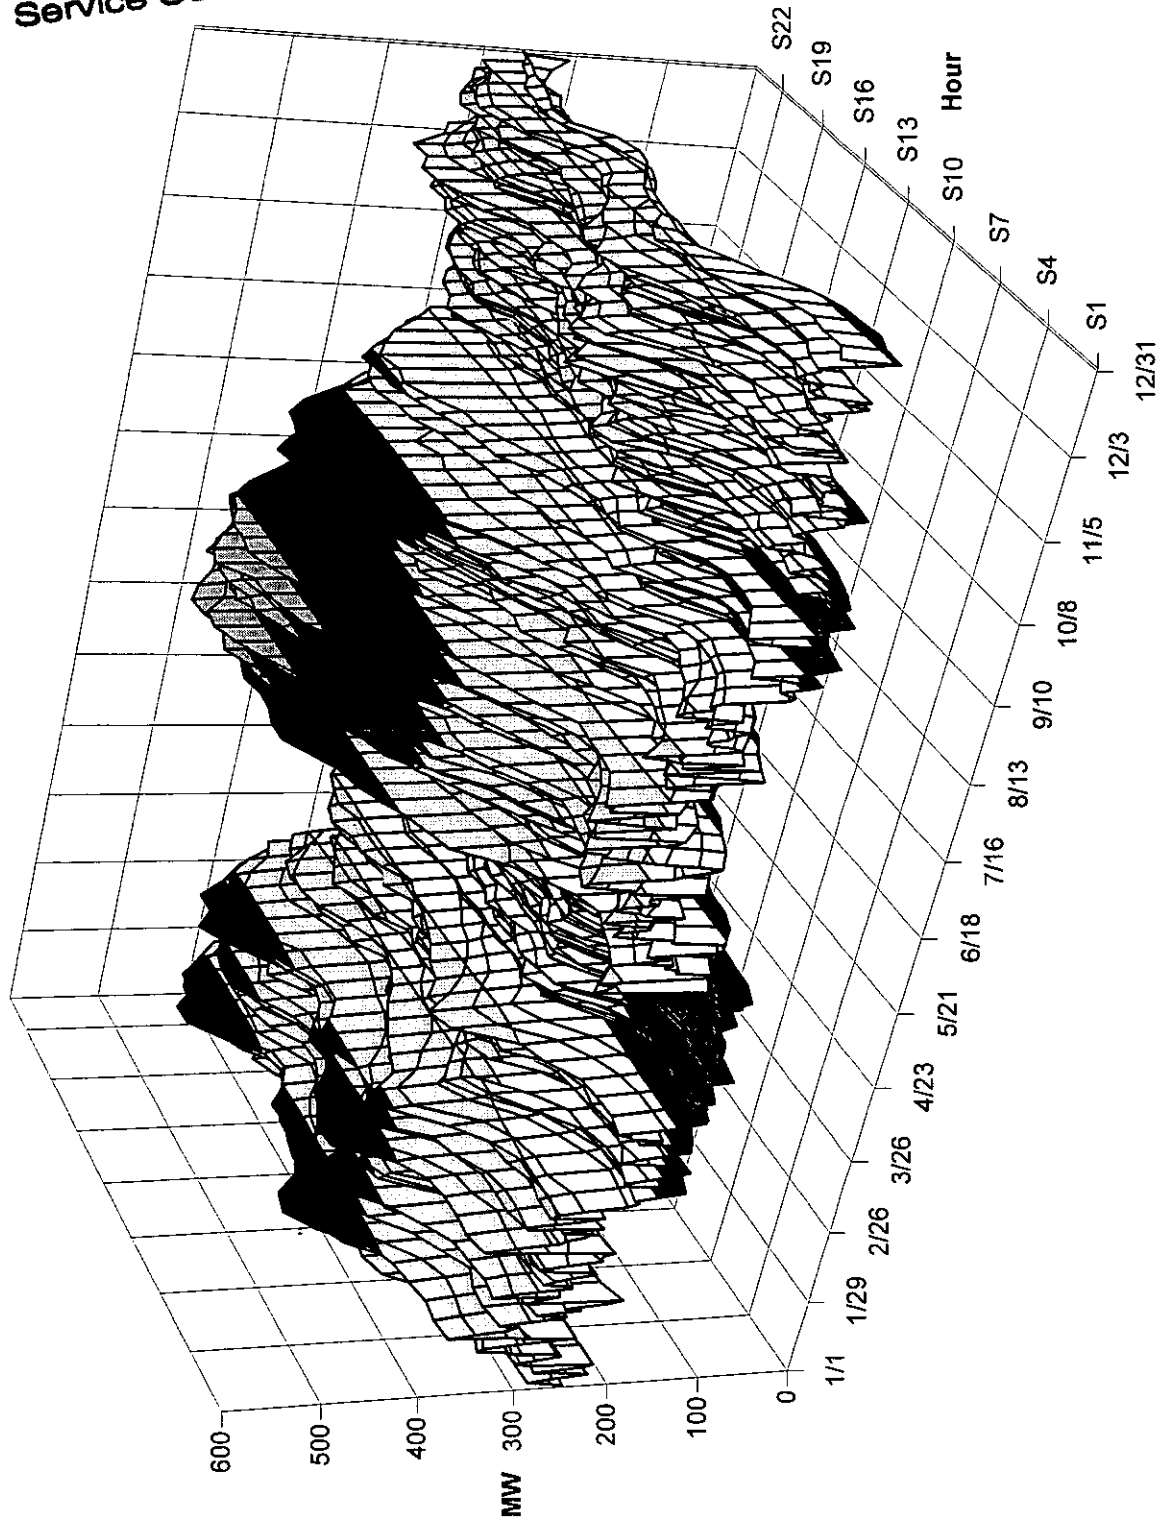



Exhibit No. 34
Case No(s) EO-2002-384
Date 11/08/05 Rptr KF

Aquila Networks - LP Residential General Use
Load Factor = 32%


Docket No. EO-2002-384

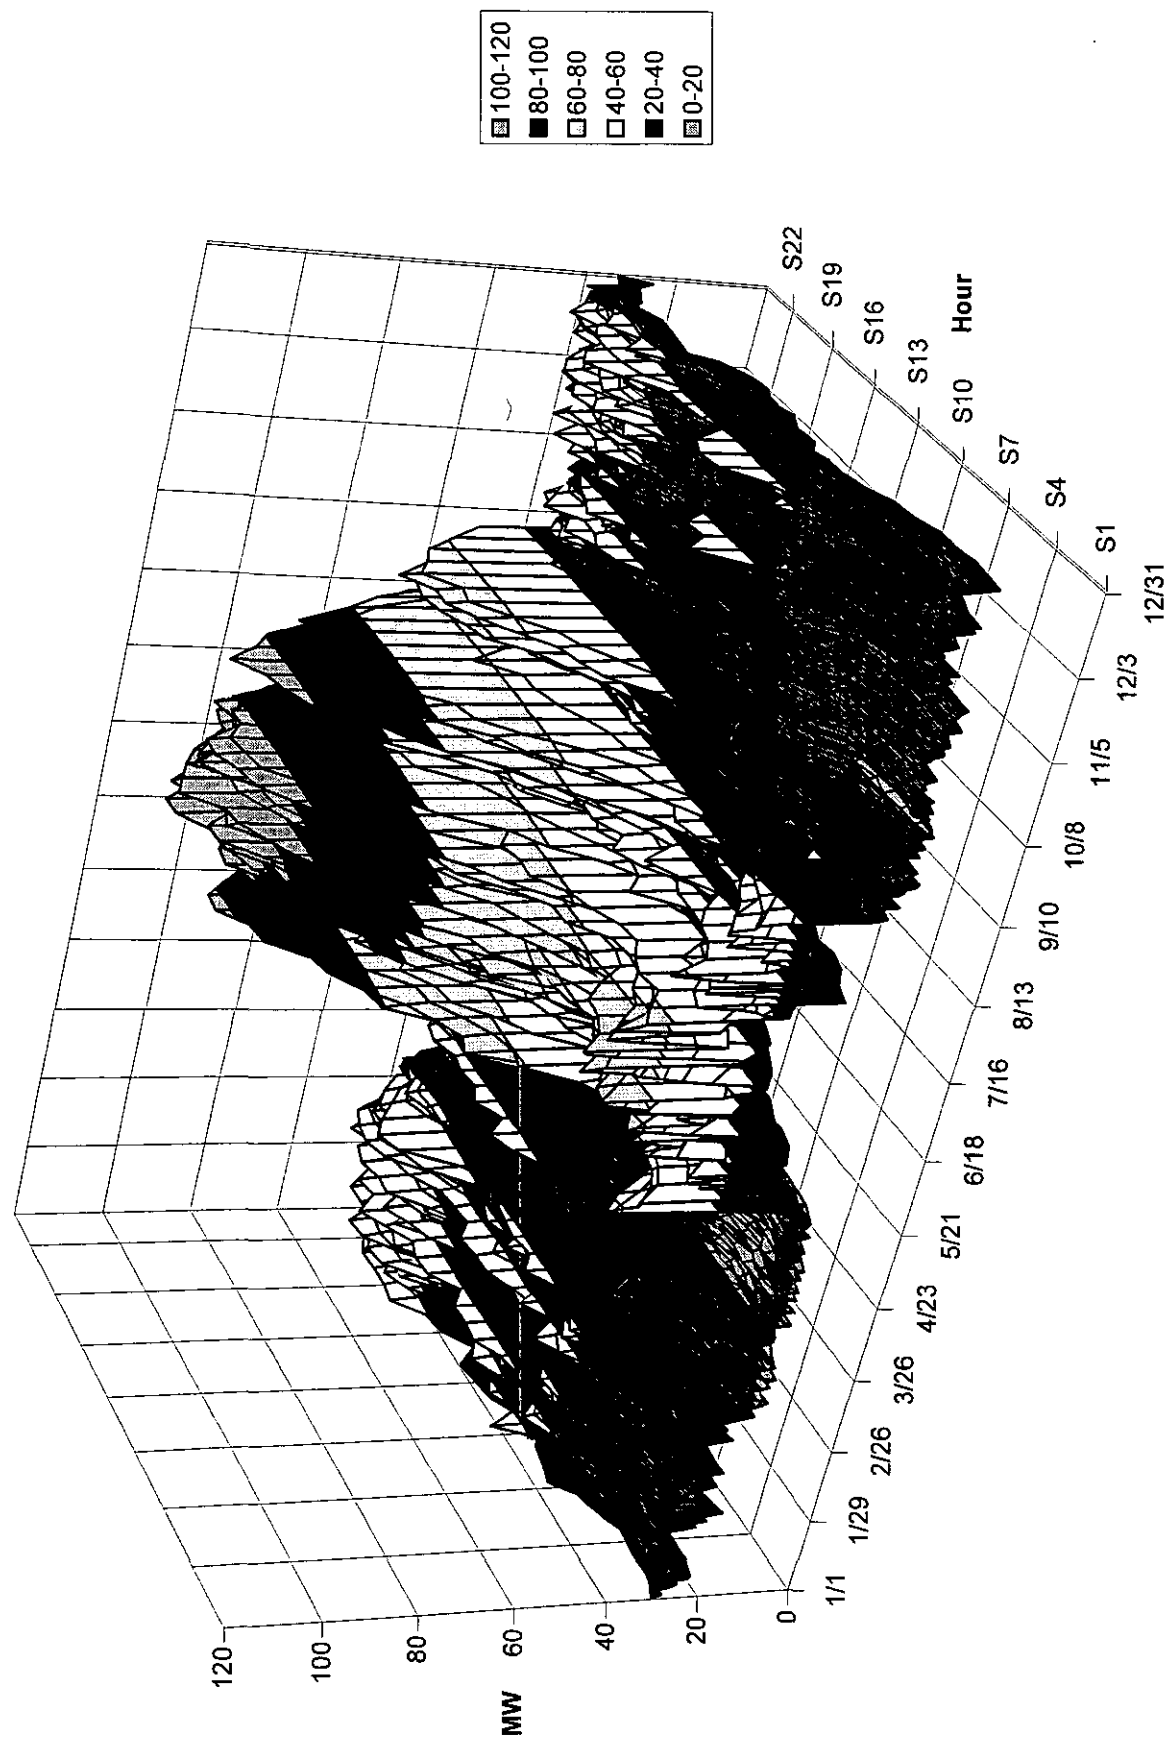


Aquila Networks - LP Residential Water Heat
Load Factor = 38%

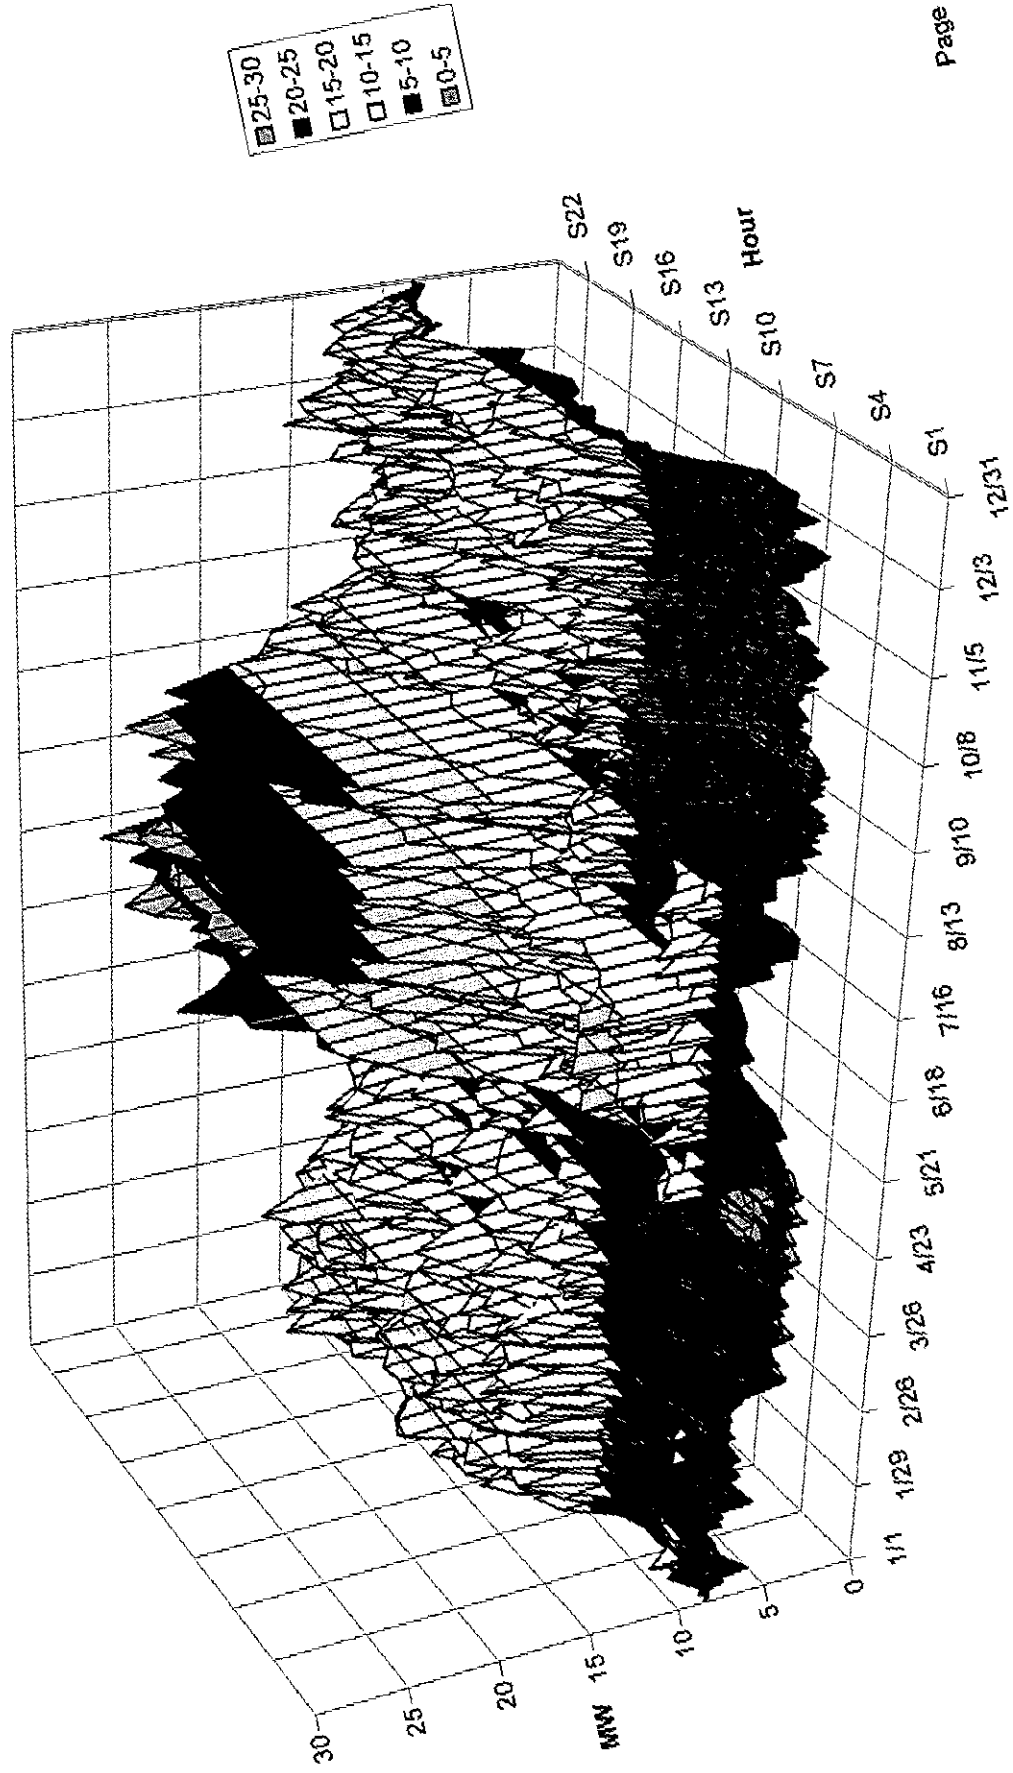


Aquila Networks - LP Residential Space Heat
Load Factor = 33% (LF on Summer Max. Demand = 68%)

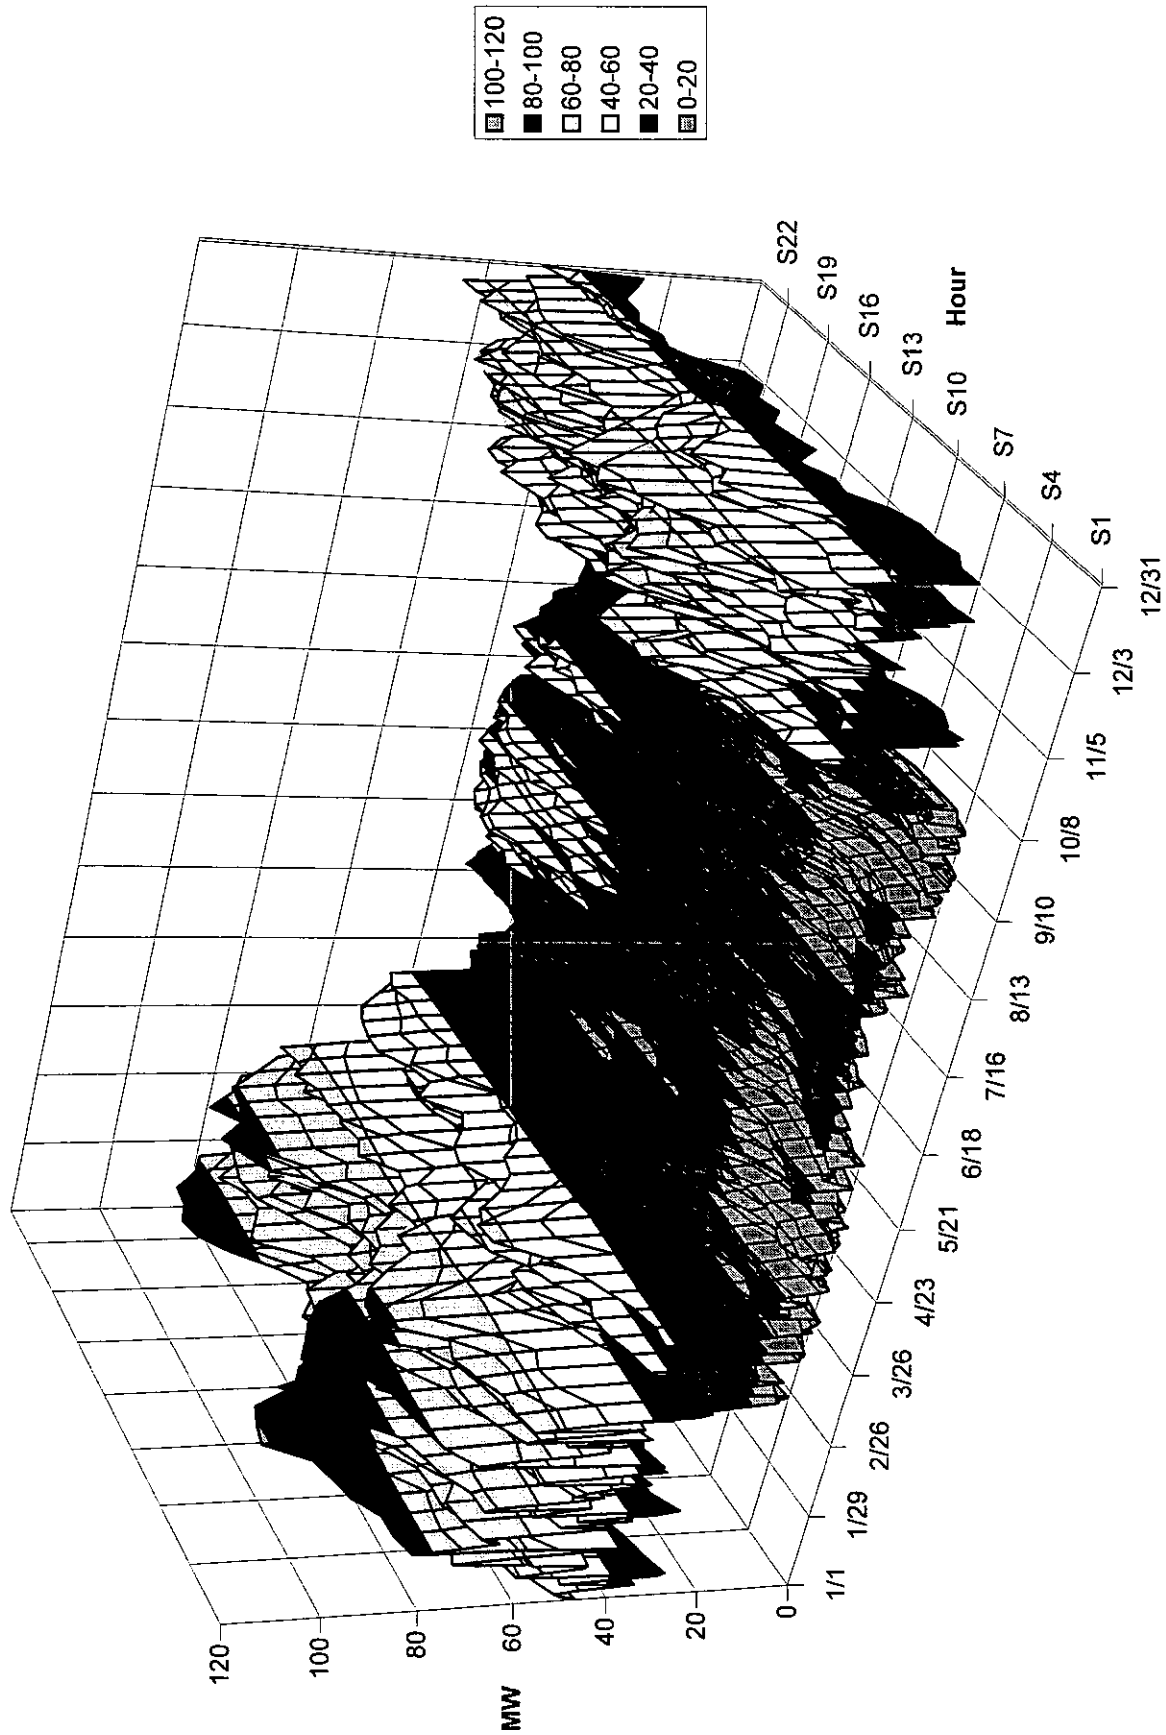


Aquila Networks - LP Small General Service
Load Factor = 44%

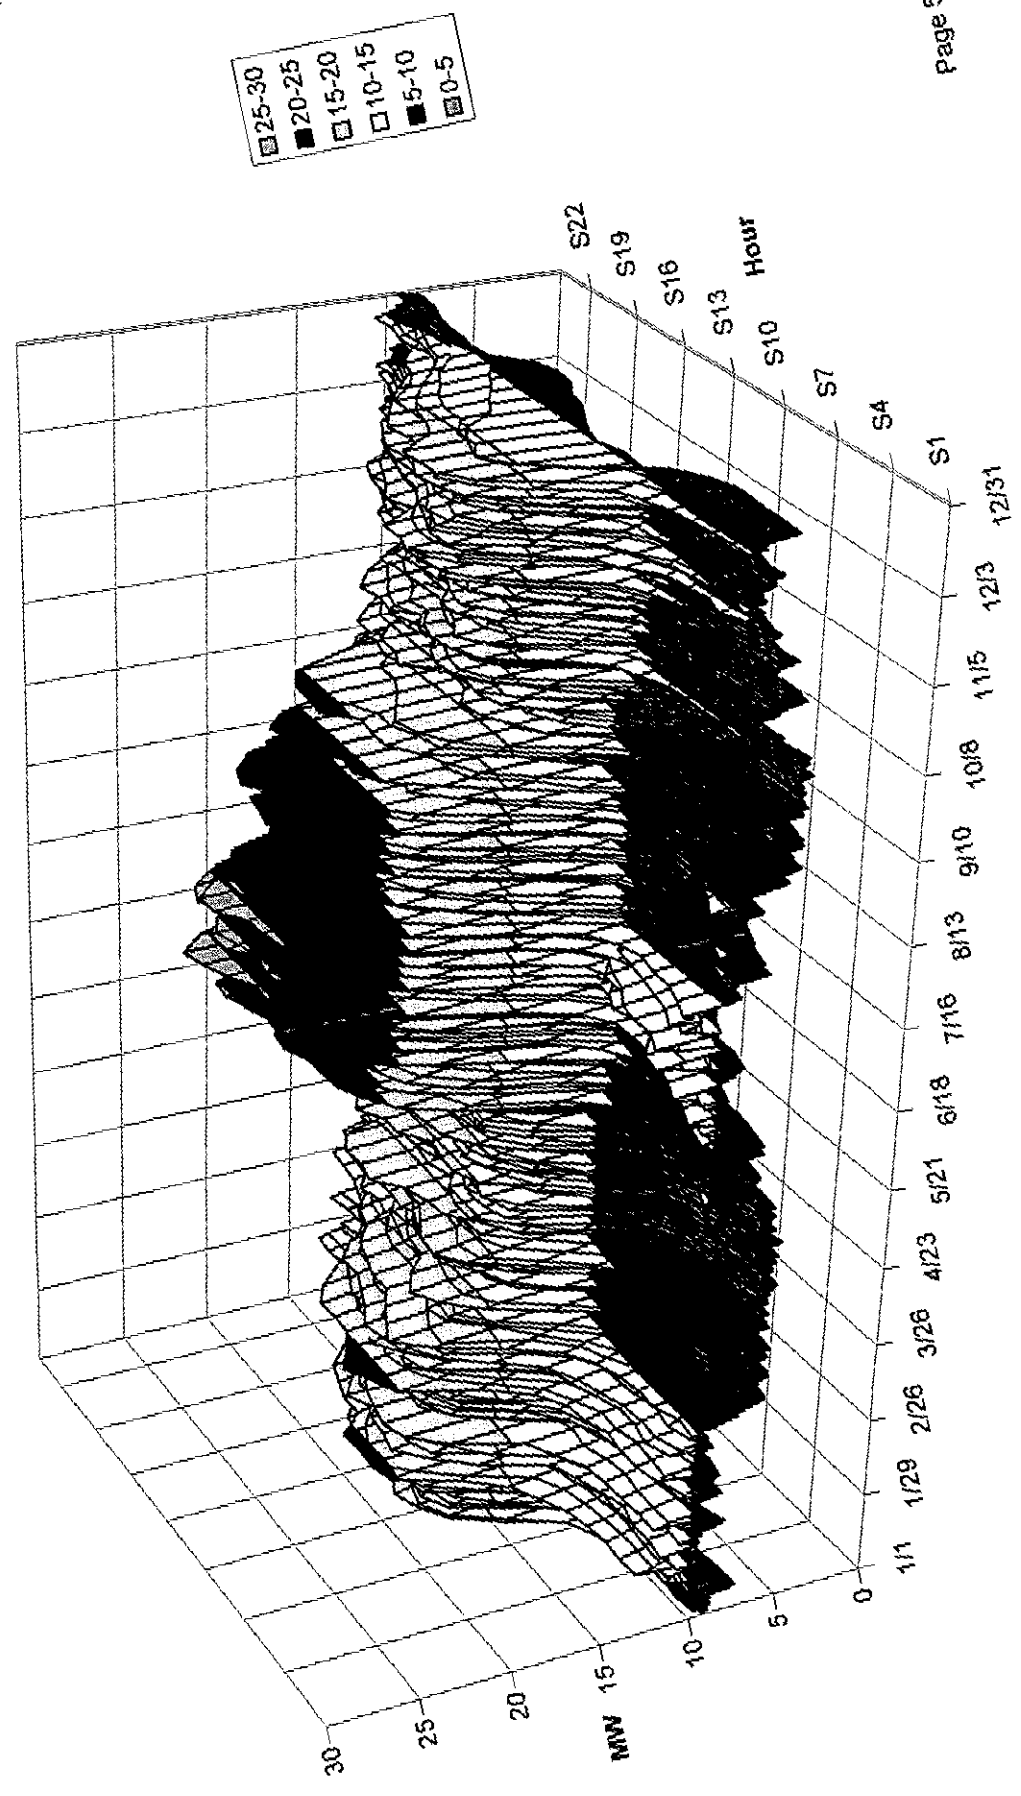

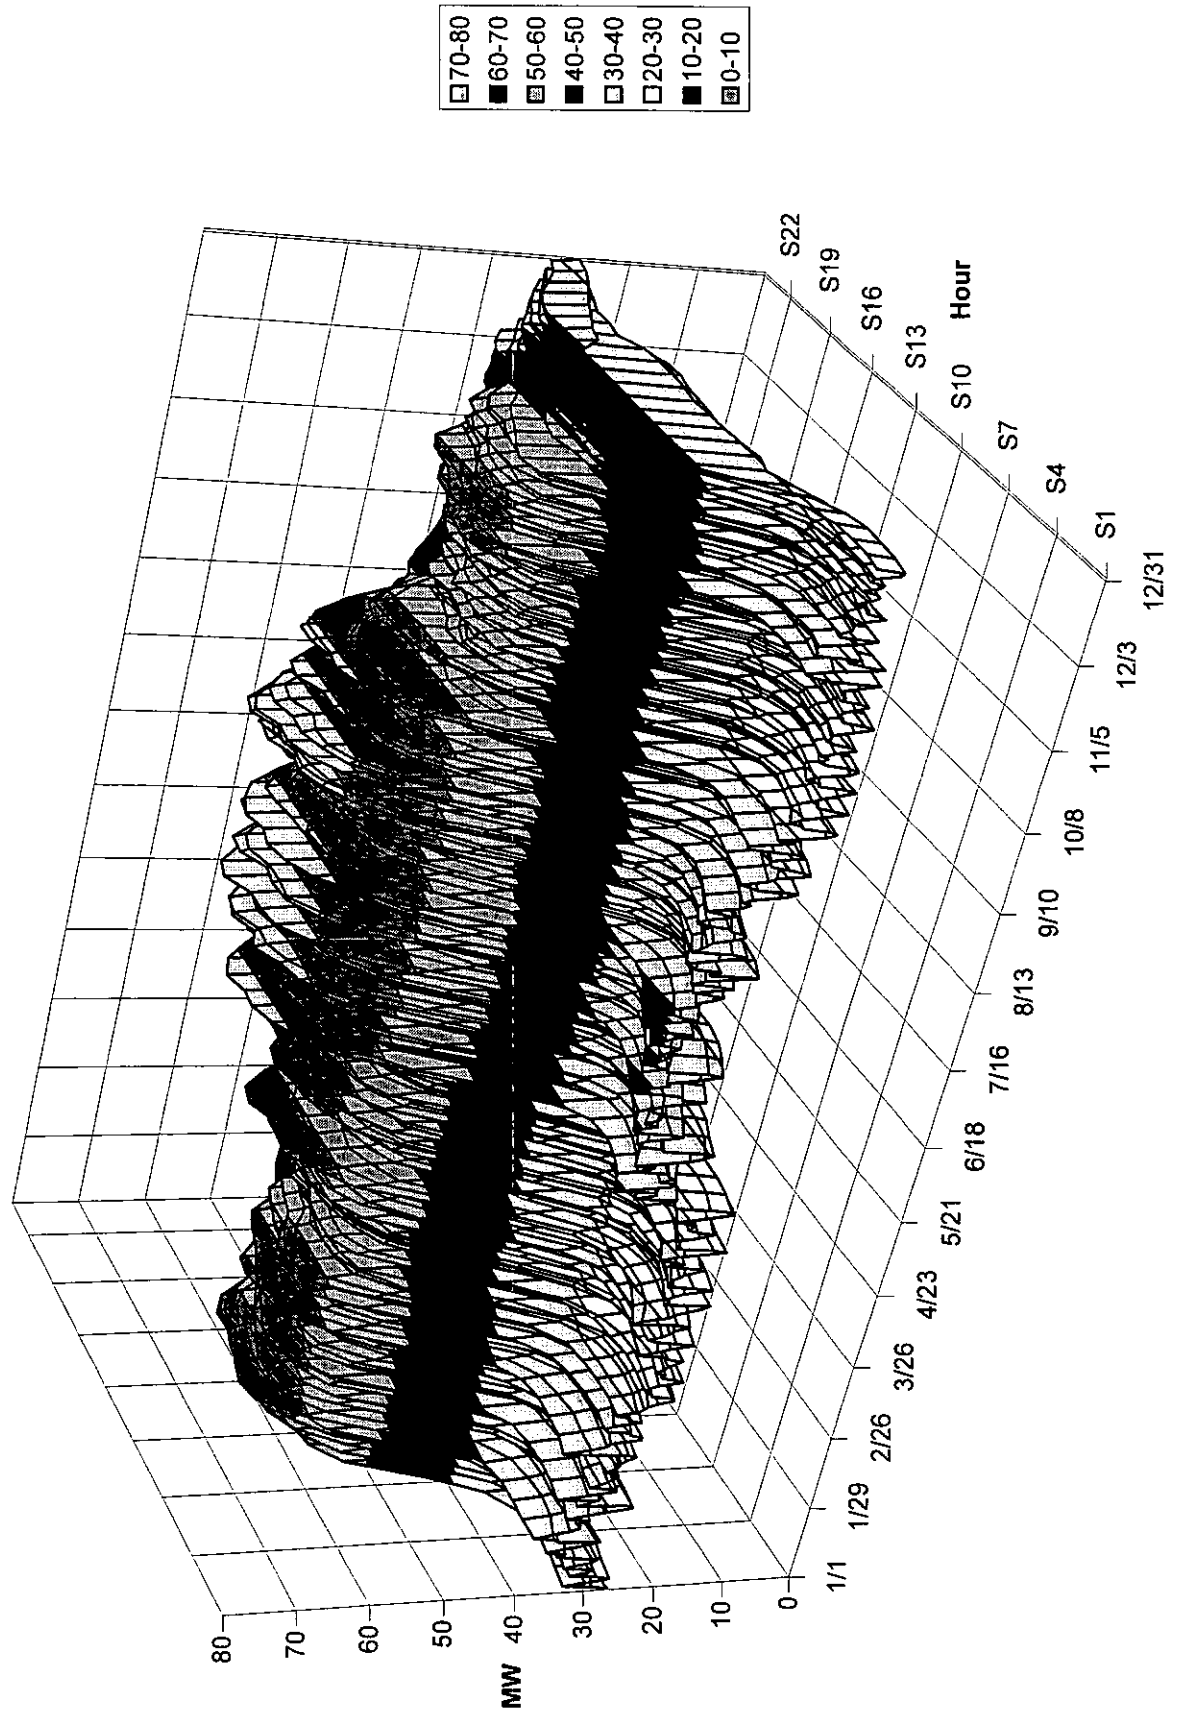

Aquila Networks - LP Large Power Service
Load Factor = 71%

Docket No. EO-2002-384

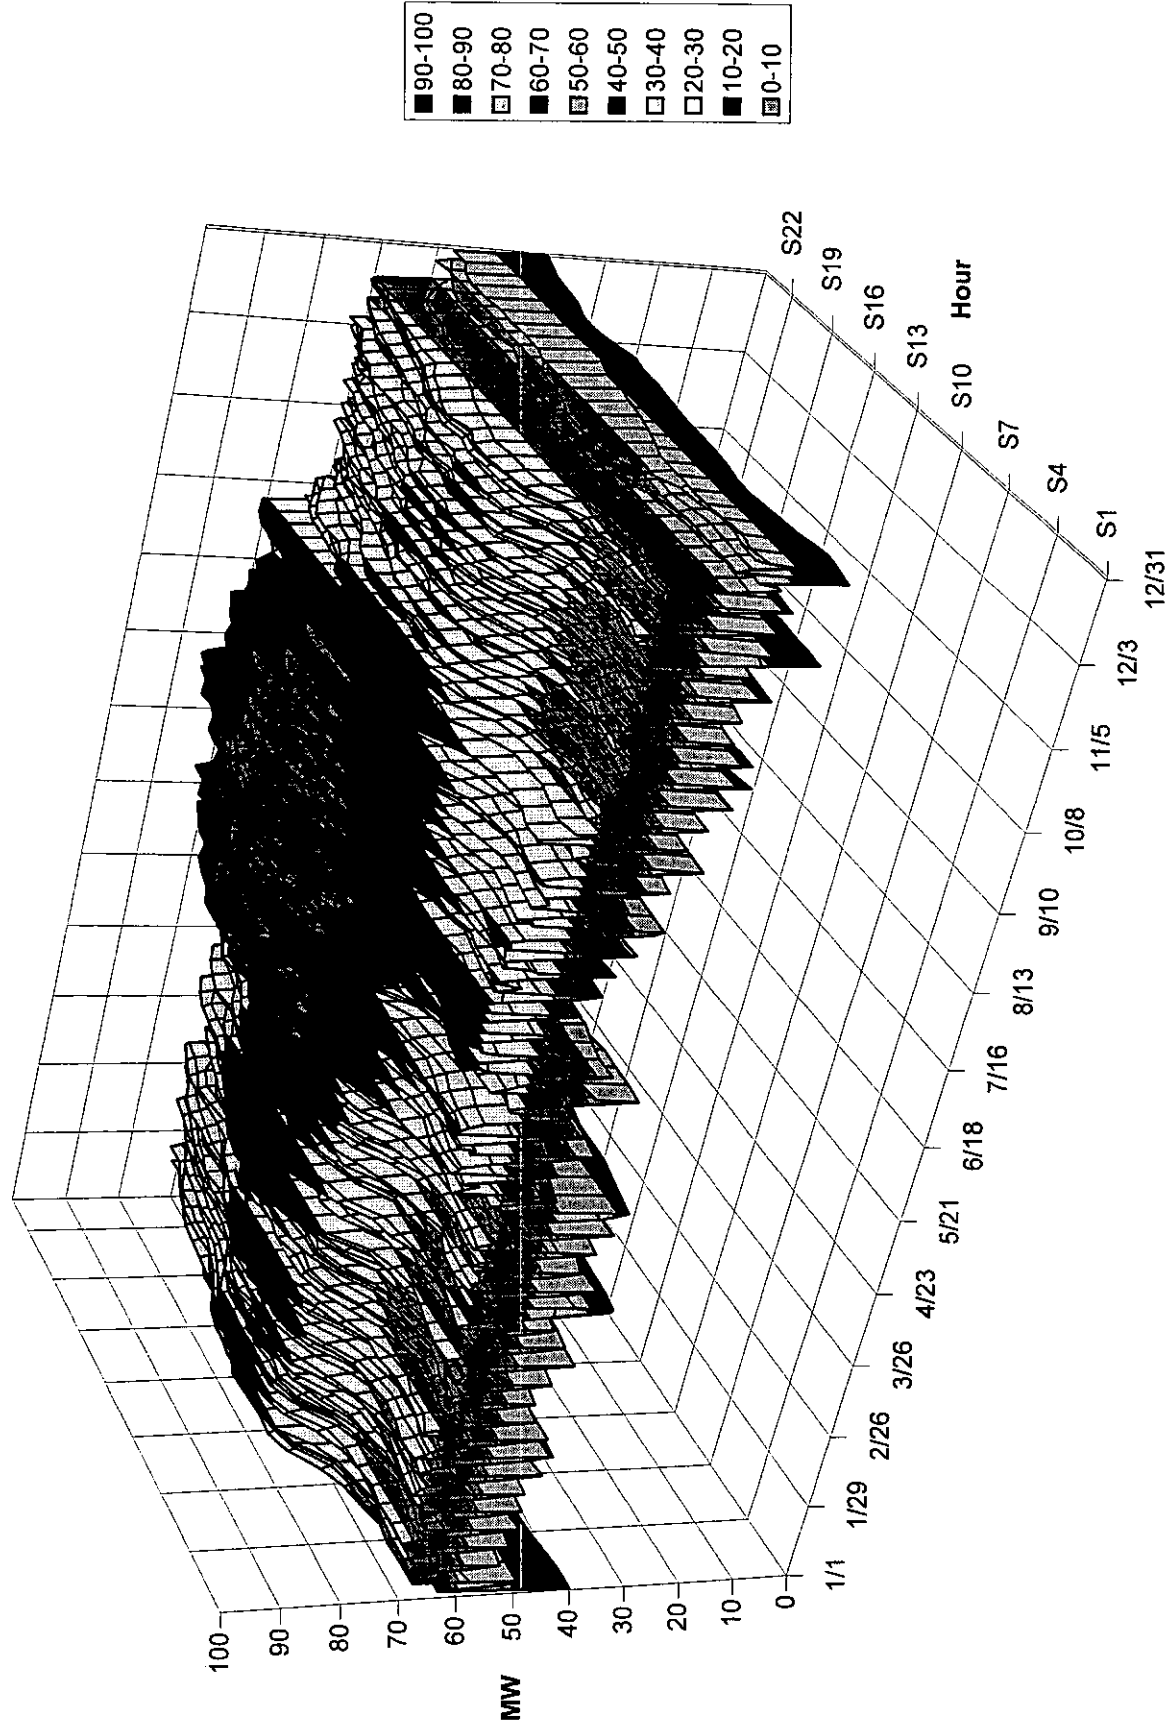

Aquila Networks - LP Lights
Load Factor = 49%

Docket No. EO-2002-384

